
















# Series 10-S0700

5 Port Solenoid Valve

## Variations

		S kit Serial Transmission (Fieldbus System)					
		EX180 For Output Serial Transmission System	EX260 For Output Serial Transmission System	EX500 Gateway-type Serial Transmission System	EX510 Gateway-type Serial Transmission System	EX250 For Input/Output Serial Transmission System	EX600 For Input/Output Serial Transmission System
		Applicable Protocol · DeviceNet® · CC-Link	Applicable Protocol · DeviceNet® · PROFIBUS DP · CC-Link · EtherNet/IP™ · EtherCAT · PROFINET · Ethernet POWERLINK	Applicable Protocol · PROFIBUS DP · EtherNet/IP™	Applicable Protocol · DeviceNet® · PROFIBUS DP · CC-Link	Applicable Protocol · DeviceNet® · AS-Interface · EtherNet/IP™	Applicable Protocol · DeviceNet® · PROFIBUS DP · CC-Link · EtherNet/IP™ · PROFINET
Slim Compact Plug-in Manifold Bar Base							
		Page 423-2			Page 425		
Plug-in Manifold Stacking Base							
			Page 423-6	Page 447		Page 449	Page 451
Plug Lead Manifold Bar Base							
					Page 495		

	<b>F kit</b> D-sub Connector	<b>P kit</b> Flat Ribbon Cable	<b>T kit</b> Terminal Block Box	<b>L kit</b> Lead Wire	<b>M kit</b> Circular Connector	<b>C kit</b> Connector
	MIL Standard	MIL Standard · 26 pins, 20 pins				
	 <b>Page 429</b>	 <b>Page 433</b>	—	—	—	—
	 <b>Page 457</b>	 <b>Page 461</b>	 <b>Page 469</b>	 <b>Page 473</b>	 <b>Page 477</b>	—
	—	—	—	—	—	 <b>Page 491</b>

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment





Fittings &amp; Tubing

Flow Control  
Equipment








Pressure Switches/  
Pressure Sensors

## Options





### Slim Compact Plug-in Manifold Bar Base / Options

<b>Blanking plate</b> <b>SS0700-10A-3</b> Page 440	<b>Individual SUP spacer</b> <b>S0700-P-3-C</b> Page 440	<b>Individual EXH spacer</b> <b>S0700-R-3-C</b> Page 440	<b>Blanking plate with output</b> <b>SS0700-3C-</b> Page 440
			

### Plug-in Manifold Stacking Base / Options









<b>Blanking plate</b> <b>SS0700-10A-1</b> Page 481	<b>Individual SUP/EXH spacer</b> <b>SS0700-PR-1</b> Page 481	<b>EXH block plate</b> <b>SS0700-B-R</b> Page 482	<b>Blanking plate with output</b> <b>SS0700-1C-</b> Page 483 Blanking plate with output
			
<b>External pilot [-R]</b> Page 481 External pilot port (M5 x 0.8)	<b>SUP block plate</b> <b>SS0700-B-P</b> Page 482	<b>Back pressure check valve [-B]</b> <b>SS0700-7A-1</b> Page 482	
			

### Plug Lead Manifold Bar Base / Options

<b>Blanking plate</b> <b>SS0700-10A-5</b> Page 497	<b>Individual SUP spacer</b> <b>SS0700-P-5-M5</b> Page 497	<b>Individual EXH spacer</b> <b>S0700-R-5-M5</b> Page 497	<b>Port plug</b> <b>VVQ0000-CP</b> Page 497
			
	* Compatible with 8.5 mm pitch only	* Compatible with 8.5 mm pitch only	

**External pilot [-R]  
Page 441**

External pilot port  
(M5 x 0.8)


**DIN rail mounting bracket  
SS0700-57A-3 Page 441**

**Port plug  
VVQ0000-CP Page 483**

**Blanking plug  
(For One-touch fitting)  
KJP-02  
KQ2P-23/04/06 Page 483**

**DIN rail mounting bracket  
SS0700-57A-□ Page 483**

**Name plate [-N]  
SS0700-N-Station (1 to Max.  
stations)  
Page 484**

**External pilot [-R]  
Page 497**

**Blanking plug  
(For One-touch fitting)  
KJP-02  
KQ2P-23/04/06 Page 498**

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment

Fittings &amp; Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



## Series 10-S0700

# Valve Specifications

## Valve Specifications

### Model

Series		Actuation type	Model	Flow rate characteristics						Note 2) Response time (msec)	Weight (g)
				1→4/2 (P→A/B)			4/2→5/3 (A/B→R1/R2)				
				C [dm³/(s·bar)]	b	Cv	C [dm³/(s·bar)]	b	Cv		
Slim compact Plug-in manifold Bar base	2-position	Single	S0711	0.39	0.39	0.11	0.37	0.39	0.10	18 or less	36
		Double	S0721	0.39	0.39	0.11	0.37	0.39	0.10	10 or less	41
	4-position	Dual 3-port valve	S07 <sup>A</sup> <sub>B1</sub> <sub>C</sub>	0.34	0.34	0.09	0.33	0.33	0.08	18 or less	41
Plug-in manifold Stacking base	2-position	Single	S0710	0.39	0.39	0.11	0.37	0.39	0.10	18 or less	30
		Double	S0720	0.39	0.39	0.11	0.37	0.39	0.10	10 or less	38
	4-position	Dual 3-port valve	S07 <sup>A</sup> <sub>B0</sub> <sub>C</sub>	0.34	0.34	0.09	0.33	0.33	0.08	18 or less	38
Plug lead manifold Bar base	2-position	Single	S0715	0.39	0.39	0.11	0.37	0.39	0.10	12 or less	28
		Double	S0725	0.39	0.39	0.11	0.37	0.39	0.10	10 or less	36
	4-position	Dual 3-port valve	S07 <sup>A</sup> <sub>B5</sub> <sub>C</sub>	0.34	0.34	0.09	0.33	0.33	0.08	12 or less	36

Note 1) Values for cylinder port fitting size C6

Note 2) Based on JIS B 8375-1993 (Supply pressure: 0.5 MPa, with indicator light and surge voltage suppressor, clean air. This will change depending on pressure and air quality.) The value when ON for the double type.

### Specifications

Valve specifications	Valve construction	Rubber seal
	Fluid	Air/Inert gas
	Max. operating pressure	0.7 MPa
	Min. operating pressure	0.2 MPa
	Ambient and fluid temperature	-10 to 50°C <sup>Note 1)</sup>
	Max. operating cycle	5 Hz
	Pilot valve exhaust method	Common exhaust <sup>Note 2)</sup>
	Pilot valve manual override	Push type
	Lubrication	Not required
	Impact/Vibration resistance <sup>Note 3)</sup>	30/100 m/s <sup>2</sup>
Electrical specifications	Enclosure	IP40
	Coil rated voltage	24 VDC
	Allowable voltage fluctuation	±10% of rated voltage
	Coil insulation type	Class B or equivalent
	Power consumption (Current)	24 VDC DC 0.35 W (15 mA)

Note 1) Use dry air to prevent condensation when operating at low temperatures.

Note 2) Since the pilot EXH of valves with the external pilot specification also has a common exhaust specification, the 3(R) port should be released to the atmosphere.

Note 3) Impact resistance: No malfunction occurred when it was tested with a drop tester in the axial direction and at right angles to the main valve and armature in both energized and de-energized states once for each condition.

Vibration resistance: No malfunction occurred in a one-sweep test between 8.3 and 2000 Hz. Test was performed in both energized and de-energized states in the axial direction and at right angles to the main valve and armature.

# Manifold Specifications

## Manifold Specifications

### Model

Base model		Piping specifications		Connection type	Applicable stations <small>Note 1)</small>	5-station weight (g) <small>Note 3)</small>	Addition per station (g) <small>Note 3)</small>
		Port size					
		1(P), 3(R)	4(A), 2(B)				
Slim compact Plug-in manifold Bar base	10-SS0751-□□□□	C6 (ø6) C8 (ø8) N7 (ø1/4") N9 (ø5/16") Option (Direct EXH outlet with built-in silencer)	C2 (ø2) C3 (ø3.2) C4 (ø4) N1 (ø1/8") N3 (ø5/32")	S kit: Serial transmission (EX510)	Max. 16 stations	320	19 <small>Note 7)</small>
				F kit: D-sub connector	Max. 24 stations	185	17
				P kit: Flat ribbon cable	Max. 24 stations	181	17
Plug-in manifold Stacking base	10-SS0750-□□□□	C6 (ø6) C8 (ø8) N7 (ø1/4") N9 (ø5/16") Option (Direct EXH outlet with built-in silencer)	C2 (ø2) C3 (ø3.2) C4 (ø4) N1 (ø1/8") N3 (ø5/32")	S kit: Serial transmission (EX500)	Max. 16 stations	360	20
				S kit: Serial transmission (EX250)	Max. 24 stations <small>Note 2)</small>	560 <small>Note 4)</small>	20
				F kit: D-sub connector	Max. 24 stations	330	20
				P kit: Flat ribbon cable	Max. 24 stations	325	20
				T kit: Terminal block box	Max. 20 stations	660	20
				L kit: Lead wire	Max. 24 stations	455 <small>Note 5)</small>	20
				M kit: Circular connector	Max. 24 stations	390	20
Plug lead manifold Bar base	10-SS0755-□□C□C (Manifold pitch: 8.5 mm*)	Rc1/8	M5 thread C2 (ø2) C3 (ø3.2) C4 (ø4) N1 (ø1/8") N3 (ø5/32")	C kit: Connector	Max. 20 stations	115	20
				S kit: Serial transmission (EX510)	Max. 16 stations	115	20
Single unit	10-S07□5-5□-M5	M5 thread	M5 thread	Connector kit	—	14 <small>Note 6)</small>	

Note 1) Maximum stations for mixed single and double wiring (special wiring specifications)

Note 2) Differs depending on the serial unit type. For details, refer to page 449.

Note 3) Weight excluding valve. Refer to page 421 for valve weight.

Note 4) Weight with one input block

Note 5) Weight with lead wire length 0.6 m

Note 6) Weight of sub-plate only. Refer to page 421 for valve weight.

Note 7) Including DIN rail weight

\* The manifold pitch 7.5 mm type is available as special order.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings & Tubing


Flow Control Equipment

Pressure Switches/  
Pressure Sensors

## Cylinder Speed Chart

Use as a guide for selection.  
Please confirm the actual conditions with  
SMC Model Selection Software.

### Base Mounted

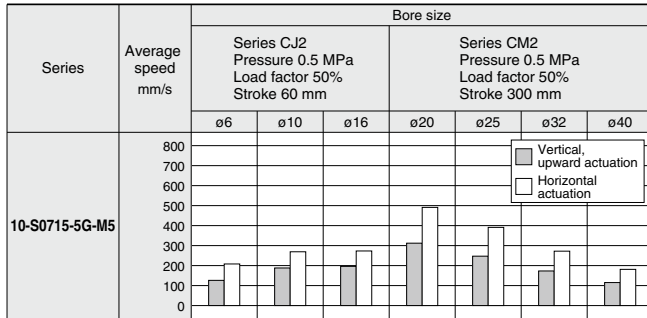

\* It is when the cylinder is extending that is meter-out controlled by speed controller which is directly connected with cylinder, and its needle valve with being fully open.

\* The average velocity of the cylinder is what the stroke is divided by the total stroke time.

\* Load factor: ((Load mass x 9.8)/Theoretical force) x 100%

### Conditions

Base mounted	Series CJ2	Series CM2
Tubing diameter x Length	ø6 x 1 m	
Speed controller	AS2001F-06	AS2301F-06
Silencer	AN120-M5	

## Symbol

Model	Actuation type	Symbol
10-S0710 10-S0711 10-S0715	2-position single	
10-S0720 10-S0721 10-S0725	2-position double	
10-S07A0 10-S07A1 10-S07A5	4-position dual 3-port (N.C. + N.C.) [Exhaust center]	
10-S07B0 10-S07B1 10-S07B5	4-position dual 3-port (N.O. + N.O.) [Pressure center]	
10-S07C0 10-S07C1 10-S07C5	4-position dual 3-port (N.C. + N.O.)	


# Slim Compact Bar Base

## Serial Transmission

# S kit



Slim Compact  
Bar Base

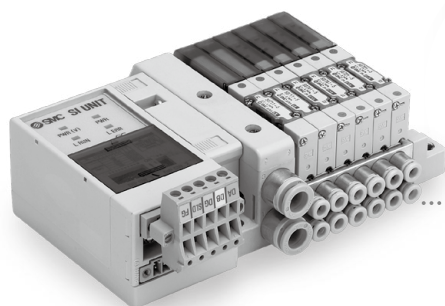

For Output  
Serial Transmission System  
**EX180**

Page 423-2

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



# 10-S0700 Series Slim Compact Bar Base

Kit (Serial Transmission) **EX180 (For Output) Serial Transmission System**

## How to Order Manifold



10-SS0751-08 C4 C8 SDV2

### Stations

Symbol	Stations
02	2 stations
⋮	⋮
32 <sup>*1</sup>	32 stations

\*1: The maximum number of stations will be different depending on the wiring specifications.

### Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
N1	With ø1/8" One-touch fitting	Inch
N3	With ø5/32" One-touch fitting	

### P, R port size

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	Inch
N9	With ø5/16" One-touch fitting	

\*: If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### SI Unit Part No.

Symbol	Component module/Communication connector	Common specification	SI unit part no.	Output stations
V2	CC-Link (32 points)	NPN output (Positive common)	EX180-SMJ3	Max. 32 <sup>*1</sup>
V2N	T-branch type	PNP output (Negative common)	EX180-SMJ5	
V2A	CC-Link (32 points)	NPN output (Positive common)	EX180-SMJ3A	
V2AN	Straight type	PNP output (Negative common)	EX180-SMJ5A	
Q2	DeviceNet® (32 points)	NPN output (Positive common)	EX180-SDN3	Max. 32 <sup>*1</sup>
Q2N	T-branch type	PNP output (Negative common)	EX180-SDN5	
Q2A	DeviceNet® (32 points)	NPN output (Positive common)	EX180-SDN3A	
Q2AN	Straight type	PNP output (Negative common)	EX180-SDN5A	
Q3	DeviceNet® (16 points)	NPN output (Positive common)	EX180-SDN4	Max. 16 <sup>*1</sup>
Q3N	T-branch type	PNP output (Negative common)	EX180-SDN6	
Q3A	DeviceNet® (16 points)	NPN output (Positive common)	EX180-SDN4A	
Q3AN	Straight type	PNP output (Negative common)	EX180-SDN6A	

\*1: Single wiring

### Kit type

Symbol	Specifications
SD0	Without SI unit
SDV2	CC-Link (32 points)
SDQ2	DeviceNet® (32 points)
SDQ3	DeviceNet® (16 points)

\*: Please contact SMC for SI unit specifications.

### Option

Symbol	Specifications
Nil	None
D	With DIN rail (Rail length: Standard)
D0	Without DIN rail (With bracket)
D□	With DIN rail Designated length (□: Station)
K <sup>*1</sup>	Special wiring specifications (Except double wiring)
R <sup>*2</sup>	External pilot

\*1: Indicate the wiring specifications for mixed single and double wirings.

\*2: For details, refer to page 481.

\*: When two or more options are specified, indicate them alphabetically.

Example: -KR

\*: For manifold optional parts, refer to pages 481 to 484.

\*: For manifold exploded view, refer to page 487.

Refer to the **Web Catalog** and the Operation Manual for the details of the EX180 Integrated-type (For Output) Serial Transmission System. Please download the Operation Manual via our website, <http://www.smcworld.com>

\*: The maximum number of stations is determined by the total number of solenoids.

For mixed single and double wirings, enter -K to the order code options.

\*: For the 10-S0700 series, SI unit models EX180-SDN1, EX180-SDN2, or EX180-SMJ1 cannot be selected as S kit (SDQ□, SDV2).

Type of actuation	Single	Double, Dual 3-port
Number of solenoids	1	2

## How to Order Manifold Assembly

### Example Serial transmission kit

Specify the part numbers for valves and options together beneath the manifold base part number.

10-SS0751-08C4C8SDQ2 ... 1 set - Manifold base part no.  
 \* 10-S0711-5 ..... 3 sets - Valve part no. (Stations 1 to 3)  
 \* 10-S0721-5 ..... 2 sets - Valve part no. (Stations 4 to 5)  
 \* 10-S07A1-5 ..... 2 sets - Valve part no. (Stations 6 to 7)  
 \* 10-SS0700-10A-3 ... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part numbers of the solenoid valve etc. Write sequentially from the 1st station on the D side. When part numbers written collectively are complicated, specify on the manifold specification sheet.

## How to Order Valves

10-S07 1 1 - 5

### Type of actuation

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

\*: For symbol, refer to page 652.


### Voltage: 24 VDC

### Function



Symbol	Specifications
Nil	Standard
R	External pilot <sup>*1</sup>

\*1: Not compatible with dual 3-port valves. The 3(R) port is open to the atmosphere. (Cannot be used for applying pressure or vacuum)

### Base mounted plug-in



**10-SS0751**  
**S kit (Serial transmission: EX180)**

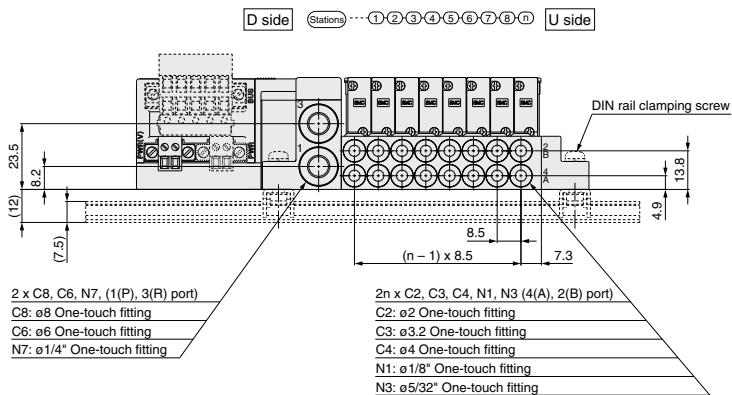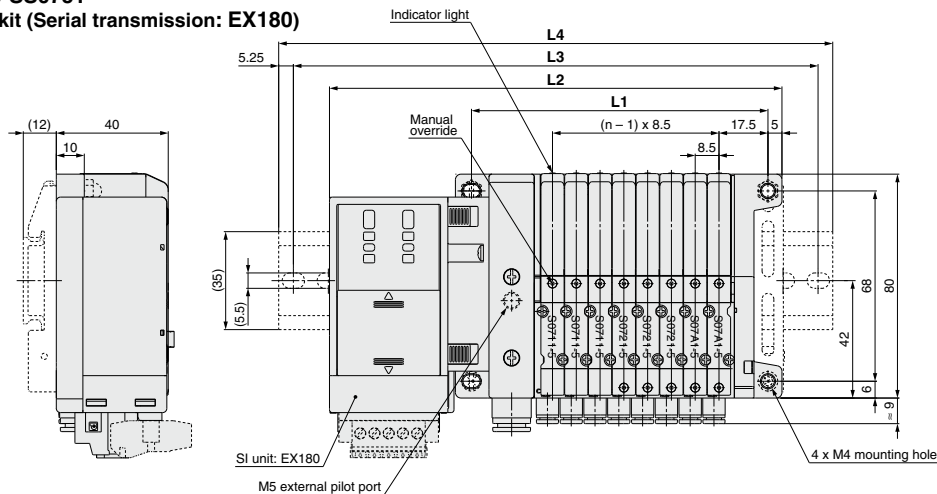

\*: Dotted line indicates DIN rail mounting bracket (-D).

**Dimensions**

Formula  $L1 = 8.5n + 38$ ,  $L2 = 8.5n + 93.7$  n: Station (Maximum 32 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
L1	55	63.5	72	80.5	89	97.5	106	114.5	123	131.5	140	148.5	157	165.5	174	182.5	191
L2	110.7	119.2	127.7	136.2	144.7	153.2	161.7	170.2	178.7	187.2	195.7	204.2	212.7	221.2	229.7	238.2	246.7
L3	137.5	150	150	162.5	175	175	187.5	200	200	212.5	225	225	237.5	250	250	262.5	275
L4	148	160.5	160.5	173	185.5	185.5	198	210.5	210.5	223	235.5	235.5	248	260.5	260.5	273	285.5

L \ n	19	20	21	22	23	24	25	26	27	28	29	30	31	32
L1	199.5	208	216.5	225	233.5	242	250.5	259	267.5	276	284.5	293	301.5	310
L2	255.2	263.7	272.2	280.7	289.2	297.7	306.2	314.7	323.2	331.7	340.2	348.7	357.2	365.7
L3	275	287.5	300	312.5	312.5	325	337.5	337.5	350	362.5	362.5	375	387.5	387.5
L4	285.5	298	310.5	323	323	335.5	348	348	360.5	373	373	385.5	398	398



# Plug-in Type Stacking Base

## Serial Transmission

# S kit

Plug-in Type  
Stacking Base



For Output  
Serial Transmission System  
**EX260**

Page 423-6



Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



## Plug-in Type

# S


# 10-S0700 Series Stacking Base

## Kit (Serial Transmission) EX260 (For Output) Serial Transmission System

### How to Order Manifold

10-SS0750-08 C4 C8 SNAN-B

1 2 3 4 5



### 1 Stations

In the case of the 32-output SI unit

Symbol	Stations	Note
01	1 station	Double wiring*1
...	...	
16	16 stations	
01	1 station	Specified layout*2 (Available up to 32 solenoids)
...	...	
24	24 stations	

In the case of the 16-output SI unit

Symbol	Stations	Note
01	1 station	Double wiring*1
...	...	
08	8 stations	
01	1 station	Specified layout*2 (Available up to 16 solenoids)
...	...	
16	16 stations	

- \*1: Double wiring : single, double, 3-position and 4-position solenoid valves can be used on all manifold stations.  
Up to 24 stations due to the structure of the manifold. Please note the maximum number of stations is 24 for single wiring, too.
- \*2: Specified layout: Indicate the wiring specifications with the manifold specification sheet.  
(Note that double, 3-position and 4-position valves cannot be used where single solenoid wiring has been specified.)
- \*3: This also includes the number of blanking plate assembly.

### 2 Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3/2 One-touch fitting	
C4	With ø4 One-touch fitting	
CM	Mixed sizes and with port plug*1	Inch
N1	With ø1/8" One-touch fitting	
N3	With ø5/32" One-touch fitting	
NM	Mixed sizes and with port plug*1	

- \*1: Specify Mixed sizes and with port plug on the manifold specification sheet.

### 3 P, R port size

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	Inch
N9	With ø5/16" One-touch fitting	

- \*: If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### 4 SI unit specifications

(Output polarity, protocol, number of outputs, communication connector)

Symbol (output polarity)	Protocol	Number of outputs	Communication connector
Positive common (NPN)			
Negative common (NPN)			
SD0*1	Without SI unit		
SQA SQAN	DeviceNet®	32	M12
SQB SQAN		16	
SNA SNAN	PROFIBUS DP	32	M12
SNB SNBN		16	
SNC SNCN		32	D-sub *4
SND SNDN		16	
SVA SVAN	CC-Link	32	M12
SVB SVBN		16	
SDA SDAN	EtherCAT	32	M12
SDB SDBN		16	
SFA SFAN	PROFINET	32	M12
SFB SFBN		16	
SEA SEAN	EtherNet/IP™	32	M12
SEB SEBN		16	
—*3	SGAN Ethernet	32	M12
—*3	SGBN POWERLINK	16	

- \*1: Without SI Unit, the output polarity is decided by the SI unit used.
- \*2: DIN rail cannot be mounted without SI unit.
- \*3: Positive common (NPN) type is not applicable.
- \*4: IP40 for the D-sub applicable communication connector specification.
- \*5: The maximum number of stations is determined by the total number of solenoids.  
For mixed single and double wirings, enter -K to the order code options.
- \*6: For SI unit part number, refer to page 444.

Type of actuation	Single	Double, Dual 3-port
Number of solenoids	1	2

### 5 Option

Symbol	Specifications
Nil	None
B*1	With back pressure check valve (All stations)
D	With DIN rail (Rail length: Standard)
D0	Without DIN rail (with bracket)
D□*2	With DIN rail Designated length (□: Station)
K*3	Special wiring specifications (Except double wiring)
N	With name plate
R*4	External pilot

- \*1: When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.
- \*2: The available number of stations is larger than the number of manifold stations.
- \*3: Indicate the wiring specifications for mixed single and double wirings.
- \*4: For details, refer to page 481.
- \*: When two or more options are specified, indicate them alphabetically. Example) -BKN
- \*: For manifold optional parts, refer to pages 481 to 484.
- \*: For manifold exploded view, refer to page 487.
- \*: When the SD0 (Without SI unit) is specified, -D, -D□ cannot be selected.

Refer to the **Web Catalog** and the Operation Manual for the details of the EX260 Integrated-type (For Output) Serial Transmission System. Please download the Operation Manual via our website, <http://www.smcworld.com>

### How to Order Valves

10-S07 1 0 - 5

Type of actuation • Voltage: 24 VDC

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

- \*: For symbol, refer to page 423.

### Function

Symbol	Specifications
Nil	Standard
R	External pilot*1

- \*1: Not compatible with dual 3-port valves.  
The 3(R) port is open to the atmosphere.  
(Cannot be used for applying pressure or vacuum)

### Base mounted plug-in

### How to Order Manifold Assembly


#### Example Serial transmission kit

Specify the part numbers for valves and options together beneath the manifold base part number.




10-SS0750-04C8SNAN... 1 set - Manifold base part no.  
10-S0720-5 ..... 4 sets - Valve part no. (Stations 1 to 4)

Prefix the asterisk to the part numbers of the solenoid valve etc.


Write sequentially from the 1st station on the D side. When part numbers written collectively are complicated, specify on the manifold specification sheet.



**10-SS0750**  
**S kit (Serial transmission: EX260)**

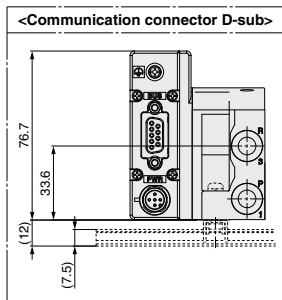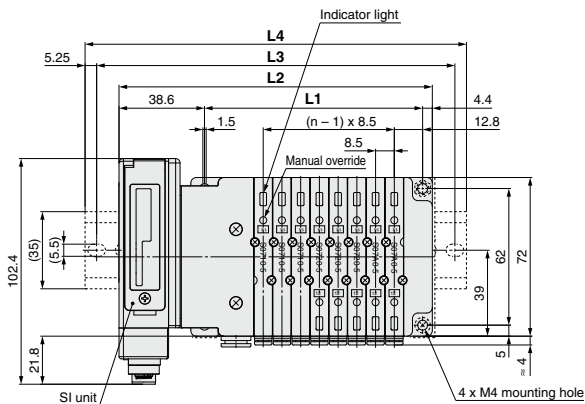

D side Stations 1 2 3 4 5 6 7 8 n U side

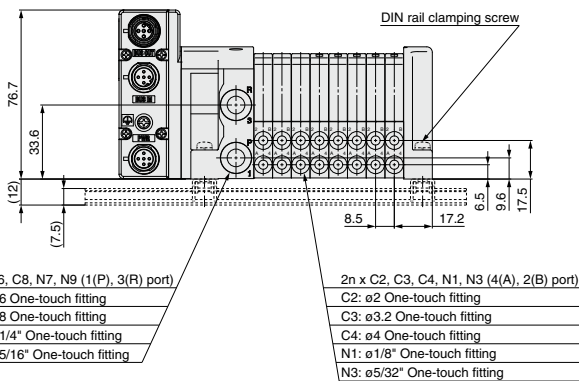

**Dimensions**

Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 74$  n: Station (Maximum 24 stations)

L \ n	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	39.5	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167
L2	82.5	91	99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210
L3	112.5	112.5	125	137.5	137.5	150	162.5	162.5	175	187.5	187.5	200	212.5	212.5	225	237.5
L4	123	123	135.5	148	148	160.5	173	173	185.5	198	198	210.5	223	223	235.5	248

L \ n	17	18	19	20	21	22	23	24
L1	175.5	184	192.5	201	209.5	218	226.5	235
L2	218.5	227	235.5	244	252.5	261	269.5	278
L3	250	250	262.5	275	275	287.5	300	300
L4	260.5	260.5	273	285.5	285.5	298	310.5	310.5




## Slim Compact Plug-in Manifold Bar Base

# Serial Transmission

# S kit

Slim Compact  
Plug-in Manifold  
Bar Base

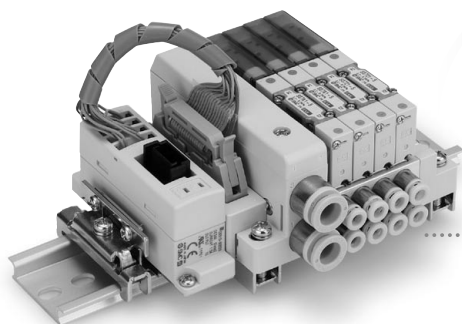

Gateway-type  
Serial Transmission  
System

**EX510**



Page 425

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment


Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors

# S

## Series 10-S0700 Slim Compact Plug-in Manifold Bar Base kit (Serial Transmission) EX510 Gateway-type Serial Transmission System



### How to Order Manifold

10-SS0751-08 C4 C8 SB -

Clean series

Stations

Symbol	Stations
01	1 station
:	:
16 (Note)	16 stations

(Note) The maximum number of stations will be different depending on the wiring specifications.

Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	Inch
N1	With ø1/8" One-touch fitting	
N3	With ø5/32" One-touch fitting	

Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
1 to 8 stations	16 stations	16

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

P, R port size

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	Inch
N9	With ø5/16" One-touch fitting	

(Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

Option

Symbol	Specifications
Nil	None
K (Note 2)	Special wiring specifications (Except double wiring)
R (Note 3)	External pilot

Note 1) When two or more options are specified, indicate them alphabetically.

Example) -KR

Note 2) Indicate the wiring specifications for mixed single and double wirings.

Note 3) For details, refer to page 441.

\* For manifold optional parts, refer to pages 440 and 441.

\* For manifold exploded view, refer to page 443.

SI unit output polarity

SI unit output polarity	
Nil	+COM.
N	-COM.

S kit  
EX510 serial wiring

Refer to the **WEB catalog** for details on the EX510 Gateway-type Serial Transmission System.

### How to Order Valve

10-S07 1 1 - 5

Clean series

Actuation type

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

(Note) For symbol, refer to page 423.

Voltage: 24 VDC

Function

Symbol	Specifications
Nil	Standard
R	External pilot (Note)

(Note) Not compatible with dual 3-port valves. The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in

### How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

<Example>

Serial transmission kit

10-SS0751-08C4C8SB...1 set - Manifold base part no.

\* 10-S0711-5 ..... 3 sets - Valve part no. (Stations 1 to 3)


\* 10-S0721-5 ..... 2 sets - Valve part no. (Stations 4 to 5)


\* 10-S07A1-5 ..... 2 sets - Valve part no. (Stations 6 to 7)

\* SS0700-10A-3 ..... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.

Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



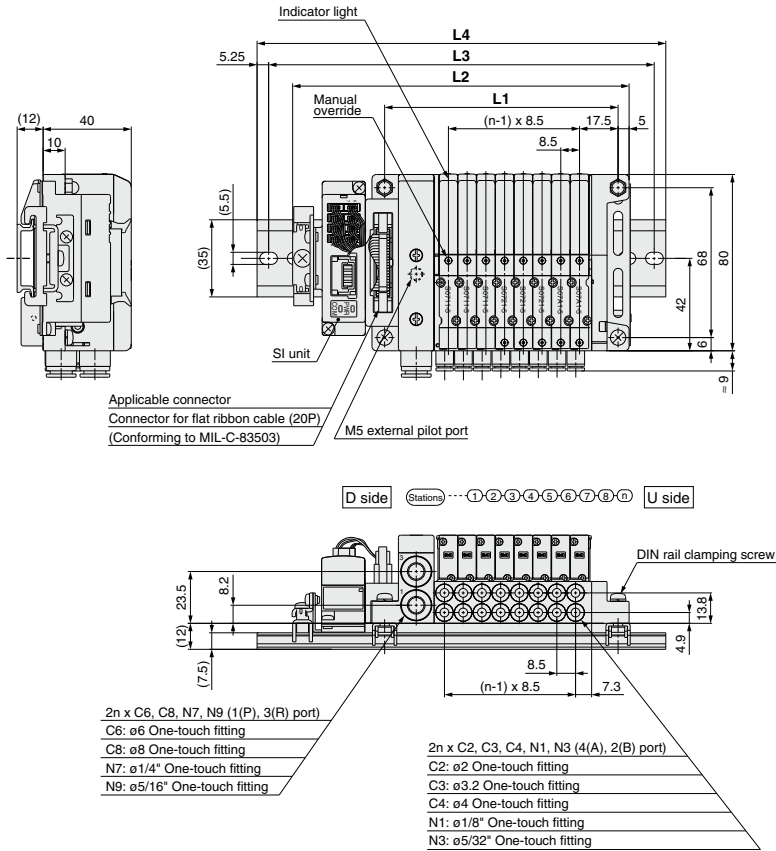**10-SS0751****S kit (Serial transmission: EX510)****Dimensions**Formula  $L1 = 8.5n + 38$ ,  $L2 = 8.5n + 84.7$  n: Station (Maximum 16 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
<b>L1</b>	55	63.5	72	80.5	89	97.5	106	114.5	123	131.5	140	148.5	157	165.5	174
<b>L2</b>	101.7	110.2	118.7	127.2	135.7	144.2	152.7	161.2	169.7	178.2	186.7	195.2	203.7	212.2	220.7
<b>L3</b>	125	137.5	150	150	162.5	175	175	187.5	200	200	212.5	225	225	237.5	250
<b>L4</b>	135.5	148	160.5	160.5	173	185.5	185.5	198	210.5	210.5	223	235.5	235.5	248	260.5




## Slim Compact Plug-in Manifold Bar Base

# D-sub Connector

# F kit

Slim Compact  
Plug-in Manifold  
Bar Base

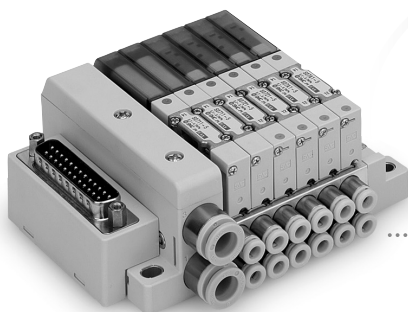

### MIL Standard

- 25 pins
- Cable length: 1.5 m, 3 m, 5 m



Page 429

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment


Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors




# F Series 10-S0700 Slim Compact Plug-in Manifold Bar Base kit (D-sub Connector)



- The D-sub connector reduces installation labor for electrical connections.
- Using the D-sub connector (25P) conforming to MIL standard permits the use of commercial connectors and gives a wide interchangeability.

## Electrical Wiring Specifications

### D-sub connector




As the standard electrical wiring specifications, double wiring (connected to SOL.A and SOL.B) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types. Mixed single and double wiring is available as an option. For details, refer to "Special Wiring Specifications" (Option) below.

### D-sub connector assembly wire color (AXT100-DS25-015 to 050)

	Terminal no.	Polarity	Lead wire color	Dot marking	
Station 1	<u>SOL A</u> 1	(-)	(+)	Black	None
	<u>SOL B</u> 14	(-)	(+)	Yellow	Black
Station 2	<u>SOL A</u> 2	(-)	(+)	Brown	None
	<u>SOL B</u> 15	(-)	(+)	Pink	Black
Station 3	<u>SOL A</u> 3	(-)	(+)	Red	None
	<u>SOL B</u> 16	(-)	(+)	Blue	White
Station 4	<u>SOL A</u> 4	(-)	(+)	Orange	None
	<u>SOL B</u> 17	(-)	(+)	Purple	None
Station 5	<u>SOL A</u> 5	(-)	(+)	Yellow	None
	<u>SOL B</u> 18	(-)	(+)	Gray	None
Station 6	<u>SOL A</u> 6	(-)	(+)	Pink	None
	<u>SOL B</u> 19	(-)	(+)	Orange	Black
Station 7	<u>SOL A</u> 7	(-)	(+)	Blue	None
	<u>SOL B</u> 20	(-)	(+)	Red	White
Station 8	<u>SOL A</u> 8	(-)	(+)	Purple	White
	<u>SOL B</u> 21	(-)	(+)	Brown	White
Station 9	<u>SOL A</u> 9	(-)	(+)	Gray	Black
	<u>SOL B</u> 22	(-)	(+)	Pink	Red
Station 10	<u>SOL A</u> 10	(-)	(+)	White	Black
	<u>SOL B</u> 23	(-)	(+)	Gray	Red
Station 11	<u>SOL A</u> 11	(-)	(+)	White	Red
	<u>SOL B</u> 24	(-)	(+)	Black	White
Station 12	<u>SOL A</u> 12	(-)	(+)	Yellow	Red
	<u>SOL B</u> 25	(-)	(+)	White	None
	COM. 13	(+)	(-)	Orange	Red
	Positive pole		Negative pole	Note)	

Note) Mounting valve has no polarity. It can also be used as a negative common.

## Special Wiring Specifications (Option) [-K]



Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 24.

### 1. How to order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations of the single and double wiring on the manifold specification sheet.

### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.

## Cable Assembly


### AXT100-DS25-030 050

(The D-sub connector cable assemblies can be ordered with manifolds.)  
Refer to "How to Order Manifold."

### D-sub connector cable assembly

#### Wire Color by Terminal No.

Terminal no.	Lead wire color	Dot marking
1	Black	None
2	Brown	None
3	Red	None
4	Orange	None
5	Yellow	None
6	Pink	None
7	Blue	None
8	Purple	White
9	Gray	Black
10	White	Black
11	White	Red
12	Yellow	Red
13	Orange	Red
14	Yellow	Black
15	Pink	Black
16	Blue	White
17	Purple	None
18	Gray	None
19	Orange	Black
20	Red	White
21	Brown	White
22	Pink	Red
23	Gray	Red
24	Black	White
25	White	None

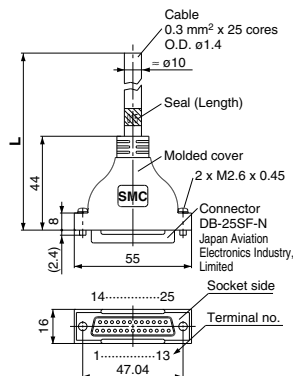

### D-sub Connector Cable Assembly (Option)

Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-DS25-015	
3 m	AXT100-DS25-030	Cable 0.3 mm² x 25 cores
5 m	AXT100-DS25-050	

\* For other commercial connectors, use a 25-pin type with female connector conforming to MIL-C-24308.

\* Cannot be used for movable wiring.

### Electrical Characteristics

Item	Property
Conductor resistance $\Omega/\text{km}$ , 20°C	65 or less
Voltage limit V, 1 minute, AC	1000
Insulation resistance $\text{M}\Omega/\text{km}$ , 20°C	5 or more

Note) The minimum bending radius of D-sub connector cable is 20 mm.

### Example of connector manufacturers

- Fujitsu Limited
- Japan Aviation Electronics Industry, Limited
- J.S.T. Mfg. Co., Ltd.
- HIROSE ELECTRIC CO., LTD.



## How to Order Manifold

**10-SS0751-08 C4 C8 FD1-**

Clean series

### Stations

Symbol	Stations
01	1 station
⋮	⋮
24 <sup>(Note)</sup>	24 stations

(Note) The maximum number of stations will be different depending on the wiring specifications.

### Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
N1	With ø1/8" One-touch fitting	Inch
N3	With ø5/32" One-touch fitting	

### P, R port size

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	
N9	With ø5/16" One-touch fitting	Inch

(Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### Option

Symbol	Specifications
Nil	None
D	With DIN rail (Rail length: Standard)
D0	Without DIN rail (With bracket)
D□ <sup>(Note 2)</sup>	With DIN rail Designated length (□: Station)
K <sup>(Note 3)</sup>	Special wiring specifications (Except double wiring)
R <sup>(Note 4)</sup>	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -DKR

Note 2) The available number of stations is larger than the number of manifold stations.

Note 3) Indicate the wiring specifications for mixed single and double wirings.

Note 4) For details, refer to page 441.

\* For manifold optional parts, refer to pages 440 to 441.

\* For manifold exploded view, refer to page 443.

### Kit type/Cable length

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
F kit	FD0	D-sub connector (25P), without cable	1 to 12 stations	24 stations	24
	FD1	D-sub connector (25P), with 1.5 m cable			
	FD2	D-sub connector (25P), with 3.0 m cable			
	FD3	D-sub connector (25P), with 5.0 m cable			

(Note) The maximum number of stations is determined by the total number of solenoids. For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

## How to Order Valve

**10-S07 1 1 - 5**

Clean series

### Actuation type

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

(Note) For symbol, refer to page 423.

### Voltage

Symbol	Specifications
5	24 VDC
6	12 VDC

### Function

Symbol	Specifications
Nil	Standard
R	External pilot <sup>(Note)</sup>

(Note) Not compatible with dual 3-port valves. The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in


## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

D-sub connector kit  
 10-SS0751-08C4C8FD1... 1 set - Manifold base part no.  
 = 10-S0711-5 ..... 3 sets - Valve part no. (Stations 1 to 3)  
 = 10-S0721-5 ..... 2 sets - Valve part no. (Stations 4 to 5)  
 = 10-S07A1-5 ..... 2 sets - Valve part no. (Stations 6 to 7)  
 = SS0700-10A-3 ..... 1 set - Blanking plate part no. (Station 8)

Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment



Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

# F

## Series 10-S0700 kit (D-sub Connector)

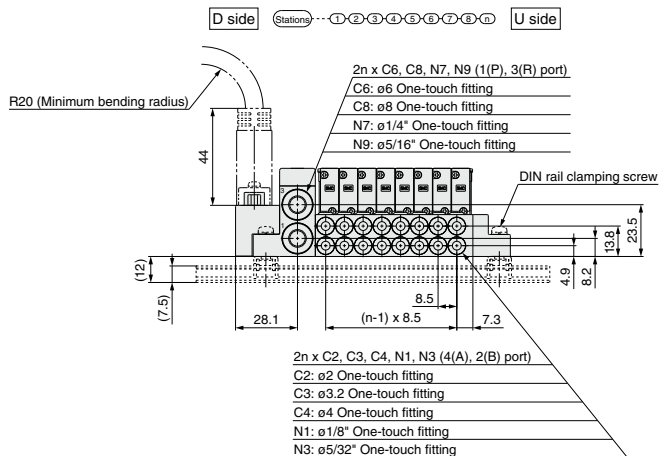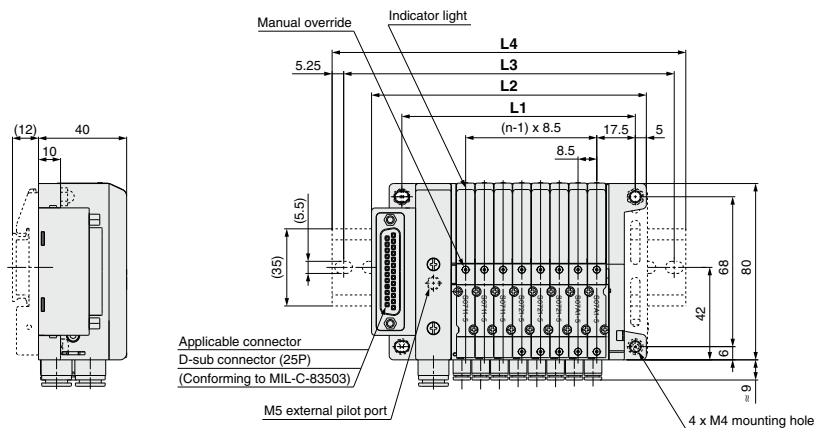

### Dimensions

Formula L1 = 8.5n + 38, L2 = 8.5n + 56.7 n: Station (Maximum 24 stations)


L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
L1	55	63.5	72	80.5	89	97.5	106	114.5	123	131.5	140	148.5	157	165.5	174	182.5	191	199.5	208	216.5	225	233.5	242
L2	73.7	82.2	90.7	99.2	107.7	116.2	124.7	133.2	141.7	150.2	158.7	167.2	175.7	184.2	192.7	201.2	209.7	218.2	226.7	235.2	243.7	252.2	260.7
L3	100	112.5	112.5	125	137.5	137.5	150	162.5	162.5	175	187.5	187.5	200	212.5	212.5	225	237.5	237.5	250	262.5	275	275	287.5
L4	110.5	123	123	135.5	148	148	160.5	173	173	185.5	198	198	210.5	223	223	235.5	248	248	260.5	273	285.5	285.5	298

## Slim Compact Plug-in Manifold Bar Base

### Flat Ribbon Cable

# P kit

**Slim Compact  
Plug-in Manifold  
Bar Base**

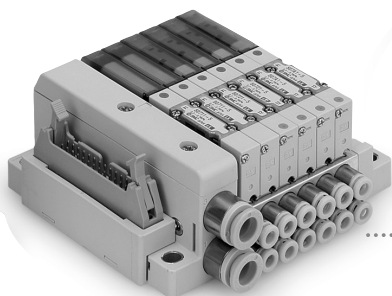

#### MIL Standard

- 26 pins, 20 pins
- Cable length:  
1.5 m, 3 m, 5 m



➤ **Page 433**

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment


Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment


Pressure Switches/  
Pressure Sensors



- Flat ribbon cable connector reduces installation labor for electrical connection.
- Using the connector for flat ribbon cable (26P, 20P) conforming to MIL standard permits the use of commercial connectors and gives a wide interchangeability.

## Electrical Wiring Specifications

### Flat ribbon cable connector




Double wiring (connected to SOL.A and SOL.B) is adopted for the internal wiring of each station, regardless of valve and option types. Mixed single and double wiring is available as an option. For details, refer to "Special Wiring Specifications" (Option) below.


Connector terminal no.

Triangle mark indicator position

### <26P>

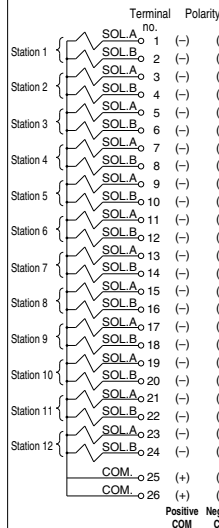

### <20P>

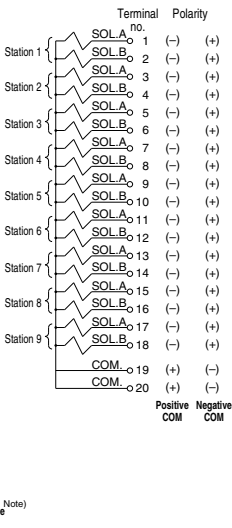


Note) Mounting valve has no polarity. It can also be used as a negative common.

## Cable Assembly

### AXT100-FC<sup>20</sup><sub>26</sub><sup>1</sup><sub>3</sub>

(Type 26P flat ribbon cable connector assemblies can be ordered with manifolds. Refer to "How to Order Manifold.")

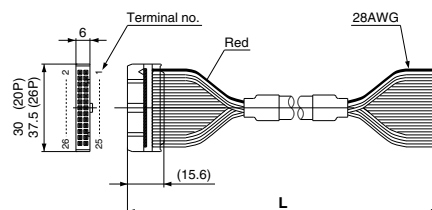

### Flat Ribbon Cable Connector Assembly (Option)


Cable length (L)	Assembly part no.	
	26P	20P
1.5 m	AXT100-FC26-1	AXT100-FC20-1
3 m	AXT100-FC26-2	AXT100-FC20-2
5 m	AXT100-FC26-3	AXT100-FC20-3

- \* For other commercial connectors, use a 20- or 26-pin type with strain relief conforming to MIL-C-83503.
- \* Cannot be used for movable wiring.

### Example of connector manufacturers

- HIROSE ELECTRIC CO., LTD.
- 3M Japan Limited
- Fujitsu Limited
- Japan Aviation Electronics Industry, Limited
- J.S.T. Mfg. Co., Ltd.
- Oki Electric Cable Co., Ltd.

## Special Wiring Specifications (Option) [-K]



Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 24 for 26P, 18 for 20P.

### 1. How to Order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations on the manifold specification sheet.

### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.

**How to Order Manifold**

**10-SS0751-08C4C8PD1-**

Clean series

**Stations**

Symbol	Stations
01	1 station
:	:
24	24 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

**Cylinder port size**

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
N1	With ø1/8" One-touch fitting	Inch
N3	With ø5/32" One-touch fitting	

**P, R port size**

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	Inch
N9	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

**Option**

Symbol	Specifications
Nil	None
D	With DIN rail (Rail length: Standard)
D0	Without DIN rail (With bracket)
D□ Note 2)	With DIN rail Designated length (□: Station)
K Note 3)	Special wiring specifications (Except double wiring)
R Note 4)	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -DKR

Note 2) The available number of stations is larger than the number of manifold stations.

Note 3) Indicate the wiring specifications for mixed single and double wirings.

Note 4) For details, refer to page 441.

\* For manifold optional parts, refer to pages 440 to 441.

\* For manifold exploded view, refer to page 443.

**Kit type/Cable length**

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
P kit	PD0	Flat ribbon cable (26P), without cable	1 to 12 stations	24 stations	24
	PD1	Flat ribbon cable (26P), with 1.5 m cable			
	PD2	Flat ribbon cable (26P), with 3.0 m cable			
	PD3	Flat ribbon cable (26P), with 5.0 m cable			
	PDC	Flat ribbon cable (20P), without cable	1 to 9 stations	18 stations	18

Note) The maximum number of stations is determined by the total number of solenoids.

For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

**How to Order Valve**

**10-S0711-11-5**

Clean series

**Actuation type**

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

Base mounted plug-in

**Voltage**

Symbol	Specifications
5	24 VDC
6	12 VDC

**Function**

Symbol	Specifications
Nil	Standard
R	External pilot (Note)

Note) Not compatible with dual 3-port valves. The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

**How to Order Manifold Assembly**

Specify the part numbers for valves and options together beneath the manifold base part number.


**<Example>**

Flat ribbon cable kit

- 10-SS0751-08C4C8PD1...1 set - Manifold base part no.  
 \* 10-S0711-5 ..... 2 sets - Valve part no. (Stations 1 to 3)  
 \* 10-S0721-5 ..... 4 sets - Valve part no. (Stations 4 to 5)  
 \* 10-S07A1-5 ..... 1 set - Valve part no. (Stations 6 to 7)  
 \* SS0700-10A-3 ..... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.

Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment



Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

# P

## Series 10-S0700 kit (Flat Ribbon Cable)

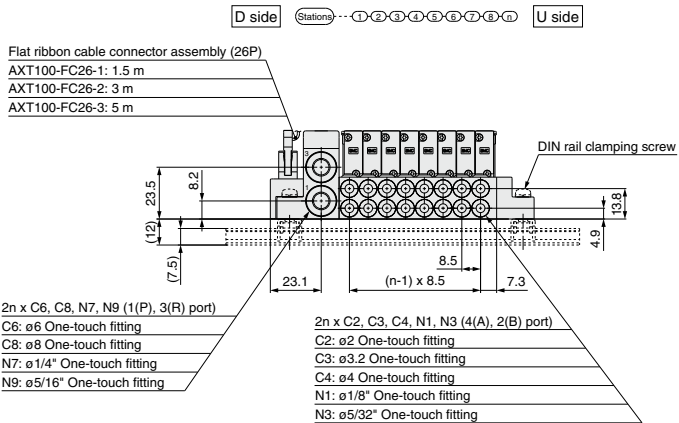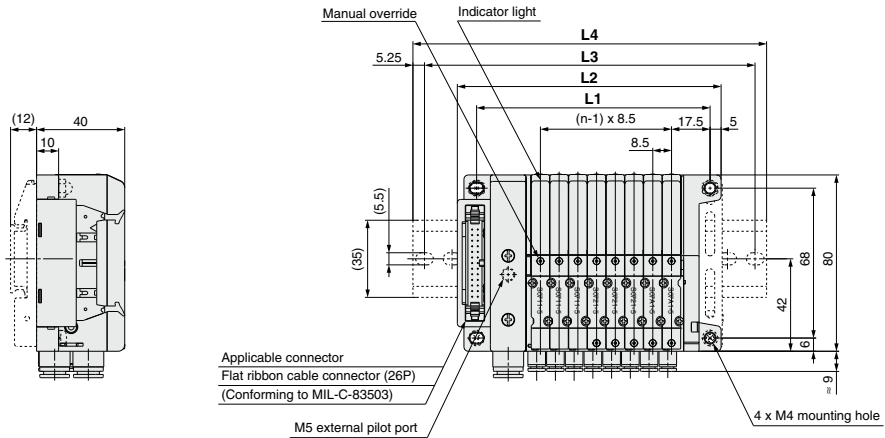

### Dimensions

Formula L1 = 8.5n + 38, L2 = 8.5n + 51.7 n: Station (Maximum 24 stations)

L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
L1		55	63.5	72	80.5	89	97.5	106	114.5	123	131.5	140	148.5	157	165.5	174	182.5	191	199.5	208	216.5	225	233.5	242
L2		68.7	77.2	85.7	94.2	102.7	111.2	119.7	128.2	136.7	145.2	153.7	162.2	170.7	179.2	187.7	196.2	204.7	213.2	221.7	230.2	238.7	247.2	255.7
L3		100	100	112.5	125	137.5	137.5	150	162.5	175	175	187.5	200	200	212.5	225	225	237.5	250	250	262.5	275	275	
L4		110.5	110.5	123	135.5	148	148	160.5	160.5	173	185.5	185.5	198	210.5	210.5	223	235.5	235.5	248	260.5	260.5	273	285.5	285.5

## Series **10-S0700** Slim Compact Plug-in Manifold Bar Base


### Manifold Optional Parts

#### Blanking plate assembly

##### SS0700-10A-3

It is used by attaching on the manifold block for being prepared for removing a valve for maintenance reasons or planning to mount a spare valve, etc.

Weight: 8 g

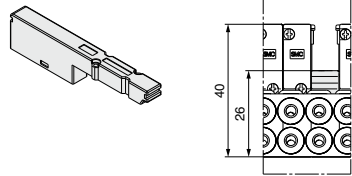

#### Individual SUP spacer


##### SS0700-P-3-C

Mounted on the manifold block to make an independent supply port when each solenoid valve uses different operating pressure.

Weight: 15 g

##### Port size

Symbol	Applicable tubing
<b>C2</b>	Applicable tubing ø2
<b>C3</b>	Applicable tubing ø3
<b>C4</b>	Applicable tubing ø4
<b>N1</b>	Applicable tubing ø1/8"
<b>N3</b>	Applicable tubing ø5/32"

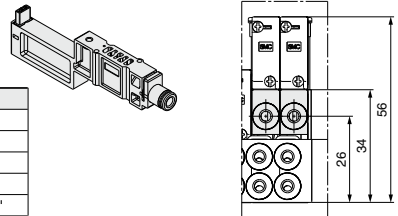

#### Individual EXH spacer


##### SS0700-R-3-C

Mounted on the manifold block to make an independent exhaust port when the exhaust from one valve affects valves on other stations in the air circuit.

Weight: 15 g

##### Port size

Symbol	Applicable tubing
<b>C2</b>	Applicable tubing ø2
<b>C3</b>	Applicable tubing ø3
<b>C4</b>	Applicable tubing ø4
<b>N1</b>	Applicable tubing ø1/8"
<b>N3</b>	Applicable tubing ø5/32"

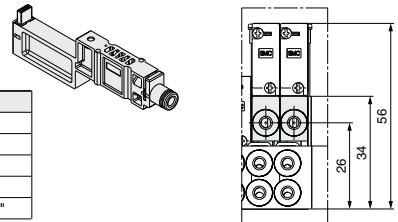

#### Blanking plate with output

##### SS0700-3C-

##### Lead wire length (mm)

<b>Nil</b>	600
<b>10</b>	1000
<b>15</b>	1500
<b>20</b>	2000
<b>25</b>	2500
<b>30</b>	3000

Blanking plate with a connector for individually outputting electricity to drive a single valve or equipment that are not on the manifold base.


Note 1) Electric current should be 0.5 A or less. (Including the mounted valves)  
When the current is output from two positions at the same time, the current should be 0.25 A or less.

Note 2) Please consult with SMC for the max. allowable current for serial transmission kit.

Weight: 23 g



Blanking plate with output

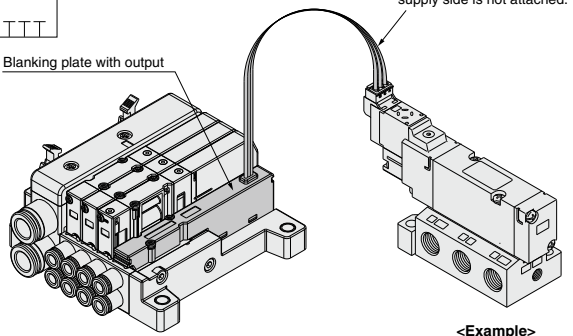

<Example>

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



# Series 10-S0700 Slim Compact Plug-in Manifold Bar Base

## Manifold Optional Parts

### External pilot [-R]

This can be used when the air pressure is 0.1 to 0.2 MPa lower than the minimum operating pressure of the solenoid valves or used for vacuum specifications.

Add R to the part numbers of manifolds and valves to indicate the external pilot specifications.

An M5 port will be installed on the top side of the manifold's SUP/EXH block.

#### ● How to Order Valve (Example)

10-S0710 R -5

↓ External pilot


#### ● How to Order Manifold (Example)

\* Indicate R for an option.

10-SS0750-08C4FD1-R

↓ External pilot

External pilot port  
(M5 x 0.8)

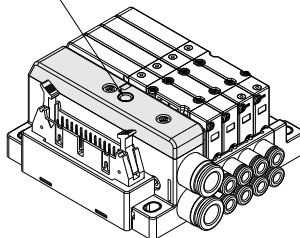

Note 1) Not compatible with dual 3-port valves.

Note 2) When the internal pilot type of valves are mixed up on the manifold, order the manifold suitable for the specifications of the external pilot valve.

Note 3) Since the pilot EXH of valves with the external pilot specification also has a common exhaust specification, the 3(R) port should be released to the atmosphere.


### DIN rail mounting bracket

#### SS0700-57A-3

It is used for mounting a manifold on a DIN rail. The DIN rail mounting bracket is fixed to the manifold end plate. (The specification is the same as that for the option "-D".)

1 set of DIN rail mounting bracket is included for 1 manifold (2 or 3 DIN rail mounting brackets (S, T kit)).



\* When ordering this option incorporated with a manifold, suffix "-D" to the end of the manifold part number.

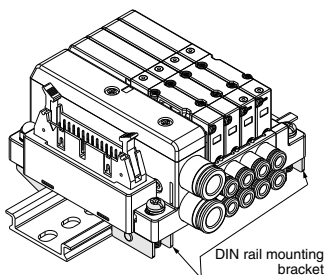



# Series 10-S0700 Slim Compact Plug-in Manifold Bar Base

## Construction





Single: 10-S0711

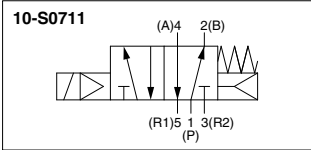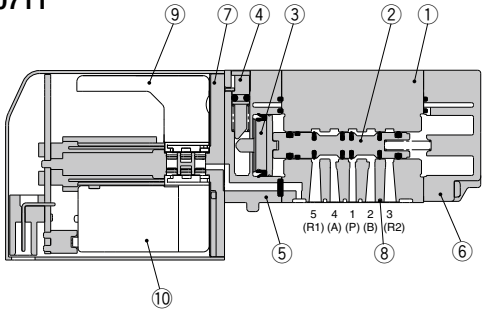

Double: 10-S0721

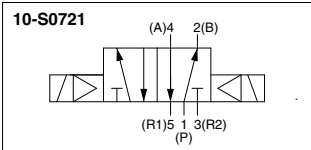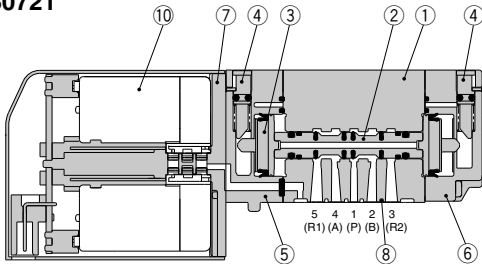

Dual 3-Port: 10-S07B1

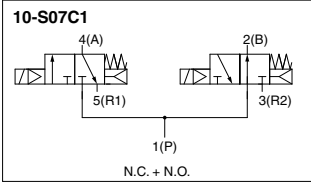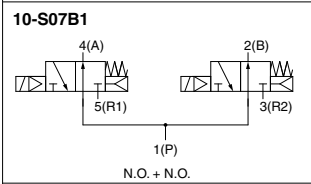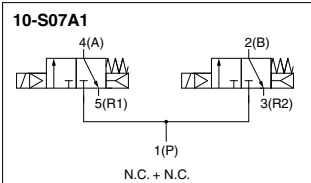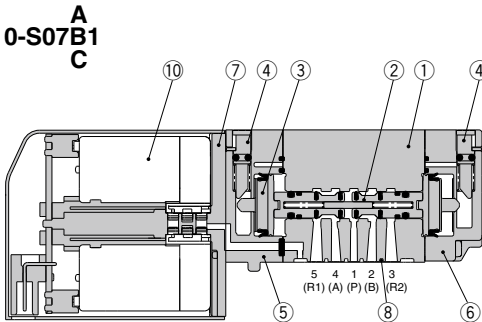


### Component Parts

No.	Description	Material
1	Body	Zinc die-casted
2	Spool	Aluminum
3	Piston	Resin
4	Manual override	Resin
5	Adapter plate	Resin
6	End plate	Resin
7	Pilot spacer	Resin
8	Interface gasket	HNBR
9	Plate	Resin
10	Pilot valve assembly <small>(Note)</small>	—

Note) Please consult with SMC for pilot valve replacement.

# Series 10-S0700 Slim Compact Plug-in Manifold Bar Base

## Manifold Exploded View

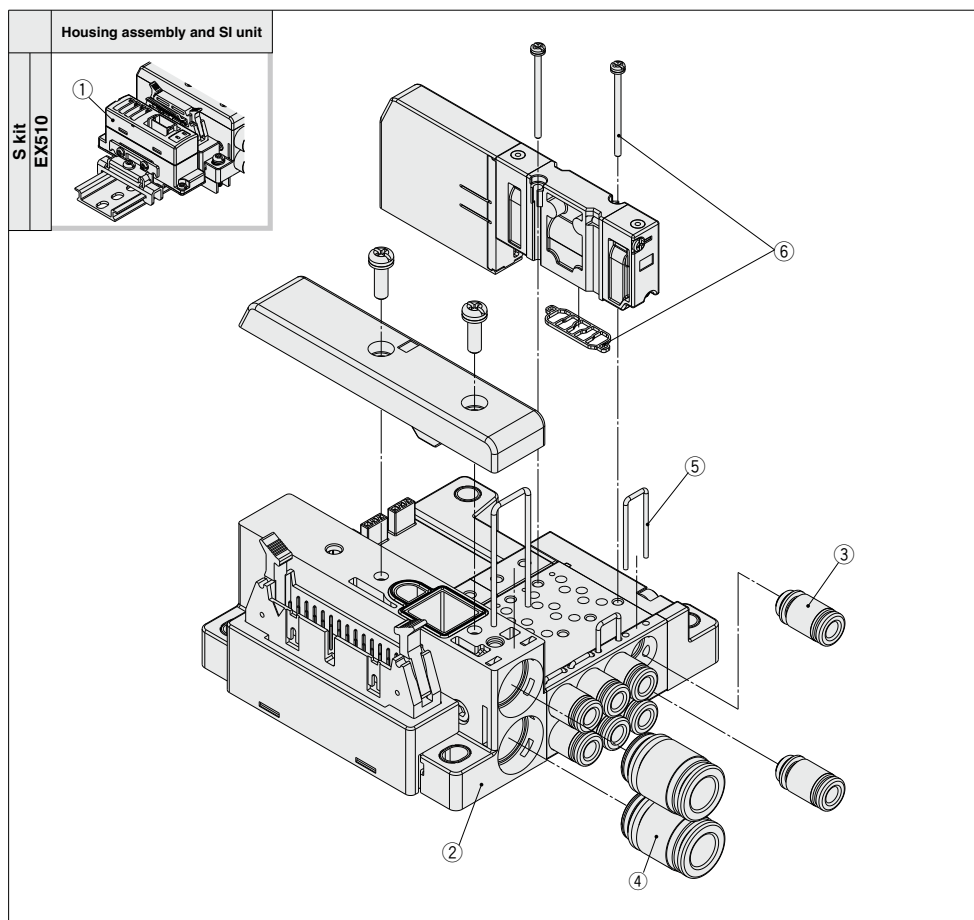

\* It is not possible to increase or decrease the number of stations or change the wiring kit on the slim compact plug-in manifold bar base.  
To change them, please change the entire base unit.

**Manifold Assembly Part No.**

No.	Description	Part no.	Note
①	SI unit	<b>EX510-S002A</b>	NPN (Positive common)
		<b>EX510-S102A</b>	PNP (Negative common)
②	Base unit	<b>SS0751-□□□□</b>	Refer to How to Order for each kit.

**③ Fitting assembly part number for cylinder port****VVQ0000-50A-□****Port size**

Symbol	Applicable tubing
<b>C2</b>	Applicable tubing ø2
<b>C3</b>	Applicable tubing ø3
<b>C4</b>	Applicable tubing ø4
<b>N1</b>	Applicable tubing ø1/8"
<b>N3</b>	Applicable tubing ø5/32"

Note 1) Purchase orders are available in units of 10 pieces.

Note 2) For One-touch fittings replacement, refer to the Specific Product Precautions 2.

**④ Fitting assembly part number for P, R port****VVQ1000-51A-□****Port size**

Symbol	Applicable tubing
<b>C6</b>	Applicable tubing ø6
<b>C8</b>	Applicable tubing ø8
<b>N7</b>	Applicable tubing ø1/4"
<b>N9</b>	Applicable tubing ø5/16"

Note 1) Purchase orders are available in units of 10 pieces.

Note 2) For One-touch fittings replacement, refer to the Specific Product Precautions 2.

No.	Description	Part no.
⑤	Clip	<b>SS0700-80A-5</b>

Note) 1 set includes 10 pieces.

No.	Description	Part no.
⑥	Gasket, Screw	<b>SS0700-GS-3</b>

Note) Above part number consists of 10 units. Each unit has one gasket and two screws.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings &amp; Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors



## Plug-in Manifold Stacking Base

## Serial Transmission

# S kit

### Plug-in Manifold Stacking Base

The EX250/500 series is to be discontinued. When designing new equipment and facilities, consider using another series (EX260/EX600) instead.



Gateway-type  
Serial Transmission System

**EX500**

Page 447



Integrated-type (For I/O)  
Serial Transmission System

**EX250**

Page 449



Integrated-type (For I/O)  
Serial Transmission System (Fieldbus System)

**EX600**

Page 451

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.


Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors

The EX500 series is to be discontinued. When designing new equipment and facilities, consider using another series (EX260/EX600) instead.



# S

## Series 10-S0700 Plug-in Manifold Stacking Base kit (Serial Transmission) EX500 Gateway-type Serial Transmission System

### How to Order Manifold

10-SS0750-08C4C8SDA2N-B

① ② ③ ④ ⑤ ⑥

Clean series

#### 1 Valve stations

Stations	Note
01 1 station	
02 2 stations	
08 8 stations	Double wiring
01 1 station	
16 16 stations	Specified layout*1 (Available up to 16 solenoids)

\*1: Specified layout: Indicate the wiring specifications on the manifold specification sheet. (Note that 2-position double, 3-position and 4-position valves cannot be used where single wiring has been specified.) In addition, select the option K.

#### 2 A, B port size

##### Metric size

C2	ø2 One-touch fitting
C3	ø3.2 One-touch fitting
C4	ø4 One-touch fitting
CM*1	Mixed sizes and port plug

##### Inch size

N1	ø1/8" One-touch fitting
N3	ø5/32" One-touch fitting
NM*1	Mixed sizes and port plug

\*1: Indicate the sizes on the manifold specification sheet.

#### 3 P, R port size

##### Metric size

C6	ø6 One-touch fitting
C8	ø8 One-touch fitting

##### Inch size

N7	ø1/4" One-touch fitting
N9	ø5/16" One-touch fitting

\*: If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

#### 4 SI unit (Number of outputs, Max. number of valve stations)

SD0	Without SI unit
SDA2	16 outputs, 1 to 8 stations (16 stations)*1

\*1: ( ): Maximum number of stations for mixed single and double wiring.  
\*: For SI unit part number, refer to page 444.

#### 5 SI unit (Output polarity)

NII	Positive common
N	Negative common

\*: Ensure a match with the common specification of the valve to be used.  
\*: Select Nil for without SI unit.

#### 6 Option

NII	None
B*1	With back pressure check valve (All stations)
D	With DIN bracket, DIN rail with standard length
D0	With DIN bracket, without DIN rail
D□*2	With DIN bracket, DIN rail for □ stations
K*3	Special wiring specification (Except double wiring)
N	With name plate
R*4	External pilot

\*1: When a back pressure check valve is used only for specified station, specify the back pressure check valve part number, and specify the station number to which the valve is mounted, on the manifold specification sheet.

\*2: □: Specify a longer rail than the length of valve stations.

Example) -D08

In this case, the valves will be mounted on the DIN rail for 8 stations, regardless of the number of manifold stations.

\*3: When single wiring and double wiring are mixed, specify wiring type of each station on the manifold specification sheet.

\*4: For external pilot option -R, indicate the external pilot specification R for the applicable valves as well.

\*: When multiple symbols are specified, indicate them alphabetically. Example) -BKN

\*: For manifold optional parts, refer to pages 481 to 484.

\*: For manifold exploded view, refer to page 487.

### How to Order Valves

10-S0710-10-5

Clean series

Type of actuation

Function

Voltage: 24 VDC

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

\*: For symbol, refer to page 423.

Symbol	Specifications
NII	Standard
R	External pilot*1

\*1: Not compatible with dual 3-port valves.  
The 3(R) port is open to the atmosphere.  
(Cannot be used for applying pressure or vacuum)

Base mounted plug-in

### How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

#### <Example>

Serial transmission kit

10-SS0750-08C4C8SDA2... 1 set - Manifold base part no.

\* 10-S0710-5 ..... 3 sets - Valve part no. (Stations 1 to 3)


\* 10-S0720-5 ..... 2 sets - Valve part no. (Stations 4 to 5)

\* 10-S07A0-5 ..... 2 sets - Valve part no. (Stations 6 to 7)


\* SS0700-10A-1 ..... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.


Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



# 10-SS0750 S kit (Serial transmission: EX500)

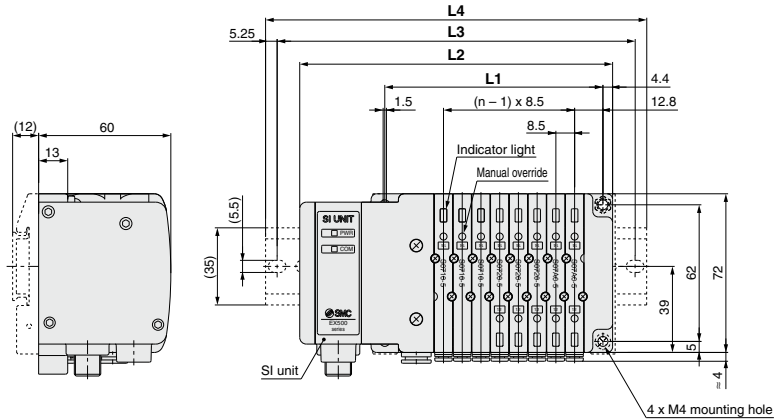

D side Stations 1 2 3 4 5 6 7 8 9 U side

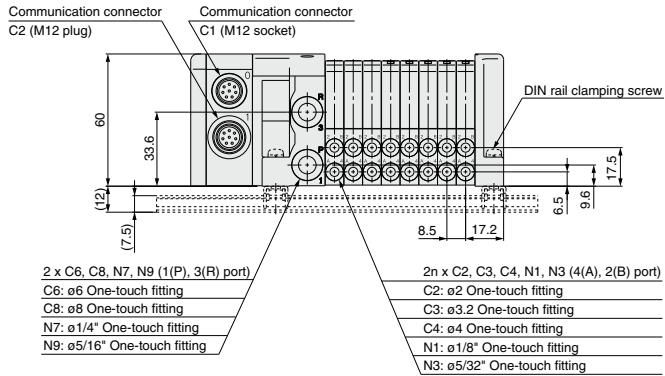

## Dimensions


Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 74$  n: Station (Maximum 16 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167
L2	91	99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210
L3	112.5	125	137.5	150	162.5	175	187.5	198	209	219.5	230	240.5	251	261.5	272
L4	123	135.5	148	160.5	173	185.5	198	210.5	223	235.5	248	260.5	273	285.5	298



# S Series 10-S0700 Plug-in Manifold Stacking Base kit (Serial Transmission) EX500 Gateway-type Serial Transmission System 2

## How to Order Manifold

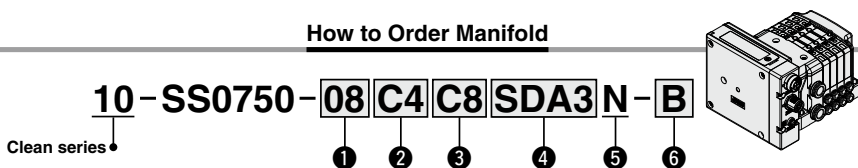

### 1 Valve stations

Stations	Note
01 1 station	Double wiring
16 16 stations	
01 1 station	
24 24 stations	Specified layout*1 (Available up to 32 solenoids)

\*1: Specified layout: Indicate the wiring specifications on the manifold specification sheet. (Note that 2-position double, 3-position and 4-position valves cannot be used where single wiring has been specified.) In addition, select the option K.

### 2 A, B port size

#### Metric size

C2	ø2 One-touch fitting
C3	ø3.2 One-touch fitting
C4	ø4 One-touch fitting
CM*1	Mixed sizes and port plug

#### Inch size

N1	ø1/8" One-touch fitting
N3	ø5/32" One-touch fitting
NM*1	Mixed sizes and port plug

\*1: Indicate the sizes on the manifold specification sheet.

### 3 P, R port size

#### Metric size

C6	ø6 One-touch fitting
C8	ø8 One-touch fitting

#### Inch size

N7	ø1/4" One-touch fitting
N9	ø5/16" One-touch fitting

\*1: If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### 4 SI unit (Number of outputs, Max. number of valve stations)

SD0	Without SI unit
SDA3	32 outputs*1, 2, 1 to 16 stations (24 stations*2)

\*1: When using the SI unit with 32 outputs, use the GW unit compatible with the EX500 Gateway Decentralized System 2 (128 points).

\*2: 16 outputs can be set by switching the built-in setting switch.

\*3: ( ): Maximum number of stations for mixed single and double wiring.

\*4: For SI unit part number, refer to page 444.

### 5 SI unit (Output polarity)

NII	(Without SI unit)
N	Negative common

### 6 Option

NII	None
B*1	With back pressure check valve (All stations)
D	With DIN bracket, DIN rail with standard length
D0	With DIN bracket, without DIN rail
D□*2	With DIN bracket, DIN rail for □ stations
K*3	Special wiring specification (Except double wiring)
N	With name plate
R*4	External pilot

\*1: When a back pressure check valve is used only for specified station, specify the back pressure check valve part number, and specify the station number to which the valve is mounted, on the manifold specification sheet.

\*2: □: Specify a longer rail than the length of valve stations.

Example) -D08

In this case, the valves will be mounted on the DIN rail for 8 stations, regardless of the number of manifold stations.

\*3: When single wiring and double wiring are mixed, specify wiring type of each station on the manifold specification sheet.


\*4: For external pilot option -R, indicate the external pilot specification R for the applicable valves as well.

\*5: When multiple symbols are specified, indicate them alphabetically. Example) -BKN

\*6: For manifold optional parts, refer to pages 481 to 484.

\*7: For manifold exploded view, refer to page 487.

## How to Order Valves



Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

\*: For symbol, refer to page 423.

### Function

Symbol	Specifications
NII	Standard
R	External pilot*1

\*1: Not compatible with dual 3-port valves.

The 3(R) port is open to the atmosphere.

(Cannot be used for applying pressure or vacuum)

### Base mounted plug-in

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

Serial transmission kit


10-SS0750-04C4C8SDA3 ... 1 set - Manifold base part no.


\* 10-S0720-5 ..... 2 sets - 2-position double part no.

\* 10-S07A0-5 ..... 2 sets - 4-position dual 3-port part no.

Prefix the asterisk to the part numbers of the solenoid valve etc.

Write sequentially from the 1st station on the D side. When part numbers written collectively are complicated, specify on the manifold specification sheet.



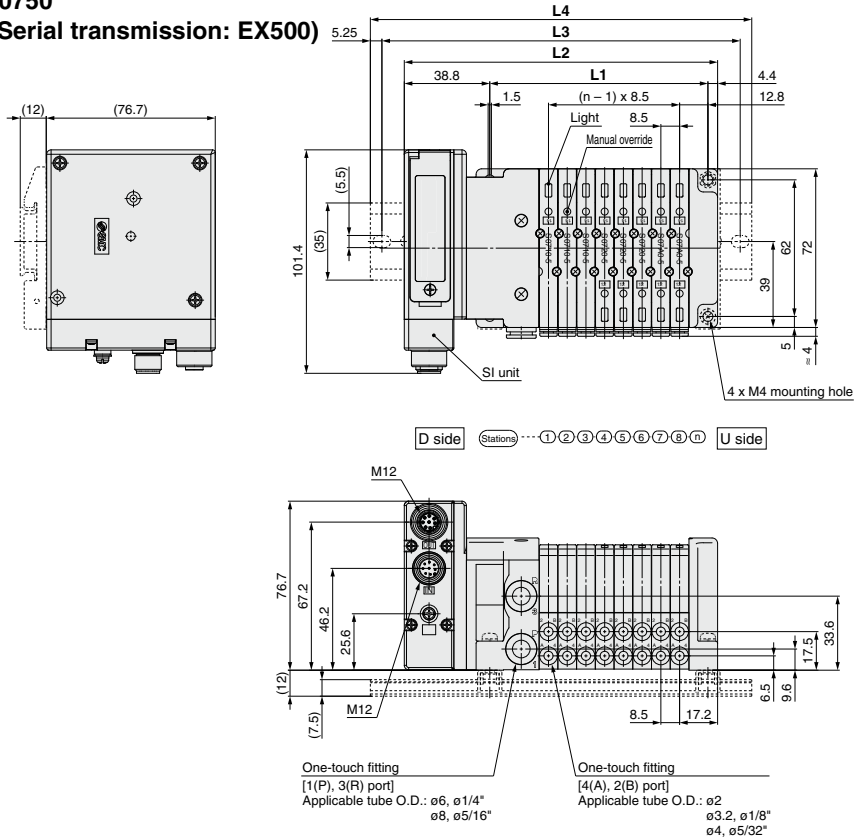**10-SS0750**
**S kit (Serial transmission: EX500)**

**Dimensions**

 Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 74$  n: Station (Maximum 24 stations)

L \ n	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	39.5	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167
L2	82.5	91	99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210
L3	112.5	112.5	125	137.5	137.5	150	162.5	162.5	175	187.5	187.5	200	212.5	212.5	225	237.5
L4	123	123	135.5	148	148	160.5	173	173	185.5	198	198	210.5	223	223	235.5	248


L \ n	17	18	19	20	21	22	23	24
L1	175.5	184	192.5	201	209.5	218	226.5	235
L2	218.5	227	235.5	244	252.5	261	269.5	278
L3	250	250	262.5	275	275	287.5	300	300
L4	260.5	260.5	273	285.5	285.5	298	310.5	310.5

The EX250 series is to be discontinued. When designing new equipment and facilities, consider using another series (EX260/EX600) instead.

# S

## Series 10-S0700 Plug-in Manifold Stacking Base kit (Serial Transmission)

EX250 Integrated-type (For Input/Output) Serial Transmission System



### How to Order Manifold

10-SS0750-08C4C8SDQN-5

Clean series

#### ① Stations

Symbol	Stations
01	1 station
⋮	⋮
24 (Note)	24 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

#### ② Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
CM	Mixed sizes and with port plug (Note)	
N1	With ø1/8" One-touch fitting	Inch
N3	With ø5/32" One-touch fitting	
NM	Mixed sizes and with port plug (Note)	

Note) Specify "Mixed sizes and with port plug" on the manifold specification sheet.

#### ③ P, R port size

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	Inch
N9	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

#### ④ Kit type

Kit type	Note 2) Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
S kit	SD0	Without SI unit	1 to 12 stations	24 stations	24
	SDQ	DeviceNet®			
	SDZEN	EtherNet/IP™			
	SDTA	AS-Interface, 8 in/8 out, 2 isolated common type	1 to 4 stations	8 stations	8
	SDTB	AS-Interface, 4 in/4 out, 2 isolated common type	1 to 2 stations	4 stations	4
	SDTC	AS-Interface, 8 in/8 out, 1 common type	1 to 4 stations	8 stations	8
	SDTD	AS-Interface, 4 in/4 out, 1 common type	1 to 2 stations	4 stations	4

Note 1) The maximum number of stations is determined by the total number of solenoids.  
For mixed single and double wirings, enter "K" to the order code options.

Note 2) For SI unit part number, refer to page 444.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

#### ⑤ SI unit COM.

SI unit COM.		EX250		
		DeviceNet®	AS-Interface	EtherNet/IP™
Nil	+COM.	—	—	—
N	-COM.	○	○	○

Note) The symbol is nil for no SI unit (SD0).

#### ⑥ Input block (for I/O unit only)

Symbol	Specifications
Nil	SI unit/Input block: None (SD0)
0	Input block: None
1	Input block: 1 pc.
⋮	⋮
8	Input block: 8 pcs.

Note) The symbol is nil for no SI unit (SD0).

#### ⑦ Input block type (for I/O unit only)

Symbol	Specifications
Nil	Input block: None
1	M12 2 inputs
2	M12 4 inputs
3	M8 4 inputs (3 pins)

Note) The symbol is nil for no SI unit (SD0).

#### ⑧ Input block COM. (for I/O unit only)

Symbol	Specifications
Nil	PNP sensor input (+COM.) or without input block
N	NPN sensor input (-COM.)

Note) The symbol is nil for no SI unit (SD0).

#### ⑨ Option

Symbol	Specifications
Nil	None
B (Note 2)	With back pressure check valve (All stations)
D	With DIN rail (Rail length: Standard)
D0	Without DIN rail (With bracket)
D□ (Note 3)	With DIN rail Designated length (□: Station)
K (Note 4)	Special wiring specifications (Except double wiring)
N	With name plate
R (Note 5)	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -BKN

Note 2) When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.

Note 3) The available number of stations is larger than the number of manifold stations.

Note 4) Indicate the wiring specifications for mixed single and double wirings.

Note 5) For details, refer to page 481.

\* For manifold optional parts, refer to pages 481 to 484.

\* For manifold exploded view, refer to page 487.

Refer to the **WEB catalog** for details on the EX250 Integrated-type (For Input/Output) Serial Transmission System.

### How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

#### <Example>

Serial transmission kit

10-SS0750-08C4C8SDQ13N... 1 set - Manifold base part no.


\* 10-S0710-5 ..... 3 sets - Valve part no. (Stations 1 to 3)

\* 10-S0720-5 ..... 2 sets - Valve part no. (Stations 4 to 5)

\* 10-S07A0-5 ..... 2 sets - Valve part no. (Stations 6 to 7)

\* S0700-10A-1 ..... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.  
Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



### How to Order Valve

10-S0710-5

Clean series

Actuation type

Function

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

Symbol	Specifications
Nil	Standard
R	External pilot (Note)


Note) Not compatible with dual 3-port valves.

The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in



# 10-SS0750 S kit (Serial transmission: EX250)

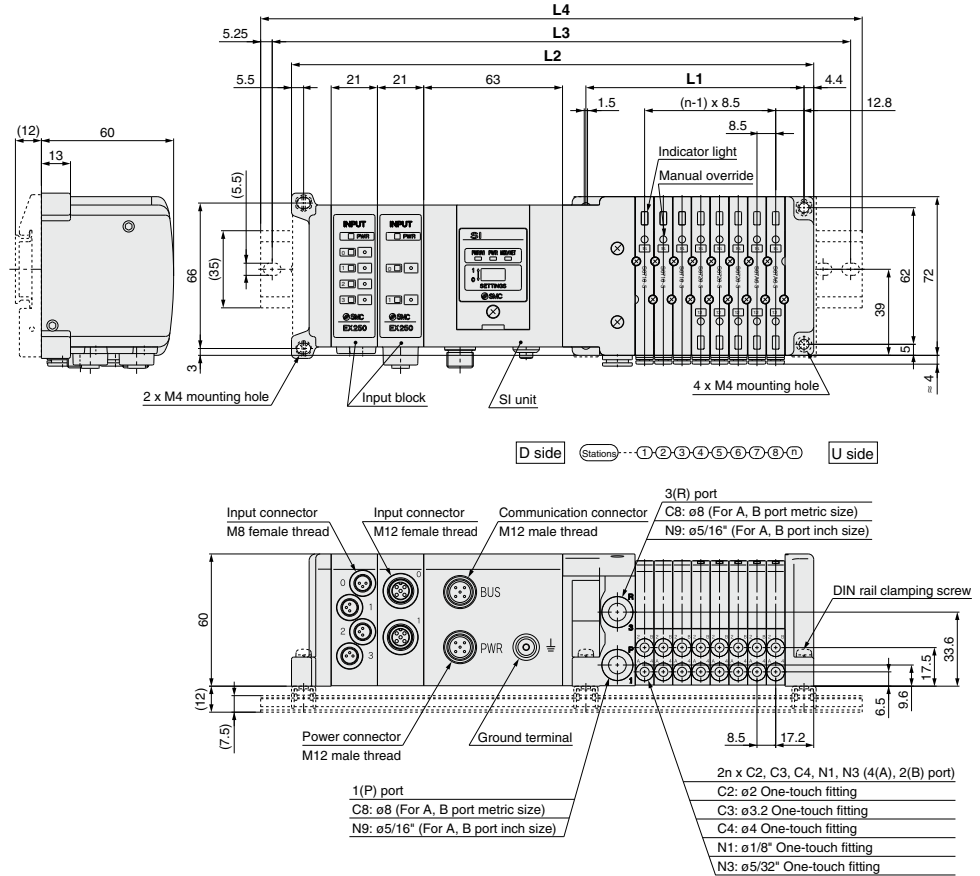

## Dimensions


Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 169$  (For 2 input blocks, 21 mm is added per 1 pc.) n: Station (Maximum 24 stations)

L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167	
L2	186	194.5	203	211.5	220	228.5	237	245.5	254	262.5	271	279.5	288	296.5	305	
L3	212.5	225	225	237.5	250	250	262.5	275	275	287.5	300	300	312.5	325	325	
L4	223	235.5	235.5	248	260.5	260.5	273	285.5	285.5	298	310.5	310.5	323	335.5	335.5	

L	n	17	18	19	20	21	22	23	24
L1	175.5	184	192.5	201	209.5	218	226.5	235	
L2	313.5	322	330.5	339	347.5	356	364.5	373	
L3	337.5	350	350	362.5	375	387.5	387.5	400	
L4	348	360.5	360.5	373	385.5	398	398	410.5	

## How to Order Manifold

10-SS0750-08 C4 SD6Q 2 N 1-B



### Clean series

Symbol	Stations
01	1 station
⋮	⋮
24	24 stations

(Note) Max. number of stations depends on the wiring specifications.

### Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
CM	Mixed sizes and with port plug (Note)	
N1	With ø1/8" One-touch fitting	Inch
N3	With ø5/32" One-touch fitting	
NM	Mixed sizes and with port plug (Note)	

(Note) Indicate the sizes on the manifold specification sheet for CM and NM.

### P, R port size (Note 1)

Symbol	Port size	
Nil	With ø8 One-touch fitting (Note 2)	Metric
C6	ø6 One-touch fitting	Inch
N7	ø1/4" One-touch fitting	

Note 1) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

Note 2) The P, R port size is ø5/16" when the cylinder ports are inch sizes.

### Kit type

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
S kit	SD60	Without SI unit	1 to 16 stations	24 stations (Note 3)	32
	SD6Q	DeviceNet®			
	SD6V	CC-Link			
	SD6N	PROFIBUS DP			
	SD6WS	Wireless remote (Note 4)			

Note 1) Max. station number depends on the number of solenoid valve.

Add the option symbol "K" when the combination of single wiring and double wiring is specified.

• When "Without SI unit" is specified, valve plate to connect the manifold and SI unit is not mounted. Refer to page 512 for mounting method.

• I/O unit cannot be chosen without SI unit.

Note 2) For SI unit part number, refer to page 444.

Note 3) Up to 24 stations due to the structure of the manifold. Please note the maximum number of stations is 24 for single wiring, too.

Note 4) The wireless system is suitable for use only in a country where it is in accordance with the Radio Act and regulations of that country.

Actuation type	Single	Double, Dual 3-port
Number of solenoid valves	1	2

### Option

Symbol	Specifications
Nil	None
B (Note 2)	With back pressure check valve (All sta.)
D	With DIN rail (Rail length: Standard)
D0	With DIN rail bracket (Without rail)
D□ (Note 3)	With DIN rail length specified (□: Sta.)
K (Note 4)	Special wiring specifications (Except double wiring)
N	With name plate
R	External pilot

Note 1) When two or more symbols are specified, indicate them alphabetically. Example) -BKN

Note 2) When back pressure check valve is used only for specified station, specify back pressure check valve part number, and specify station number to which the valve is mounted on the manifold specification sheet.

Note 3) Specified station number shall be longer than manifold station number.

Note 4) When single wiring and double wiring are mixed, specify wiring type of each station on the manifold specification sheet.

Note 5) When "Without SI unit (SD60)" is specified, "With DIN rail (D)" cannot be selected.

### I/O unit station number

Nil	None
1	1 station
⋮	⋮
9	9 stations

Note 1) The symbol is nil for no SI unit.

Note 2) SI unit is not included in I/O unit station number.

Note 3) When I/O unit is selected, it is shipped separately, and assembled by customer. Refer to the attached operation manual for mounting method.

### SI unit COM.

Nil	+COM.
N	-COM.

(Note) The symbol is nil for no SI unit.

### End plate type

Nil	No end plate
2	M12 power supply connector, B-coded
3	7/8 inch power supply connector
4	M12 power supply connector IN/OUT, A-coded, Pin arrangement 1
5	M12 power supply connector IN/OUT, A-coded, Pin arrangement 2


(Note) The symbol is nil for no SI unit.

• The pin layout for "4" and "5" pin connector is different.

Refer to the Fieldbus System (For Input/Output) catalog CAT.E02-24 for details on the EX600 Integrated-type (For I/O) Serial Transmission System.

How to Order Manifold Assembly (Example)

Example

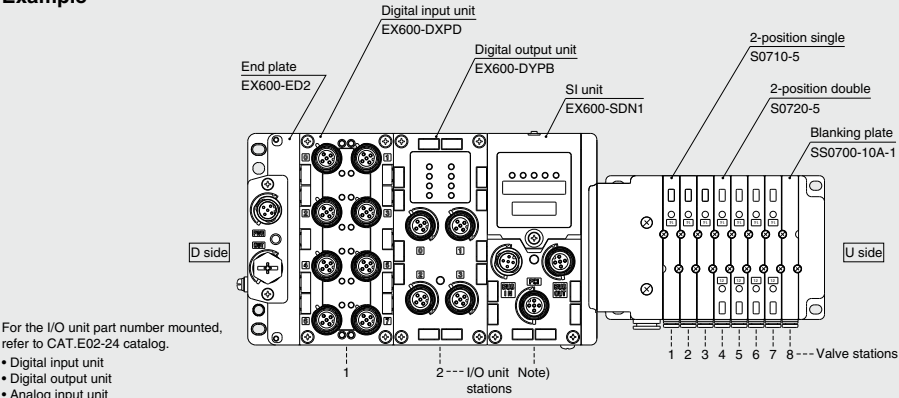

For the I/O unit part number mounted, refer to CAT.E02-24 catalog.

- Digital input unit
- Digital output unit
- Analog input unit

Serial transmission kit

- |                       |        |                                     |
|-----------------------|--------|-------------------------------------|
| 10-SS0750-08C4SD6Q2N2 | 1 set  | Manifold base part number           |
| * 10-S0710-5          | 3 sets | Valve part number (Stations 1 to 3) |
| * 10-S0720-5          | 4 sets | Valve part number (Stations 4 to 7) |
| * SS0700-10A-1        | 1 set  | Blanking plate number (Station 8)   |
| * EX600-DXPD          | 1 set  | I/O unit part number (Station 1)    |
| * EX600-DYPB          | 1 set  | I/O unit part number (Station 2)    |

The asterisk denotes the symbol for assembly. Prefix it to the part no. of the solenoid valve, etc.

Enter in order starting from the first station on the D side. If arrangement becomes complicated, specify on the manifold specification sheet.

Enter in order starting from the first station on the D side.

Note) Do not enter the SI unit part number and the end plate part number together.

How to Order Valve

10-S0710-5

Clean series

Actuation type

Coil voltage

5 24 VDC

Function

Symbol	Specifications
NII	Standard
R	External pilot <sup>Note)</sup>

Note) Not compatible with dual 3-port valves. The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in

1	2-position single 	A 4-position dual 3-port valve (N.C. + N.C.) [Exhaust center] 
2	2-position double 	B 4-position dual 3-port valve (N.O. + N.O.) [Pressure center] 
		C 4-position dual 3-port valve (N.C. + N.O.) 

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment



Pressure Switches/Pressure Sensors

# S

## Series 10-S0700 Plug-in Manifold Stacking Base

kit (Serial Transmission) EX600 Integrated-type (For Input/Output) Serial Transmission System (Fieldbus System)

### Power Supply with M12 Connector

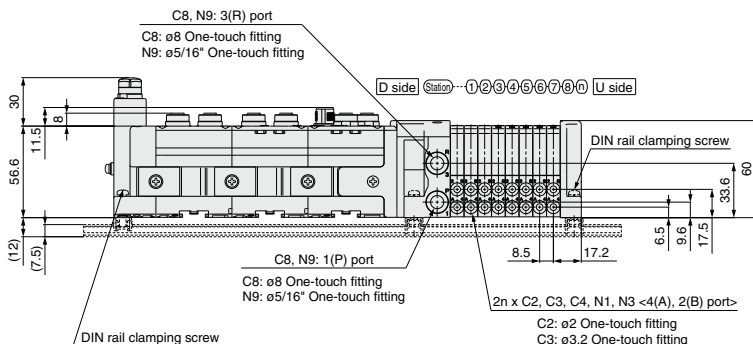
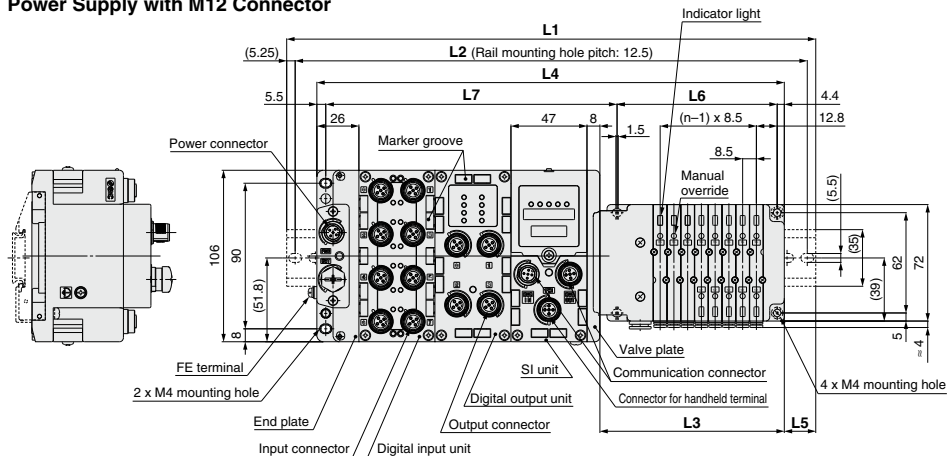


$$\begin{aligned} L2 &= L1 - 10.5 \\ L3 &= 8.5 \times n1 + 46 \\ L4 &= L3 + 81 + 47 \times n2 \\ L5 &= (L1 - L4) / 2 \\ L6 &= 8.5 \times n1 + 31 \\ L7 &= 47 \times n2 + 86.1 \end{aligned}$$

### L1: DIN Rail Overall Length

I/O unit stations (n2) \ Valve stations (n1)	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0	173	185.5	185.5	198	210.5	210.5	223	235.5	235.5	248	260.5	260.5	273	285.5	285.5	298	310.5	310.5	323	335.5	335.5	348	360.5	373
1	223	223	235.5	248	248	260.5	273	273	285.5	298	298	310.5	323	323	335.5	348	360.5	360.5	373	385.5	385.5	398	410.5	410.5
2	260.5	273	285.5	285.5	298	310.5	310.5	323	335.5	348	348	360.5	373	373	385.5	398	398	410.5	423	423	435.5	448	448	460.5
3	310.5	323	335.5	335.5	348	360.5	360.5	373	385.5	385.5	398	410.5	410.5	423	435.5	435.5	448	460.5	460.5	473	485.5	485.5	498	510.5
4	360.5	373	373	385.5	398	398	410.5	423	423	435.5	448	448	460.5	473	473	485.5	498	498	510.5	523	535.5	535.5	548	560.5
5	410.5	410.5	423	435.5	435.5	448	460.5	460.5	473	485.5	485.5	498	510.5	523	523	535.5	548	548	560.5	573	573	585.5	598	598
6	448	460.5	473	473	485.5	498	510.5	510.5	523	535.5	535.5	548	560.5	560.5	573	585.5	585.5	598	610.5	610.5	623	635.5	635.5	648
7	498	510.5	523	523	535.5	548	548	560.5	573	573	585.5	598	598	610.5	623	623	635.5	648	648	660.5	673	673	685.5	698
8	548	560.5	560.5	573	585.5	585.5	598	610.5	610.5	623	635.5	635.5	648	660.5	660.5	673	685.5	698	698	710.5	723	723	735.5	748
9	598	598	610.5	623	623	635.5	648	648	660.5	673	685.5	685.5	698	710.5	710.5	723	735.5	735.5	748	760.5	760.5	773	785.5	785.5

## Power Supply with 7/8 Inch Connector

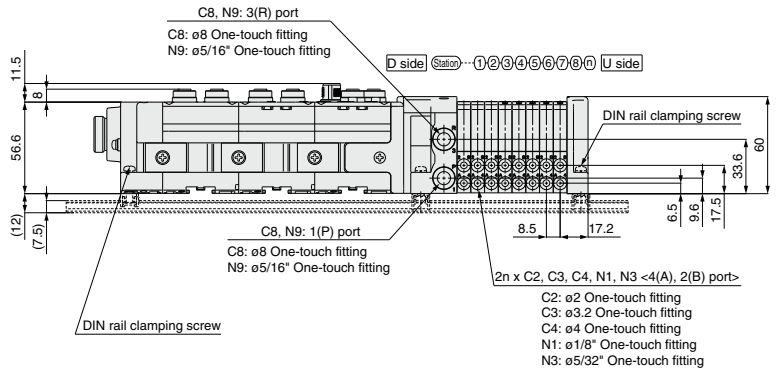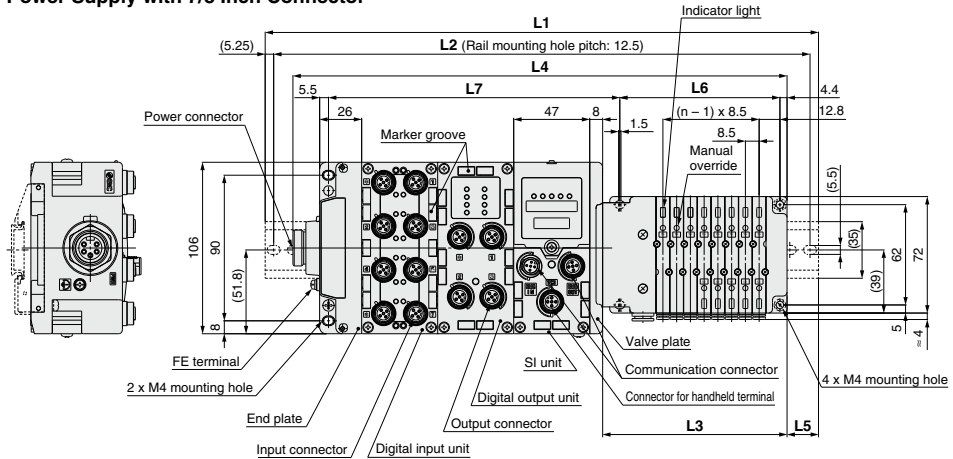

L2 = L1 - 10.5
L3 = 8.5 x n1 + 46
L4 = L3 + 97.5 + 47 x n2
L5 = (L1 - L4)/2
L6 = 8.5 x n1 + 31
L7 = 47 x n2 + 86.1

### L1: DIN Rail Overall Length

I/O unit stations (n2)	Valve stations (n1)	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
0		185.5	198	210.5	210.5	223	235.5	235.5	248	260.5	260.5	273	285.5	285.5	298	310.5	310.5	323	335.5	335.5	348	360.5	360.5	373	385.5
1		235.5	248	248	260.5	273	273	285.5	298	298	310.5	323	323	335.5	348	348	360.5	373	385.5	385.5	398	410.5	410.5	423	435.5
2		285.5	285.5	298	310.5	310.5	323	335.5	335.5	348	360.5	373	373	385.5	398	398	410.5	423	423	435.5	448	448	460.5	473	473
3		323	335.5	348	360.5	360.5	373	385.5	385.5	398	410.5	410.5	423	435.5	435.5	448	460.5	460.5	473	485.5	485.5	498	510.5	510.5	523
4		373	385.5	398	398	410.5	423	423	435.5	448	460.5	473	473	485.5	498	498	510.5	523	523	535.5	548	560.5	560.5	573	573
5		423	435.5	435.5	448	460.5	460.5	473	485.5	485.5	498	510.5	510.5	523	535.5	548	548	560.5	573	573	585.5	598	598	610.5	623
6		473	473	485.5	498	498	510.5	523	535.5	535.5	548	560.5	560.5	573	585.5	585.5	598	610.5	610.5	623	635.5	635.5	648	660.5	660.5
7		523	523	535.5	548	548	560.5	573	573	585.5	598	598	610.5	623	623	635.5	648	648	660.5	673	673	685.5	698	698	710.5
8		560.5	573	585.5	585.5	598	610.5	610.5	623	635.5	635.5	648	660.5	660.5	673	685.5	685.5	698	710.5	723	723	735.5	748	748	760.5
9		610.5	623	623	635.5	648	648	660.5	673	673	685.5	698	710.5	710.5	723	735.5	735.5	748	760.5	760.5	773	785.5	785.5	798	810.5





## Plug-in Manifold Stacking Base

# D-sub Connector

# F kit

Plug-in Manifold  
Stacking Base



### MIL Standard

- 25 pins
- Cable length:  
1.5 m, 3 m, 5 m

Connector mounting  
direction: Top or side  
selectable

Page 457



Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.


Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors


# F Series 10-S0700 Plug-in Manifold Stacking Base kit (D-sub Connector)

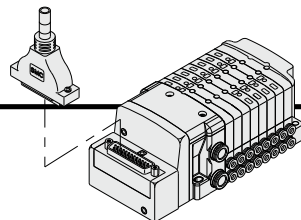

- The D-sub connector reduces installation labor for electrical connections.
- Using the D-sub connector (25P) conforming to MIL standard permits the use of commercial connectors and gives a wide interchangeability.
- Top or side receptacle position can be selected in accordance with the available mounting space.

## Electrical Wiring Specifications

### D-sub connector




As the standard electrical wiring specifications, double wiring (connected to SOL A and SOL B) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types. Mixed single and double wiring is available as an option. For details, refer to "Special Wiring Specifications" (Option) below.

### D-sub connector assembly wire color (AXT100-DS25-030 050)

	Terminal no.	Polarity	Lead wire color	Dot marking	
Station 1	<u>SOL A</u> 1	(-)	(+)	Black	None
	<u>SOL B</u> 14	(-)	(+)	Yellow	Black
Station 2	<u>SOL A</u> 2	(-)	(+)	Brown	None
	<u>SOL B</u> 15	(-)	(+)	Pink	Black
Station 3	<u>SOL A</u> 3	(-)	(+)	Red	None
	<u>SOL B</u> 16	(-)	(+)	Blue	White
Station 4	<u>SOL A</u> 4	(-)	(+)	Orange	None
	<u>SOL B</u> 17	(-)	(+)	Purple	None
Station 5	<u>SOL A</u> 5	(-)	(+)	Yellow	None
	<u>SOL B</u> 18	(-)	(+)	Gray	None
Station 6	<u>SOL A</u> 6	(-)	(+)	Pink	None
	<u>SOL B</u> 19	(-)	(+)	Orange	Black
Station 7	<u>SOL A</u> 7	(-)	(+)	Blue	None
	<u>SOL B</u> 20	(-)	(+)	Red	White
Station 8	<u>SOL A</u> 8	(-)	(+)	Purple	White
	<u>SOL B</u> 21	(-)	(+)	Brown	White
Station 9	<u>SOL A</u> 9	(-)	(+)	Gray	Black
	<u>SOL B</u> 22	(-)	(+)	Pink	Red
Station 10	<u>SOL A</u> 10	(-)	(+)	White	Black
	<u>SOL B</u> 23	(-)	(+)	Gray	Red
Station 11	<u>SOL A</u> 11	(-)	(+)	White	Red
	<u>SOL B</u> 24	(-)	(+)	Black	White
Station 12	<u>SOL A</u> 12	(-)	(+)	Yellow	Red
	<u>SOL B</u> 25	(-)	(+)	White	None
	COM. 13	(+)	(-)	Orange	Red
		Positive COM	Negative COM (Note)		

Note) Mounting valve has no polarity. It can also be used as a negative common.

## Special Wiring Specifications (Option) [-K]



Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 24.

### 1. How to Order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations of the single and double wiring on the manifold specification sheet.


### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.

## Cable Assembly

### AXT100-DS25-030 050

(The D-sub connector cable assemblies can be ordered with manifolds. Refer to "How to Order Manifold.")

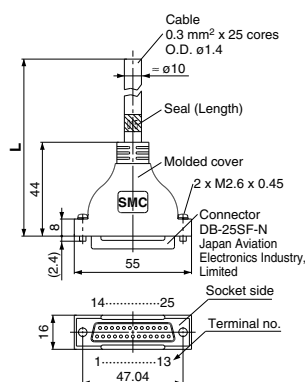

### D-sub connector cable assembly Wire Color by Terminal No.

Terminal no.	Lead wire color	Dot marking
1	Black	None
2	Brown	None
3	Red	None
4	Orange	None
5	Yellow	None
6	Pink	None
7	Blue	None
8	Purple	White
9	Gray	Black
10	White	Black
11	White	Red
12	Yellow	Red
13	Orange	Red
14	Yellow	Black
15	Pink	Black
16	Blue	White
17	Purple	None
18	Gray	None
19	Orange	Black
20	Red	White
21	Brown	White
22	Pink	Red
23	Gray	Red
24	Black	White
25	White	None

### D-sub Connector Cable Assembly (Option)

Cable length (L)	Assembly part no.	Note
1.5 m	AXT100-DS25-015	
3 m	AXT100-DS25-030	Cable 0.3 mm² x 25 cores
5 m	AXT100-DS25-050	

\* For other commercial connectors, use a 25-pin type with female connector conforming to MIL-C-24308.

\* Cannot be used for movable wiring.

### Electrical Characteristics

Item	Property
Conductor resistance Ω/km, 20°C	65 or less
Voltage limit V, 1 minute, AC	1000
Insulation resistance MΩ/km, 20°C	5 or more

Note) The minimum bending radius of D-sub connector cable is 20 mm.

### Example of connector manufacturers

- Fujitsu Limited
- Japan Aviation Electronics Industry, Limited
- J.S.T. Mfg. Co., Ltd.
- HIROSE ELECTRIC CO., LTD.

## How to Order Manifold



**10-SS0750-08 C4 C8 FD1-B**

Clean series

### Stations

Symbol	Stations
<b>02</b>	2 stations
⋮	⋮
<b>24</b> (Note)	24 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

### Cylinder port size

Symbol	Port size	
<b>C2</b>	With ø2 One-touch fitting	Metric
<b>C3</b>	With ø3.2 One-touch fitting	
<b>C4</b>	With ø4 One-touch fitting	
<b>CM</b>	Mixed sizes and with port plug (Note)	
<b>N1</b>	With ø1/8" One-touch fitting	Inch
<b>N3</b>	With ø5/32" One-touch fitting	
<b>NM</b>	Mixed sizes and with port plug (Note)	

Note) Indicate the sizes on the manifold specification sheet for CM and NM.

### P, R port size

Symbol	Port size	
<b>C6</b>	With ø6 One-touch fitting	Metric
<b>C8</b>	With ø8 One-touch fitting	
<b>N7</b>	With ø1/4" One-touch fitting	Inch
<b>N9</b>	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### Option

Symbol	Specifications
<b>Nil</b>	None
<b>B</b> (Note 2)	With back pressure check valve (All stations)
<b>D</b>	With DIN rail (Rail length: Standard)
<b>D0</b>	Without DIN rail (With bracket)
<b>D</b> (Note 3)	With DIN rail Designated length (□: Station)
<b>K</b> (Note 4)	Special wiring specifications (Except double wiring)
<b>N</b>	With name plate
<b>R</b> (Note 5)	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -BKN

Note 2) When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.

Note 3) The available number of stations is larger than the number of manifold stations.

Note 4) Indicate the wiring specifications for mixed single and double wirings.

Note 5) For details, refer to page 481.

\* For manifold optional parts, refer to pages 481 to 484.

\* For manifold exploded view, refer to page 487.

### Kit type/Cable length

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
F kit	<b>FD0</b>	D-sub connector (25P), without cable	1 to 12 stations	24 stations	24
	<b>FD1</b>	D-sub connector (25P), with 1.5 m cable			
	<b>FD2</b>	D-sub connector (25P), with 3.0 m cable			
	<b>FD3</b>	D-sub connector (25P), with 5.0 m cable			

Note) The maximum number of stations is determined by the total number of solenoids. For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

## How to Order Valve

**10-S0710-5**

Clean series

### Actuation type

Symbol	Specifications
<b>1</b>	2-position single
<b>2</b>	2-position double
<b>A</b>	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
<b>B</b>	4-position dual 3-port (N.O. + N.O.) [Pressure center]
<b>C</b>	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

### Voltage

Symbol	Specifications
<b>5</b>	24 VDC
<b>6</b>	12 VDC

### Function

Symbol	Specifications
<b>Nil</b>	Standard
<b>R</b>	External pilot (Note)

Note) Not compatible with dual 3-port valves. The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

D-sub connector kit

10-SS0750-08C4C8FD1...1 set - Manifold base part no.


= 10-S0710-5 .....3 sets - Valve part no. (Stations 1 to 3)

= 10-S0720-5 .....2 sets - Valve part no. (Stations 4 to 5)

= 10-S07A0-5 .....2 sets - Valve part no. (Stations 6 to 7)

= SS0700-10A-1 .....1 set - Blanking plate part no. (Station 8)

Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment



Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

**F**

# Series 10-S0700 kit (D-sub Connector)

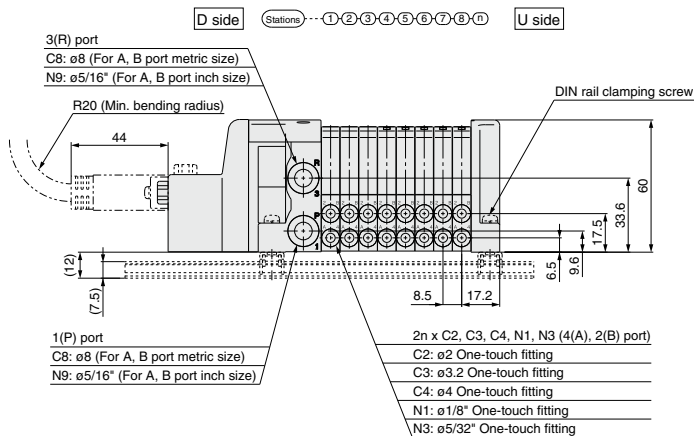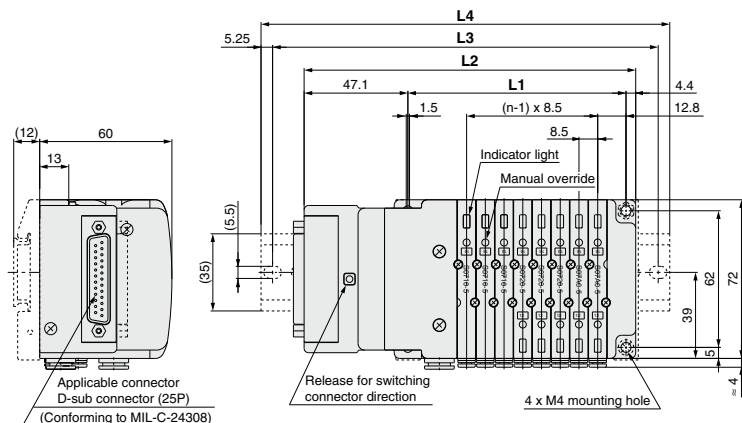

## Dimensions

Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 82.5$  n: Station (Maximum 24 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
L1	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167	175.5	184	192.5	201	209.5	218	226.5	235
L2	99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210	218.5	227	235.5	244	252.5	261	269.5	278	286.5
L3	125	137.5	137.5	150	162.5	162.5	175	187.5	187.5	200	212.5	212.5	225	237.5	250	250	262.5	275	275	287.5	300	300	312.5
L4	135.5	148	148	160.5	173	173	185.5	198	198	210.5	223	223	235.5	248	260.5	260.5	273	285.5	285.5	298	310.5	310.5	323

## Plug-in Manifold Stacking Base

## Flat Ribbon Cable

# P kit

Plug-in Manifold  
Stacking Base



### MIL Standard

■ 26 pins, 20 pins

■ Cable length

1.5 m, 3 m, 5 m


Connector mounting  
direction: Top or side  
selectable



Page 461

# P


# Series 10-S0700 Plug-in Manifold Stacking Base kit (Flat Ribbon Cable)



- Flat ribbon cable connector reduces installation labor for electrical connection.
- Using the connector for flat ribbon cable (26P, 20P) conforming to MIL standard permits the use of commercial connectors and gives a wide interchangeability.
- Top or side receptacle position can be selected in accordance with the available mounting space.

## Electrical Wiring Specifications


### Flat ribbon cable connector



Double wiring (connected to SOLA and SOLB) is adopted for the internal wiring of each station, regardless of valve and option types.  
Mixed single and double wiring is available as an option. For details, refer to "Special Wiring Specifications" (Option) below.

<26P>

<20P>

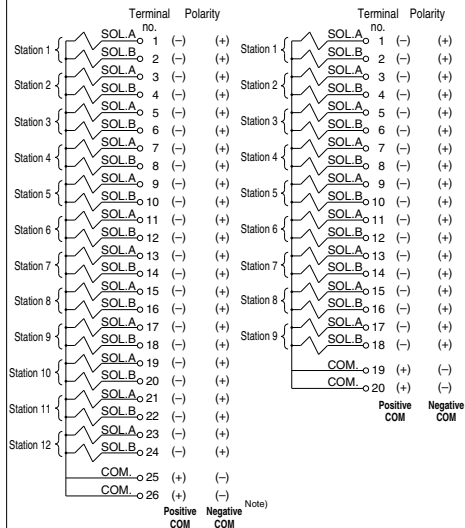


Note) Mounting valve has no polarity. It can also be used as a negative common.

## Cable Assembly

AXT100-FC<sup>20</sup><sub>26-3</sub>

(Type 26P flat ribbon cable connector assemblies can be ordered with manifolds. Refer to "How to Order Manifold.")

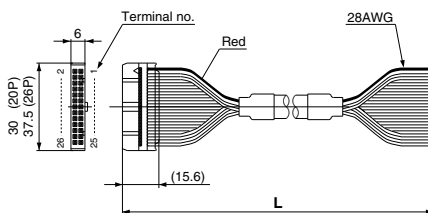

### Flat Ribbon Cable Connector Assembly (Option)


Cable length (L)	Assembly part no.	
	26P	20P
1.5 m	AXT100-FC26-1	AXT100-FC20-1
3 m	AXT100-FC26-2	AXT100-FC20-2
5 m	AXT100-FC26-3	AXT100-FC20-3

- \* For other commercial connectors, use a 20- or 26-pin type with strain relief conforming to MIL-C-83503.
- \* Cannot be used for movable wiring.

### Example of connector manufacturers

- HIROSE ELECTRIC CO., LTD. • Japan Aviation Electronics Industry, Limited
- 3M Japan Limited • J.S.T. Mfg. Co., Ltd.
- Fujitsu Limited • Oki Electric Cable Co., Ltd.

## Special Wiring Specifications (Option) [-K]



Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 24 for 26P, 18 for 20P.

### 1. How to Order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations of the single and double wiring on the manifold specification sheet.

### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.

## How to Order Manifold



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings &amp; Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

**10-SS0750-08C4C8PD1-B**

Clean series

Symbol	Stations
<b>02</b>	2 stations
...	...
<b>24</b>	24 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

Cylinder port size

Symbol	Port size	
<b>C2</b>	With ø2 One-touch fitting	Metric
<b>C3</b>	With ø3.2 One-touch fitting	
<b>C4</b>	With ø4 One-touch fitting	
<b>CM</b>	Mixed sizes and with port plug <sup>Note)</sup>	Inch
<b>N1</b>	With ø1/8" One-touch fitting	
<b>N3</b>	With ø5/32" One-touch fitting	
<b>NM</b>	Mixed sizes and with port plug <sup>Note)</sup>	

Note) Indicate the sizes on the manifold specification sheet for CM and NM.

P, R port size

Symbol	Port size	
<b>C6</b>	With ø6 One-touch fitting	Metric
<b>C8</b>	With ø8 One-touch fitting	
<b>N7</b>	With ø1/4" One-touch fitting	Inch
<b>N9</b>	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, inch size piping connections for the P and R ports as well.

Option

Symbol	Specifications
<b>Nil</b>	None
<b>B</b> <sup>Note 2)</sup>	With back pressure check valve (All stations)
<b>D</b>	With DIN rail (Rail length: Standard)
<b>D0</b>	Without DIN rail (With bracket)
<b>D□</b> <sup>Note 3)</sup>	With DIN rail Designated length (□: Station)
<b>K</b> <sup>Note 4)</sup>	Special wiring specifications (Except double wiring)
<b>N</b>	With name plate
<b>R</b> <sup>Note 5)</sup>	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -BKN

Note 2) When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.

Note 3) The available number of stations is larger than the number of manifold stations.

Note 4) Indicate the wiring specifications for mixed single and double wirings.

Note 5) For details, refer to page 481.

\* For manifold optional parts, refer to pages 481 to 484.

\* For manifold exploded view, refer to page 487.

Kit type/Cable length

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
P kit	<b>PD0</b>	Flat ribbon cable (26P), without cable	1 to 12 stations	24 stations	24
	<b>PD1</b>	Flat ribbon cable (26P), with 1.5 m cable			
	<b>PD2</b>	Flat ribbon cable (26P), with 3.0 m cable			
	<b>PD3</b>	Flat ribbon cable (26P), with 5.0 m cable			
	<b>PDC</b>	Flat ribbon cable (20P), without cable	1 to 9 stations	18 stations	18

Note) The maximum number of stations is determined by the total number of solenoids. For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

## How to Order Valve

**10-S0710-5**

Clean series

Actuation type

Symbol	Specifications
<b>1</b>	2-position single
<b>2</b>	2-position double
<b>A</b>	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
<b>B</b>	4-position dual 3-port (N.O. + N.O.) [Pressure center]
<b>C</b>	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

Base mounted plug-in

Voltage

Symbol	Specifications
<b>5</b>	24 VDC
<b>6</b>	12 VDC

Function

Symbol	Specifications
<b>Nil</b>	Standard
<b>R</b>	External pilot <sup>Note)</sup>

Note) Not compatible with dual 3-port valves.

The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.


<Example>

Flat ribbon cable kit

10-SS0750-08C4C8PD1... 1 set - Manifold base part no.  
 \* 10-S0710-5 ..... 2 sets - Valve part no. (Stations 1 to 3)  
 \* 10-S0720-5 ..... 4 sets - Valve part no. (Stations 4 to 5)  
 \* 10-S07A0-5 ..... 1 set - Valve part no. (Stations 6 to 7)  
 \* SS0700-10A-1 ..... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.


Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.





# P

## Series 10-S0700 kit (Flat Ribbon Cable)

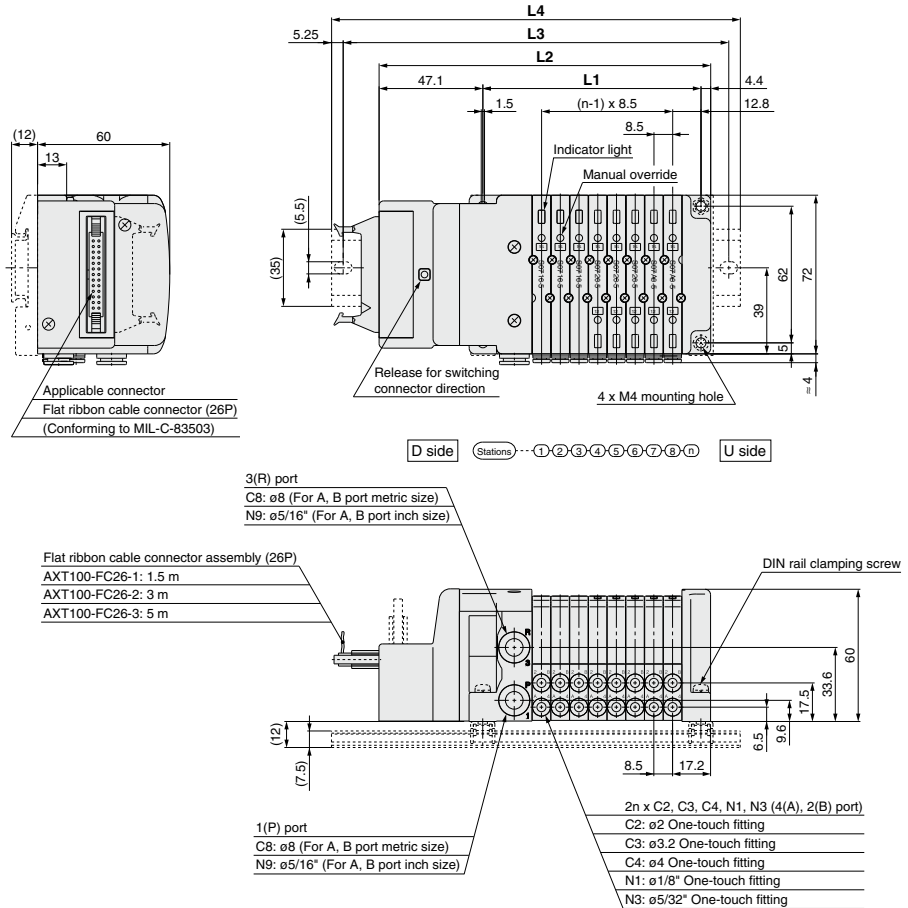


### Dimensions

Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 82.5$  n: Station (Maximum 24 stations)

L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
L1		48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167	175.5	184	192.5	201	209.5	218	226.5	235
L2		99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210	218.5	227	235.5	244	252.5	261	269.5	278	286.5
L3		125	137.5	150	162.5	175	187.5	200	212.5	225	237.5	250	262.5	275	287.5	300	312.5	325	337.5	350	362.5	375	387.5	400
L4		135.5	148	160.5	173	185.5	198	210.5	223	235.5	248	260.5	273	285.5	298	310.5	323	335.5	348	360.5	373	385.5	398	410.5



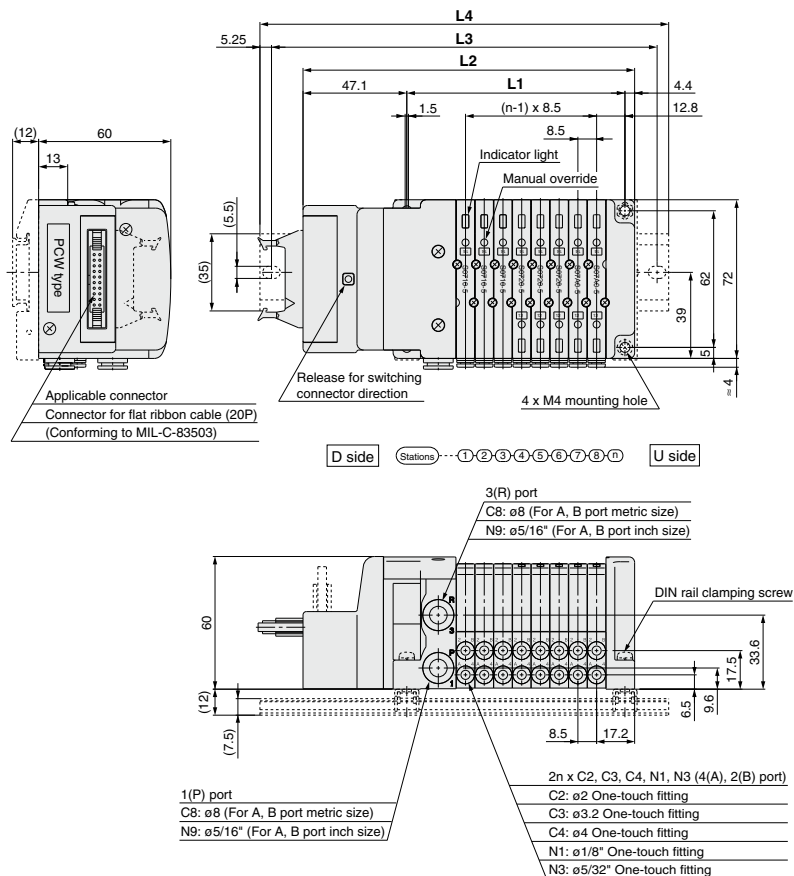

#### Dimensions

Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 82.5$  n: Station (Maximum 16 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167
L2	99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210	218.5
L3	125	137.5	150	162.5	175	187.5	200	212.5	225	237.5	250	262.5	275	287.5	300
L4	135.5	148	160.5	173	185.5	198	210.5	223	235.5	248	260.5	273	285.5	298	310.5

## Plug-in Manifold Stacking Base

# Terminal Block Box

## T kit

Plug-in Manifold  
Stacking Base



With  
Terminal  
Block Box

Page 469



Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment


Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors

# T

## Series 10-S0700 Plug-in Manifold Stacking Base kit (Terminal Block Box)




- This kit has a small terminal box inside a junction box. The electrical entry port (G3/4) permits connection of conduit fittings.

### Terminal Block Connection

#### Step 1. How to remove terminal block cover

Loosen the 4 mounting screws (M4) and open the terminal block cover.

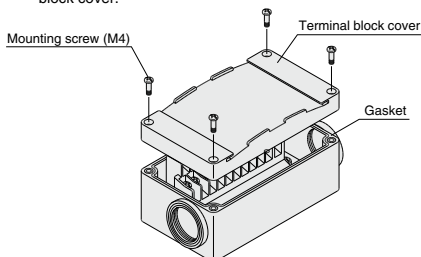


#### Step 3. How to replace terminal block cover

Securely tighten the screws with the torque shown in the table below, after confirming that the gasket is installed correctly.

Proper tightening torque (N-m)
0.7 to 1.2


#### Step 2. The diagram below shows the terminal block wiring schematic. All stations are provided with double solenoid wiring.

Connect each wire to the power supply side, according to the markings provided inside the terminal block.

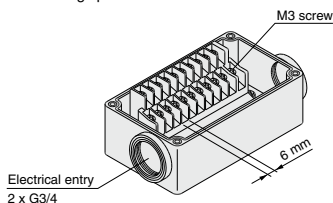

• Applicable crimped terminal: 1.25-3S, 1.25Y-3, 1.25Y-3N, 1.25Y-3.5


### Electrical Wiring Specifications



Double wiring (connected to SOLA and SOLB) is adopted for the internal wiring of each station, regardless of valve type and option types. Mixed single and double wiring is available as an option.

Note) Mounting valve has no polarity. It can also be used as a negative common.

#### Standard wiring

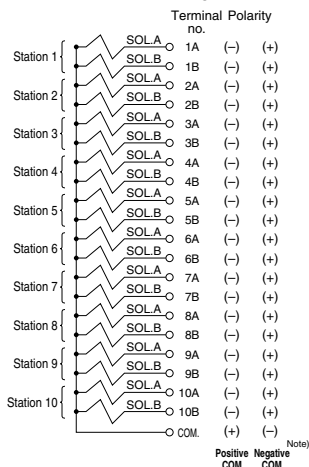

#### Special Wiring Specifications (Option) [-K]

Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 20.

##### 1. How to Order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations of the single and double wiring on the manifold specification sheet.

##### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.



## How to Order Manifold



**10-SS0750-08C4C8TD0-B**

① ② ③ ④ ⑤

Clean series

### ① Stations

Symbol	Stations
<b>01</b>	1 station
⋮	⋮
<b>20</b> <sup>Note</sup>	20 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

### ② Cylinder port size

Symbol	Port size	
<b>C2</b>	With ø2 One-touch fitting	Metric
<b>C3</b>	With ø3.2 One-touch fitting	
<b>C4</b>	With ø4 One-touch fitting	
<b>CM</b>	Mixed sizes and with port plug <sup>Note</sup>	
<b>N1</b>	With ø1/8" One-touch fitting	Inch
<b>N3</b>	With ø5/32" One-touch fitting	
<b>NM</b>	Mixed sizes and with port plug <sup>Note</sup>	

Note) Specify "Mixed sizes and with port plug" on the manifold specification sheet.

### ③ P, R port size

Symbol	Port size	
<b>C6</b>	With ø6 One-touch fitting	Metric
<b>C8</b>	With ø8 One-touch fitting	
<b>N7</b>	With ø1/4" One-touch fitting	Inch
<b>N9</b>	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### ④ Kit type

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
T kit	<b>TD0</b>	Terminal block box	1 to 10 stations	20 stations	20

Note) The maximum number of stations is determined by the total number of solenoids.  
For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

### ⑤ Option

Symbol	Specifications
<b>Nil</b>	None
<b>B</b> <sup>Note 2)</sup>	With back pressure check valve (All stations)
<b>D</b>	With DIN rail (Rail length: Standard)
<b>D0</b>	Without DIN rail (With bracket)
<b>D</b> <input type="checkbox"/> <sup>Note 3)</sup>	With DIN rail Designated length ( <input type="checkbox"/> : Station)
<b>K</b> <sup>Note 4)</sup>	Special wiring specifications (Except double wiring)
<b>N</b>	With name plate
<b>R</b> <sup>Note 5)</sup>	External pilot

Note 1) When two or more options are specified, indicate them alphabetically.

Example) -BKN

Note 2) When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.

Note 3) The available number of stations is larger than the number of manifold stations.

Note 4) Indicate the wiring specifications for mixed single and double wirings.

Note 5) For details, refer to page 481.

\* For manifold optional parts, refer to pages 481 to 484.

\* For manifold exploded view, refer to page 487.

## How to Order Valve

**10-S0710-0-5**

Clean series

Actuation type

Symbol	Specifications
<b>1</b>	2-position single
<b>2</b>	2-position double
<b>A</b>	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
<b>B</b>	4-position dual 3-port (N.O. + N.O.) [Pressure center]
<b>C</b>	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

Voltage

Symbol	Specifications
<b>5</b>	24 VDC
<b>6</b>	12 VDC

Function

Symbol	Specifications
<b>Nil</b>	Standard
<b>R</b>	External pilot <sup>Note</sup>

Note) Not compatible with dual 3-port valves.

The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

Terminal block box kit

10-SS0750-08C4C8TD0--1 set - Manifold base part no.

× 10-S0710-5.....3 sets - Valve part no. (Stations 1 to 3)


× 10-S0720-5.....2 sets - Valve part no. (Stations 4 to 5)

× 10-S07A0-5.....2 sets - Valve part no. (Stations 6 to 7)

× SS0700-10A-1.....1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.

Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment


Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

# T

## Series 10-S0700 kit (Terminal Block Box)

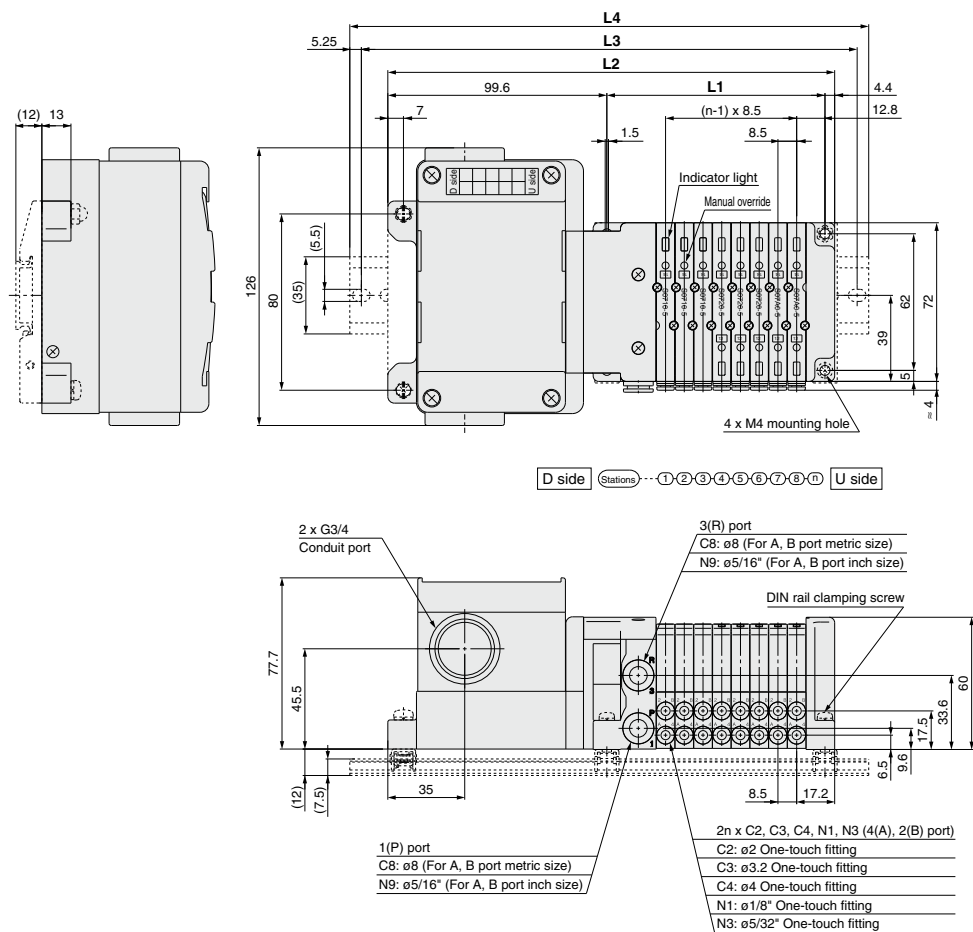

### Dimensions

Formula L1 = 8.5n + 31, L2 = 8.5n + 135 n: Station (Maximum 20 stations)


L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
<b>L1</b>	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167	175.5	184	192.5	201
<b>L2</b>	152	160.5	169	177.5	186	194.5	203	211.5	220	228.5	237	245.5	254	262.5	271	279.5	288	296.5	305
<b>L3</b>	175	187.5	200	212.5	225	237.5	250	262.5	275	287.5	300	312.5	325	337.5	350	362.5	375	387.5	400
<b>L4</b>	185.5	198	210.5	223	235.5	248	260.5	273	285.5	298	310.5	323	335.5	348	360.5	373	385.5	398	410.5

## Plug-in Manifold Stacking Base

### Lead Wire

# L kit

Plug-in Manifold  
Stacking Base

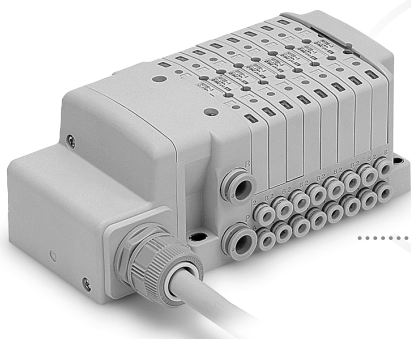

Lead Wire  
Direct Entry  
Type

Page 473



Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment


Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



# L Series 10-S0700 Plug-in Manifold Stacking Base kit (Lead Wire)




## ●Direct electrical entry type

## Electrical Wiring Specifications

### Lead wire specifications

Lead wire

0.3 mm<sup>2</sup> x 25 cores



Sheath  
Color: White

As the standard electrical wiring specifications, double wiring (connected to SOLA and SOLB) is adopted for the internal wiring of each station for 12 stations or less, regardless of valve and option types. Mixed single and double wiring is available as an option. For details, refer to "Special Wiring Specifications" (Option) below.

		Terminal no.	Polarity	Lead wire color	Dot marking	
Station 1		SOLA 1	(-)	(+)	Black	None
		SOLB 14	(-)	(+)	Yellow	Black
Station 2		SOLA 2	(-)	(+)	Brown	None
		SOLB 15	(-)	(+)	Pink	Black
Station 3		SOLA 3	(-)	(+)	Red	None
		SOLB 16	(-)	(+)	Blue	White
Station 4		SOLA 4	(-)	(+)	Orange	None
		SOLB 17	(-)	(+)	Purple	None
Station 5		SOLA 5	(-)	(+)	Yellow	None
		SOLB 18	(-)	(+)	Gray	None
Station 6		SOLA 6	(-)	(+)	Pink	None
		SOLB 19	(-)	(+)	Orange	Black
Station 7		SOLA 7	(-)	(+)	Blue	None
		SOLB 20	(-)	(+)	Red	White
Station 8		SOLA 8	(-)	(+)	Purple	White
		SOLB 21	(-)	(+)	Brown	White
Station 9		SOLA 9	(-)	(+)	Gray	Black
		SOLB 22	(-)	(+)	Pink	Red
Station 10		SOLA 10	(-)	(+)	White	Black
		SOLB 23	(-)	(+)	Gray	Red
Station 11		SOLA 11	(-)	(+)	White	Red
		SOLB 24	(-)	(+)	Black	White
Station 12		SOLA 12	(-)	(+)	Yellow	Red
		SOLB 25	(-)	(+)	White	None
		COM 13	(+)	(-)	Orange	Red
			Positive COM	Negative COM	(Note)	

Positive COM Negative COM

Note) Mounting valve has no polarity. It can also be used as a negative common.

### Lead wire length

SS0750-08 C4 LD 0

### Lead wire length

0	0.6 m
1	1.5 m
2	3.0 m

### Electrical Characteristics

Item	Property
Conductor resistance $\Omega/\text{km}$ , 20°C	65 or less
Voltage limit V, 1 minute, AC	1000
Insulation resistance $M\Omega/\text{km}$ , 20°C	5 or more

Note) Cannot be used for movable wiring.  
The minimum bending radius of cable is 20 mm.

## Special Wiring Specifications (Option) [-K]

Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 24.

### 1. How to Order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations of the single and double wiring on the manifold specification sheet.

### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.

## How to Order Manifold



**10-SS0750-08 C4 C8 LD0-B**

Clean series

### Stations

Symbol	Stations
02	2 stations
...	...
24	24 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

### Cylinder port size

Symbol	Port size	
C2	With ø2 One-touch fitting	Metric
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
CM	Mixed sizes and with port plug <sup>Note)</sup>	Inch
N1	With ø1/8" One-touch fitting	
N3	With ø5/32" One-touch fitting	
NM	Mixed sizes and with port plug <sup>Note)</sup>	

Note) Specify "Mixed sizes and with port plug" on the manifold specification sheet.

### P, R port size

Symbol	Port size	
C6	With ø6 One-touch fitting	Metric
C8	With ø8 One-touch fitting	
N7	With ø1/4" One-touch fitting	Inch
N9	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### Option

Symbol	Specifications
Nil	None
B <sup>Note 2)</sup>	With back pressure check valve (All stations)
D	With DIN rail (Rail length: Standard)
D0	Without DIN rail (With bracket)
D□ <sup>Note 3)</sup>	With DIN rail Designated length (□: Station)
K <sup>Note 4)</sup>	Special wiring specifications (Except double wiring)
N	With name plate
R <sup>Note 5)</sup>	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -BKN

Note 2) When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.

Note 3) The available number of stations is larger than the number of manifold stations.

Note 4) Indicate the wiring specifications for mixed single and double wirings.

Note 5) For details, refer to page 481.

\* For manifold optional parts, refer to pages 481 to 484.

\* For manifold exploded view, refer to page 487.

### Kit type/Cable length

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
L kit	LD0	Lead wire, with 0.6 m cable	1 to 12 stations	24 stations	24
	LD1	Lead wire, with 1.5 m cable			
	LD2	Lead wire, with 3.0 m cable			

Note) The maximum number of stations is determined by the total number of solenoids.  
For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

## How to Order Valve

**10-S07 1 0 - 5**

Clean series

### Actuation type

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

### Voltage

Symbol	Specifications
5	24 VDC
6	12 VDC

### Function

Symbol	Specifications
Nil	Standard
R	External pilot <sup>Note)</sup>

Note) Not compatible with dual 3-port valves.  
The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

Base mounted plug-in

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.


### <Example>

Lead wire kit

10-SS0750-08C4C8LD0...1 set - Manifold base part no.  
 \* 10-S0710-5 .....3 sets - Valve part no. (Stations 1 to 3)  
 \* 10-S0720-5 .....2 sets - Valve part no. (Stations 4 to 5)  
 \* 10-S07A0-5 .....2 sets - Valve part no. (Stations 6 to 7)  
 \* SS0700-10A-1 .....1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.

Write sequentially from the 1st station on the D side.  
When part no. written collectively are complicated, specify on the manifold specification sheet.



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.


Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

# L Series 10-S0700 kit (Lead Wire)

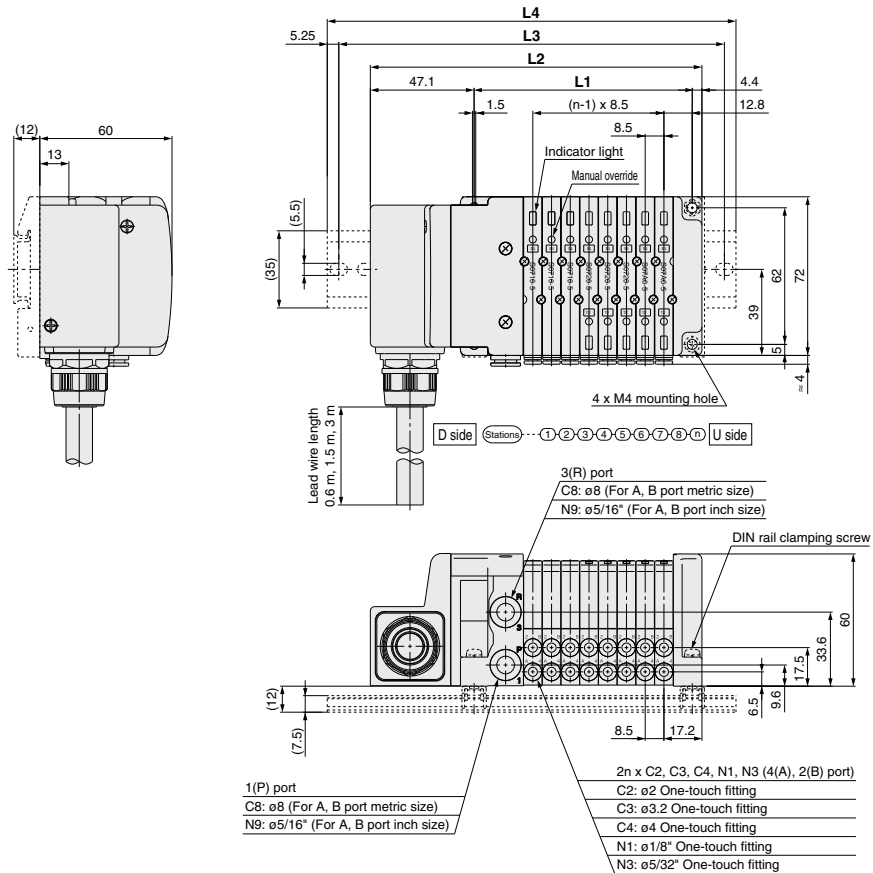

## Dimensions

Formula L1 = 8.5n + 31, L2 = 8.5n + 82.5 n: Station (Maximum 24 stations)

L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
L1		48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167	175.5	184	192.5	201	209.5	218	226.5	235
L2		99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210	218.5	227	235.5	244	252.5	261	269.5	278	286.5
L3		125	137.5	150	162.5	175	187.5	200	212.5	225	237.5	250	262.5	275	287.5	300	312.5	325	337.5	350	362.5	375	387.5	400
L4		135.5	148	160.5	173	185.5	198	210.5	223	235.5	248	260.5	273	285.5	298	310.5	323	335.5	348	360.5	373	385.5	398	410.5

## Plug-in Manifold Stacking Base

# Circular Connector

# M kit

Plug-in Manifold  
Stacking Base



Circular  
Connector  
26 Pins

Page 477



Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment


Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors

# M


# Series 10-S0700 Plug-in Manifold Stacking Base kit (Circular Connector)



- Simplification and labor savings for wiring work can be achieved by using a circular connector for the electrical connection.

## Electrical Wiring Specifications

### Circular connector



Double wiring (connected to SOLA and SOLB) is adopted for the internal wiring of each station, regardless of valve and option types.  
Mixed single and double wiring is available as an option. For details, refer to "Special Wiring Specifications" (Option) below.

	Terminal no.	Polarity
Station 1	SOLA 1	(-) (+)
	SOLB 2	(-) (+)
Station 2	SOLA 3	(-) (+)
	SOLB 4	(-) (+)
Station 3	SOLA 5	(-) (+)
	SOLB 6	(-) (+)
Station 4	SOLA 7	(-) (+)
	SOLB 8	(-) (+)
Station 5	SOLA 9	(-) (+)
	SOLB 10	(-) (+)
Station 6	SOLA 11	(-) (+)
	SOLB 12	(-) (+)
Station 7	SOLA 13	(-) (+)
	SOLB 14	(-) (+)
Station 8	SOLA 15	(-) (+)
	SOLB 16	(-) (+)
Station 9	SOLA 17	(-) (+)
	SOLB 18	(-) (+)
Station 10	SOLA 19	(-) (+)
	SOLB 20	(-) (+)
Station 11	SOLA 21	(-) (+)
	SOLB 22	(-) (+)
Station 12	SOLA 23	(-) (+)
	SOLB 24	(-) (+)
	COM. 25	(+) (-)
	COM. 26	(+) (-)

Note) Mounting valve has no polarity. It can also be used as a negative common.

## Special Wiring Specifications (Option) [-K]

Mixed single and double wiring are available as an option. The maximum number of manifold stations is determined by the number of solenoids. Count one point for a single solenoid type and two points for a double solenoid type. The total number of solenoids (points) must not exceed 24.

### 1. How to Order valve

Indicate an option symbol, -K, for the manifold part number and be sure to specify the mounting position and number of stations of the single and double wiring on the manifold specification sheet.


### 2. Wiring specifications

Connector terminal numbers are connected from solenoid station 1 on the A side in the order indicated by the arrows without skipping any terminal numbers.

## Cable Assembly

AXT100-MC26-015  
030  
050

(Circular connector assembly (26P type) can be included in a specific manifold model number. Refer to "How to Order Manifold.")

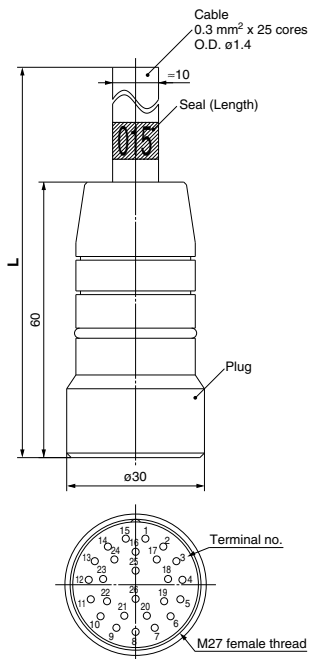

### Circular Connector Cable Assembly (Option)

Cable length (L)	Assembly part no.
1.5 m	AXT100-MC26-015
3 m	AXT100-MC26-030
5 m	AXT100-MC26-050

\* Cannot be used for movable wiring.

## How to Order Manifold



**10-SS0750-08 C4 C8 MD1-B**

①      ②      ③      ④      ⑤

Clean series

### ① Stations

Symbol	Stations
<b>02</b>	2 stations
⋮	⋮
<b>24</b> <sup>Note)</sup>	24 stations

Note) The maximum number of stations will be different depending on the wiring specifications.

### ② Cylinder port size

Symbol	Port size	
<b>C2</b>	With ø2 One-touch fitting	Metric
<b>C3</b>	With ø3.2 One-touch fitting	
<b>C4</b>	With ø4 One-touch fitting	
<b>CM</b>	Mixed sizes and with port plug <sup>Note)</sup>	
<b>N1</b>	With ø1/8" One-touch fitting	Inch
<b>N3</b>	With ø5/32" One-touch fitting	
<b>NM</b>	Mixed sizes and with port plug <sup>Note)</sup>	

Note) Specify "Mixed sizes and with port plug" on the manifold specification sheet.

### ③ P, R port size

Symbol	Port size	
<b>C6</b>	With ø6 One-touch fitting	Metric
<b>C8</b>	With ø8 One-touch fitting	
<b>N7</b>	With ø1/4" One-touch fitting	Inch
<b>N9</b>	With ø5/16" One-touch fitting	

Note) If an inch size cylinder port is selected, select inch size piping connections for the P and R ports as well.

### ④ Kit type/Cable length

Kit type	Symbol	Specifications	Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
M kit	<b>MD0</b>	Circular connector (26P), without cable	1 to 12 stations	24 stations	24
	<b>MD1</b>	Circular connector (26P), with 1.5 m cable			
	<b>MD2</b>	Circular connector (26P), with 3.0 m cable			
	<b>MD3</b>	Circular connector (26P), with 5.0 m cable			

Note) The maximum number of stations is determined by the total number of solenoids.  
For mixed single and double wirings, enter "K" to the order code options.

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

## How to Order Valve

**10-S07 1 0 - 5**

Clean series

Actuation type

Symbol	Specifications
<b>1</b>	2-position single
<b>2</b>	2-position double
<b>A</b>	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
<b>B</b>	4-position dual 3-port (N.O. + N.O.) [Pressure center]
<b>C</b>	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

Base mounted plug-in

Voltage

Symbol	Specifications
<b>5</b>	24 VDC
<b>6</b>	12 VDC

Function

Symbol	Specifications
<b>Nil</b>	Standard
<b>R</b>	External pilot <sup>Note)</sup>

Note) Not compatible with dual 3-port valves.  
The 3(R) port is released to the atmosphere. (Pressurization and vacuum are not allowed.)

### ⑤ Option

Symbol	Specifications
<b>Nil</b>	None
<b>B</b> <sup>Note 2)</sup>	With back pressure check valve (All stations)
<b>D</b>	With DIN rail (Rail length: Standard)
<b>D0</b>	Without DIN rail (With bracket)
<b>D□</b> <sup>Note 3)</sup>	With DIN rail Designated length (□: Station)
<b>K</b> <sup>Note 4)</sup>	Special wiring specifications (Except double wiring)
<b>N</b>	With name plate
<b>R</b> <sup>Note 5)</sup>	External pilot

Note 1) When two or more options are specified, indicate them alphabetically.

Example) -BKN

Note 2) When installing a back pressure check valve on the required station, enter the part number and specify the station position on the manifold specification sheet.

Note 3) The available number of stations is larger than the number of manifold stations.

Note 4) Indicate the wiring specifications for mixed single and double wirings.

Note 5) For details, refer to page 481.

• For manifold optional parts, refer to pages 481 to 484.

• For manifold exploded view, refer to page 487.

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

### <Example>

Circular connector kit

10-SS0750-08C4CM01... 1 set - Manifold base part no.

\* 10-S0710-5 ..... 3 sets - Valve part no. (Stations 1 to 3)


\* 10-S0720-5 ..... 2 sets - Valve part no. (Stations 4 to 5)

\* 10-S07A0-5 ..... 2 sets - Valve part no. (Stations 6 to 7)

\* SS0700-10A-1 ..... 1 set - Blanking plate part no. (Station 8)

Prefix the asterisk to the part no. of the solenoid valve, etc.

Write sequentially from the 1st station on the D side.  
When part no. written collectively are complicated, specify on the manifold specification sheet.



Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment


Modular F. R.

Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

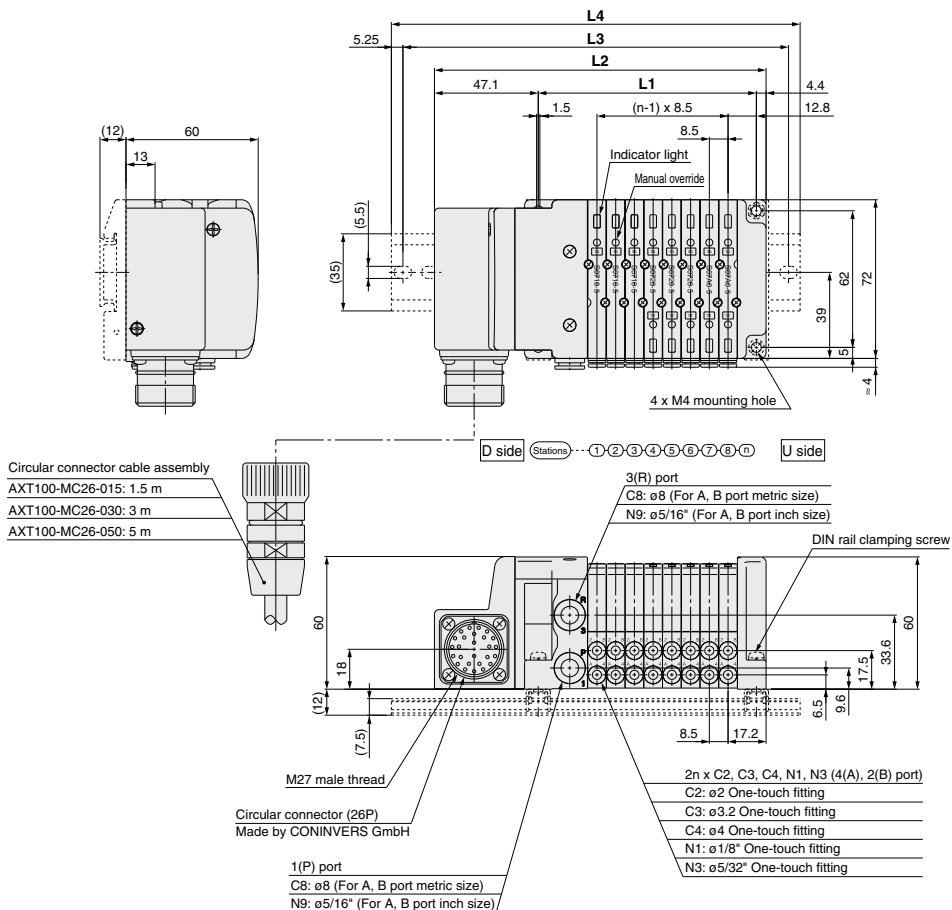

### Dimensions

Formula  $L1 = 8.5n + 31$ ,  $L2 = 8.5n + 82.5$  n: Station (Maximum 24 stations)

L \ n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
L1	48	56.5	65	73.5	82	90.5	99	107.5	116	124.5	133	141.5	150	158.5	167	175.5	184	192.5	201	209.5	218	226.5	235
L2	99.5	108	116.5	125	133.5	142	150.5	159	167.5	176	184.5	193	201.5	210	218.5	227	235.5	244	252.5	261	269.5	278	286.5
L3	125	137.5	137.5	150	162.5	162.5	175	187.5	187.5	200	212.5	212.5	225	237.5	250	250	262.5	275	275	287.5	300	300	312.5
L4	135.5	148	148	160.5	173	173	185.5	198	198	210.5	223	223	235.5	248	260.5	260.5	273	285.5	285.5	298	310.5	310.5	323





# Series 10-S0700 Plug-in Manifold Stacking Base


## Manifold Optional Parts

### Blanking plate

#### SS0700-10A-1

It is used by attaching on the manifold block for being prepared for removing a valve for maintenance reasons or planning to mount a spare valve, etc.

Weight: 25 g

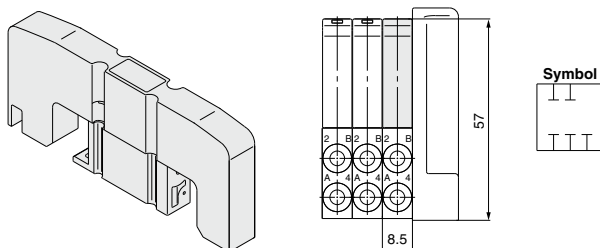

### External pilot [-R]

This can be used when the air pressure is 0.1 to 0.2 MPa lower than the minimum operating pressure of the solenoid valves or used for vacuum specifications.

Add R to the part numbers of manifolds and valves to indicate the external pilot specifications.

An M5 port will be installed on the top side of the manifold's SUP/EXH block.

#### ● How to Order Valve (Example)

10-S0710 R -5


External pilot

#### ● How to Order Manifold (Example)

\* Indicate R for an option.

10-SS0750-08C4FD1-R

External pilot

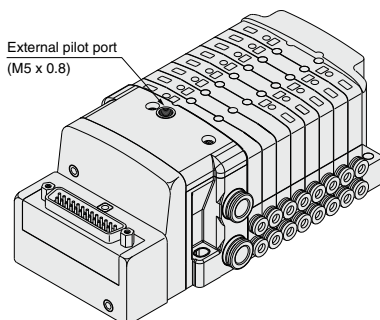

Note 1) Not compatible with dual 3-port valves.

Note 2) When the internal pilot type and external pilot type of valves are mixed up on the manifold, order the manifold suitable for the specifications of the external pilot valve.

Note 3) Since the pilot EXH of valves with the external pilot specification also has a common exhaust specification, the 3(R) port should be released to the atmosphere.

### Individual SUP/EXH spacer


#### SS0700-PR-1

If this spacer is installed instead of a valve, it is possible to add SUP and EXH ports. In this condition, the A port should be an SUP port and the B port an EXH port.

\* Specify the spacer mounting position and SUP/EXH passage shut off positions on the manifold specification sheet.

\* The spacer comes with a SUP block plate and an EXH block plate.

\* Electrical wiring is also connected to the spacer mounting position.

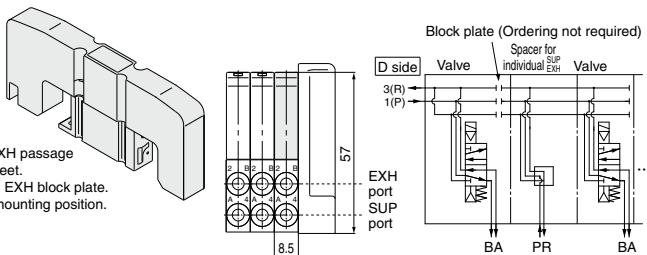

## SUP block plate

### SS0700-B-P

When different pressures, high and low, are supplied to one manifold, a SUP block plate is inserted between the stations under different pressures.


- \* Specify the number of stations on the manifold specification sheet.

#### <Block indication label>

When using block plates for SUP passage, indication label for confirmation of the blocking position from outside is attached. (One label of each)

- \* When ordering a block plate for SUP incorporated with the manifold, a block indication label is attached to the manifold.

Weight: 0.3 g

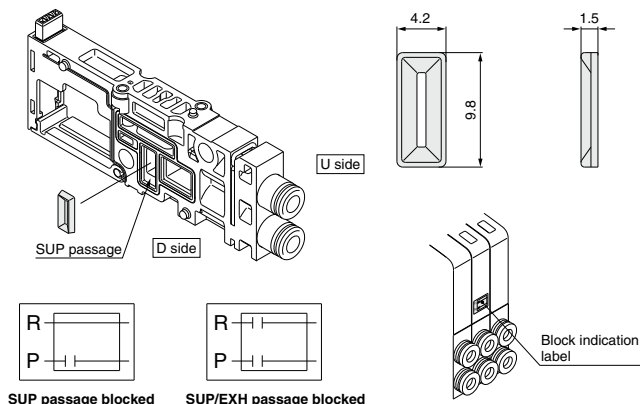

## EXH block plate

### SS0700-B-R

When valve exhaust affects the other stations on the circuit, insert EXH block plate in between stations to separate valve exhaust.


- \* Specify the number of stations on the manifold specification sheet.

#### <Block indication label>

When using block plates for EXH passage, indication label for confirmation of the blocking position from outside is attached. (One label of each)

- \* When ordering a block plate for EXH incorporated with the manifold, a block indication label is attached to the manifold.

Weight: 0.3 g

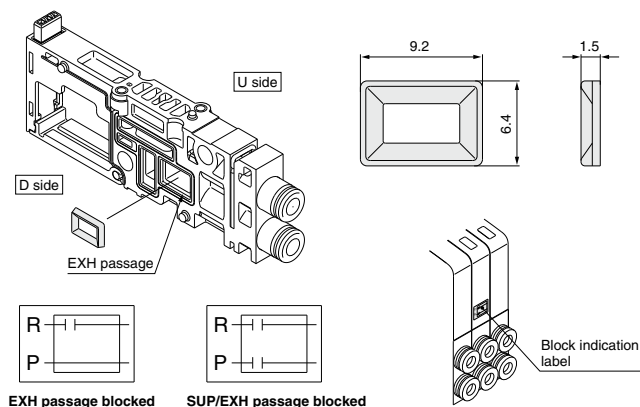


## Back pressure check valve [-B]

### SS0700-7A-1

It prevents cylinder malfunction caused by other valve exhaust. Insert it into R (EXH) port on the manifold side of a valve which is affected. It is effective when a single action cylinder is used or an exhaust center type solenoid valve is used.

- \* When a check valve for back pressure prevention is desired, and is to be installed only in certain manifold stations, clearly write the part number and specify the number of stations on the manifold specification sheet.
- \* When ordering this option incorporated with a manifold, suffix "-B" to the end of the manifold part number.

Weight: 0.1 g

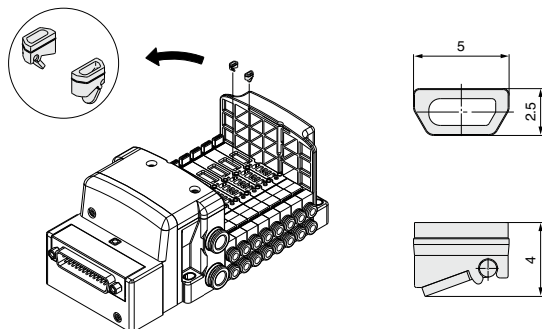

## ⚠ Precautions

1. The back pressure check valve assembly is assembly parts with a check valve structure. However, as slight air leakage is allowed for the back pressure, take care the exhaust air will not be restricted at the exhaust port.
2. When a back pressure check valve is mounted, the effective area of the valve will decrease by about 20%.

# Series 10-S0700 Plug-in Manifold Stacking Base Manifold Optional Parts

## Blanking plate with output

SS0700-1C-□

Lead wire length (mm)


Nil	600
10	1000
15	1500
20	2000
25	2500
30	3000

Blanking plate with a connector for individually outputting electricity to drive a single valve or equipment that are not on the manifold base.

Note 1) Electric current should be 0.5 A or less.  
 (Including the mounted valves) When the current is output from two positions at the same time, the current should be 0.25 A or less.

Note 2) Please consult with SMC for the max. allowable current for serial transmission kit.

Weight: 34 g

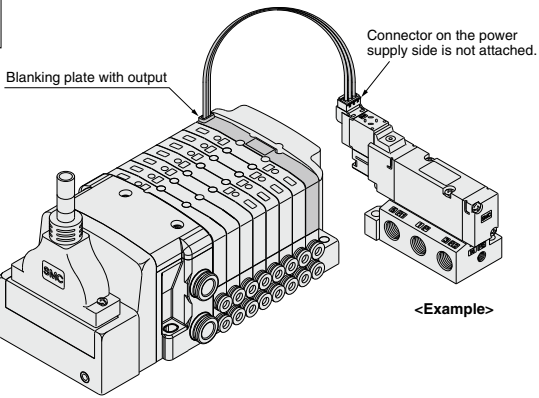


## Port plug

VVQ0000-CP

The plug is used to block the cylinder port when using a 5-port valve as a 3-port valve.

\* When ordering a plug incorporated with a manifold, indicate "CM" for the port size in the manifold part number, as well as, the mounting position and number of stations and cylinder port mounting positions, A and B on the manifold specification sheet.

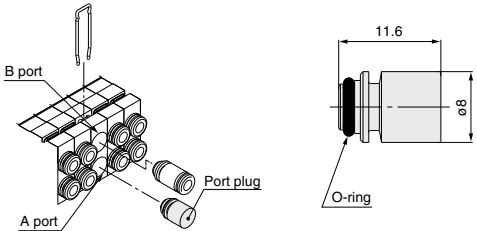


## DIN rail mounting bracket

SS0700-57A-□

Symbol	Specifications
Nil	S (EX500), F, P, L M kit
S	S (EX250) kit
T	T kit

It is used for mounting a manifold on a DIN rail. The DIN rail mounted bracket is fixed to the manifold end plate. (The specification is the same as that for the option "-D".)  
 1 set of DIN rail mounting bracket is included for 1 manifold (2 or 3 DIN rail mounting brackets (S, T kit)).

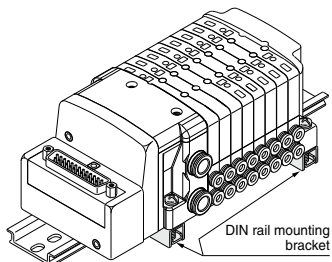


\* When ordering this option incorporated with a manifold, suffix "-D" to the end of the manifold part number.

## Blanking plug (For One-touch fittings)

KJP-02


23  
KQ2P-04  
06



It is inserted into an unused cylinder port and SUP/EXH ports.

Purchasing order is available in units of 10 pieces.

483



Dimensions (mm)					
Applicable fitting size ød	Model	A	L	D	Weight: g
2	KJP-02	8.2	17	3	0.1
3.2	KQ2P-23	16	31.5	3.2	1
4	KQ2P-04	16	32	6	1
6	KQ2P-06	18	35	8	1



## Applicable to DIN rail mounting

Each manifold can be mounted on a DIN rail.

Order it by indicating a manifold mounting symbol for DIN rail mounting [-D].

Standard DIN rail which is approx. 30 mm longer than the manifold with the specified number of stations is attached.

The following options are also available.

### ● DIN rail length longer than the standard (for stations to be added later, etc.)

In the manifold part number, specify -D for the manifold mounting symbol and add the number of required stations after the symbol.

Example) **10-SS0750-08C4FD0 - D09K**

8-station manifold

Optional symbol  
(alphabetically)


DIN rail for 9 stations

### ● How to Order DIN rail only

DIN rail part number

**AXT100-DR-n**

Note) For n, enter a number from the No. line in the table below. For L dimension, refer to the dimensions of each kit.

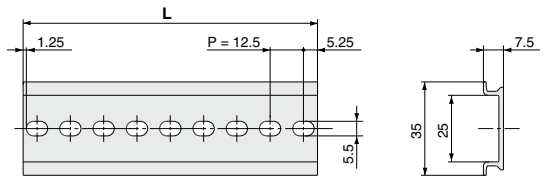

### L Dimension

$$L = 12.5 \times n + 10.5$$

No.	1	2	3	4	5	6	7	8	9	10
L dimension	23	35.5	48	60.5	73	85.5	98	110.5	123	135.5

No.	11	12	13	14	15	16	17	18	19	20
L dimension	148	160.5	173	185.5	198	210.5	223	235.5	248	260.5

No.	21	22	23	24	25	26	27	28	29	30
L dimension	273	285.5	298	310.5	323	335.5	348	360.5	373	385.5



No.	31	32	33	34	35	36	37	38	39	40
L dimension	398	410.5	423	435.5	448	460.5	473	485.5	498	510.5

## Name plate [-N]

### SS0700-N-Station (1 to max. stations)



It is a transparent resin plate for placing a label that indicates solenoid valve function, etc. Insert it into the groove on the side of the end plate and bend it as shown in the figure.

\* When ordering this option incorporated with a manifold, suffix "-N" to the end of the manifold part number.

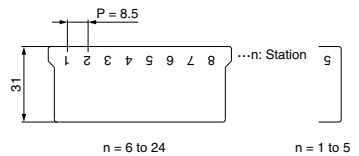



# Series 10-S0700 Plug-in Manifold Stacking Base Construction





## Single: 10-S0710

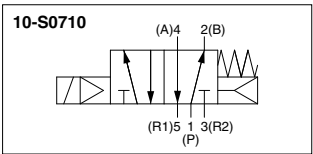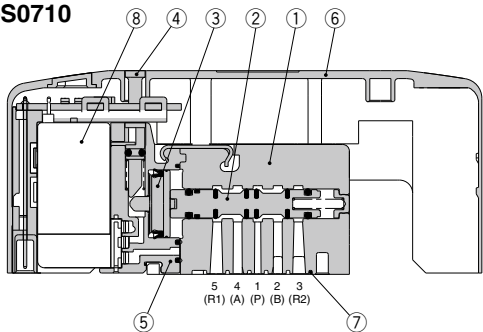

## Double: 10-S0720

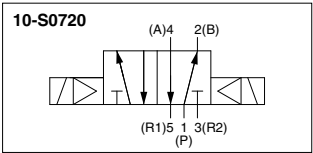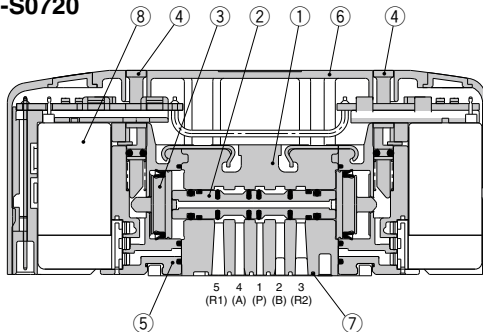

## Dual 3-Port: 10-S07B0

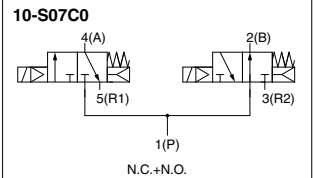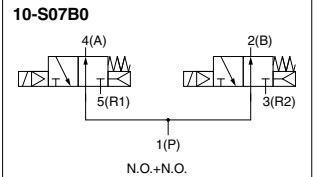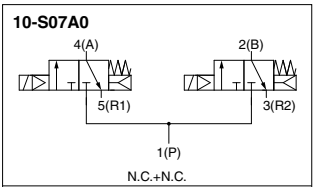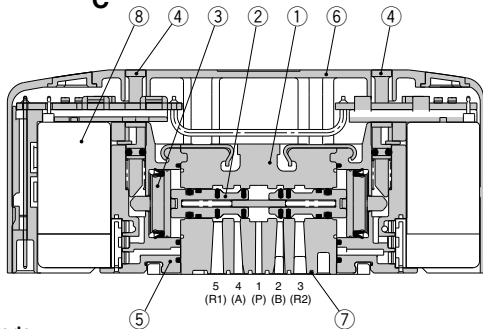

### Component Parts


No.	Description	Material
1	Body	Zinc die-casted
2	Spool	Aluminum
3	Piston	Resin
4	Manual override	Resin
5	Adapter plate	Resin
6	Cover	Resin
7	Interface gasket	HNBR
8	Pilot valve assembly <sup>Note)</sup>	—

Note) Please consult with SMC for pilot valve replacement.



# Series 10-S0700/Plug-in Manifold

## Manifold Exploded View

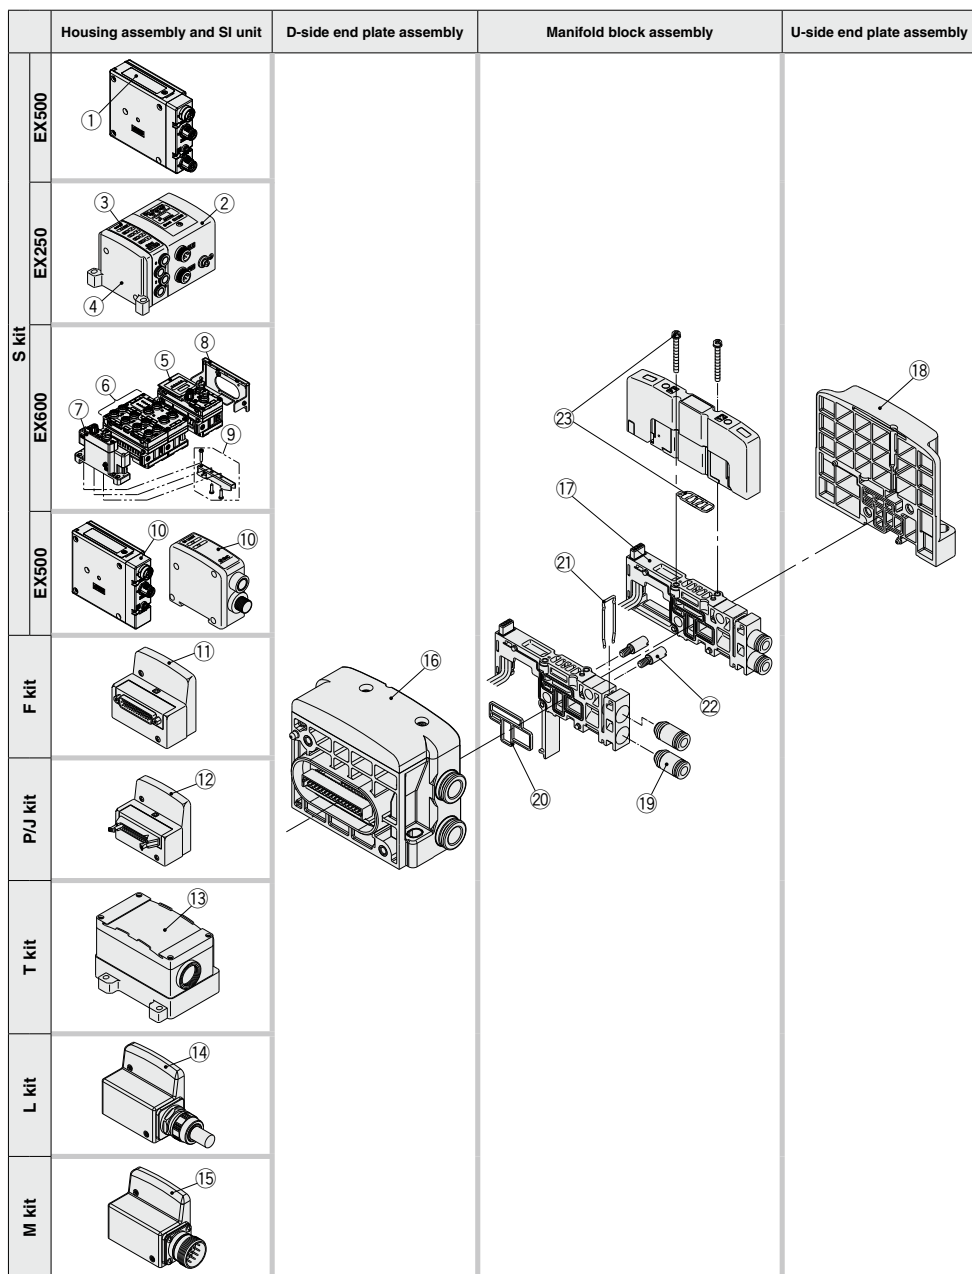

The 1-port EtherNet/IP compatible SI unit is to be discontinued as of March 2022.  
Please consider ordering the 2-port EtherNet/IP compatible SI unit as a substitute.

Discontinued models	Substitute models
EX600-SEN1	EX600-SEN3
EX600-SEN2	EX600-SEN4

## Manifold Assembly Part No.

### <Housing Assembly and SI Unit, Input Block>

No.	Description	Part no.	Note
①	EX260 SI unit	EX260-SDN1	DeviceNet® M12 connector, 32 outputs, PNP (Negative common)
		EX260-SDN2	DeviceNet® M12 connector, 32 outputs, NPN (Positive common)
		EX260-SDN3	DeviceNet® M12 connector, 16 outputs, PNP (Negative common)
		EX260-SDN4	DeviceNet® M12 connector, 16 outputs, NPN (Positive common)
		EX260-SPR1	PROFIBUS DP M12 connector, 32 outputs, PNP (Negative common)
		EX260-SPR2	PROFIBUS DP M12 connector, 32 outputs, NPN (Positive common)
		EX260-SPR3	PROFIBUS DP M12 connector, 16 outputs, PNP (Negative common)
		EX260-SPR4	PROFIBUS DP M12 connector, 16 outputs, NPN (Positive common)
		EX260-SPR5	PROFIBUS DP D-sub connector, 32 outputs, PNP (Negative common)
		EX260-SPR6	PROFIBUS DP D-sub connector, 32 outputs, NPN (Positive common)
		EX260-SPR7	PROFIBUS DP D-sub connector, 16 outputs, PNP (Negative common)
		EX260-SPR8	PROFIBUS DP D-sub connector, 16 outputs, NPN (Positive common)
		EX260-SMJ1	CC-Link M12 connector, 32 outputs, PNP (Negative common)
		EX260-SMJ2	CC-Link M12 connector, 32 outputs, NPN (Positive common)
		EX260-SMJ3	CC-Link M12 connector, 16 outputs, PNP (Negative common)
		EX260-SMJ4	CC-Link M12 connector, 16 outputs, NPN (Positive common)
		EX260-SEC1	EtherCAT M12 connector, 32 outputs, PNP (Negative common)
		EX260-SEC2	EtherCAT M12 connector, 32 outputs, NPN (Positive common)
		EX260-SEC3	EtherCAT M12 connector, 16 outputs, PNP (Negative common)
		EX260-SEC4	EtherCAT M12 connector, 16 outputs, NPN (Positive common)
		EX260-SPN1	PROFINET M12 connector, 32 outputs, PNP (Negative common)
		EX260-SPN2	PROFINET M12 connector, 32 outputs, NPN (Positive common)
		EX260-SPN3	PROFINET M12 connector, 16 outputs, PNP (Negative common)
		EX260-SPN4	PROFINET M12 connector, 16 outputs, NPN (Positive common)
		EX260-SEN1	EtherNet/IP™ M12 connector, 32 outputs, PNP (Negative common)
		EX260-SEN2	EtherNet/IP™ M12 connector, 32 outputs, NPN (Positive common)
		EX260-SEN3	EtherNet/IP™ M12 connector, 16 outputs, PNP (Negative common)
		EX260-SEN4	EtherNet/IP™ M12 connector, 16 outputs, NPN (Positive common)
②	EX250 SI unit	EX250-SDN1	DeviceNet® PNP (Negative common)
		EX250-SPR1	PROFIBUS DP PNP (Negative common)
		EX250-SAS3	AS-Interface 31 slave, 8 in/8 out, 2 isolated common type, PNP (Negative common)
		EX250-SAS5	AS-Interface 31 slave, 4 in/4 out, 2 isolated common type, PNP (Negative common)
		EX250-SAS7	AS-Interface 31 slave, 8 in/8 out, 1 common type, PNP (Negative common)
		EX250-SAS9	AS-Interface 31 slave, 4 in/4 out, 1 common type, PNP (Negative common)
		EX250-SCA1A	CANopen PNP (Negative common)
③	EX250 input block	EX250-SEN1	EtherNet/IP™ PNP (Negative common)
		EX250-IE1	M12 2 inputs
		EX250-IE2	M12 4 inputs
④	EX250 end plate assembly	EX250-IE3	M8 4 inputs
		EX250-EA1	Direct mounting
		EX250-EA2	DIN rail mounting
⑤	EX600 SI unit	EX600-SDN1A	DeviceNet® PNP (Negative common)
		EX600-SDN2A	DeviceNet® NPN (Positive common)
		EX600-SMJ1	CC-Link PNP (Negative common)
		EX600-SMJ2	CC-Link NPN (Positive common)
		EX600-SPR1A	PROFIBUS DP PNP (Negative common)
		EX600-SPR2A	PROFIBUS DP NPN (Positive common)
		EX600-WSV1 (Note)	Wireless remote module PNP (Negative common)
⑥	EX600 digital input unit	EX600-WSV2 (Note)	Wireless remote module NPN (Positive common)
		EX600-DXNB	NPN input, M12 connector, 5 pins (4 pcs.), 8 inputs
		EX600-DXPB	PNP input, M12 connector, 5 pins (4 pcs.), 8 inputs
		EX600-DXNC	NPN input, M8 connector, 3 pins (8 pcs.), 8 inputs
		EX600-DXNC1	NPN input, M8 connector, 3 pins (8 pcs.), 8 inputs, with open circuit detection
		EX600-DXPC	PNP input, M8 connector, 3 pins (8 pcs.), 8 inputs
		EX600-DXPC1	PNP input, M8 connector, 3 pins (8 pcs.), 8 inputs, with open circuit detection
		EX600-DXND	NPN input, M12 connector, 5 pins (8 pcs.), 16 inputs
		EX600-DXPD	PNP input, M12 connector, 5 pins (8 pcs.), 16 inputs
		EX600-DXNE	NPN input, D-sub connector, 25 pins, 16 inputs
		EX600-DXPE	PNP input, D-sub connector, 25 pins, 16 inputs
		EX600-DXNF	NPN input, Spring type terminal block, 32 pins, 16 inputs
		EX600-DXPF	PNP input, Spring type terminal block, 32 pins, 16 inputs

(Note) The wireless system is suitable for use only in a country where it is in accordance with the Radio Act and regulations of that country.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control

Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors



## Manifold Assembly Part No.

### <Housing Assembly and SI Unit, Input Block>

No.	Description	Part no.	Note
⑥	EX600 digital output unit	EX600-DYNB	NPN output, M12 connector, 5 pins (4 pcs.), 8 outputs
		EX600-DYPB	PNP output, M12 connector, 5 pins (4 pcs.), 8 outputs
		EX600-DYNE	NPN output, D-sub connector, 25 pins, 16 outputs
		EX600-DYPE	PNP output, D-sub connector, 25 pins, 16 outputs
		EX600-DYNF	NPN output, Spring type terminal block, 32 pins, 16 outputs
	EX600 digital I/O unit	EX600-DYPE	PNP output, Spring type terminal block, 32 pins, 16 outputs
		EX600-DMNE	NPN input/output, D-sub connector, 25 pins, 8 inputs/outputs
		EX600-DMPE	PNP input/output, D-sub connector, 25 pins, 8 inputs/outputs
		EX600-DMNF	NPN input/output, Spring type terminal block, 32 pins, 8 inputs/outputs
		EX600-DMPF	PNP input/output, Spring type terminal block, 32 pins, 8 inputs/outputs
⑦	EX600 analog input unit	EX600-AXA	M12 connector, 5 pins (2 pcs.), 2-channel input
		EX600-AYA	M12 connector, 5 pins (2 pcs.), 2-channel output
		EX600-AMB	M12 connector, 5 pins (4 pcs.), 2-channel input/output
		EX600-ED2	M12 connector, 5 pins
		EX600-ED2-2	M12 connector, 5 pins, with DIN rail mounting bracket
		EX600-ED3	7/8 inch connector, 5 pins
		EX600-ED3-2	7/8 inch connector, 5 pins, with DIN rail mounting bracket
		EX600-ED4	M12 connector (4 pins/5 pins) IN/OUT
		EX600-ED4-2	M12 connector (4 pins/5 pins) IN/OUT, with DIN rail mounting bracket
		EX600-ED5	M12 connector (4 pins/5 pins) IN/OUT
⑧	EX600 end plate	EX600-ED5-2	M12 connector (4 pins/5 pins) IN/OUT, with DIN rail mounting bracket
		EX600-ZMV1	Enclosed parts: Round head screw (M4 x 6) 2 pcs. Round head screw (M3 x 8) 4 pcs.
		EX600-ZMA2	This bracket is used for the end plate of DIN rail mounting.
		EX500-S103	EX500 Gateway Decentralized System 2 Negative common (PNP)
		EX500-Q001	EX500 Gateway Decentralized System Positive common (NPN)
		EX500-Q101	EX500 Gateway Decentralized System Negative common (PNP)
		VVQC1000-F25-1	F kit, 25 pins
		VVQC1000-P26-1	P kit, 26 pins
		VVQC1000-P20-1	P kit, 20 pins
		VVQC1000-J20-1	J kit, 20 pins
⑨	EX600 valve plate	VVQC1000-T0-1	T kit
		VVQC1000-L25-0-1	L kit, Lead wire length 0.6 m
		VVQC1000-L25-1-1	L kit, Lead wire length 1.5 m
		VVQC1000-L25-2-1	L kit, Lead wire length 3.0 m
		VVQC1000-M26-1	M kit, 26 pins
⑩	EX600 bracket for end plate		
⑪	EX500 SI unit		
⑫	D-sub connector housing assembly		
⑬	Flat ribbon cable housing assembly		
⑭	Flat ribbon cable housing assembly		
⑮	Flat ribbon cable PC wiring system compatible		
⑯	Terminal block box housing assembly		
⑰	Lead wire housing assembly		
⑱	Circular connector housing assembly		

### ⑯ D-side end plate assembly part no.

**SS0700-3** **A** -1- **C8** - **□**

**Number of outputs**

Symbol	Specifications
<b>A</b>	24 outputs or less
<b>B</b>	25 outputs or more

**Port size**

Symbol	Port size
<b>C8</b>	With ø8 One-touch fitting
<b>N9</b>	With ø5/16" One-touch fitting

**Option**

Symbol	Specifications
<b>Nil</b>	Common EXH
<b>R</b>	External pilot
<b>S</b>	Direct EXH outlet with built-in silencer

\*: When both options are specified, indicate as -RS.

### ⑰ Manifold block assembly Tie-rod (2 pcs.) and lead wire assembly for extensions are attached.

**SS0700-1A** **PD** **05** - **C3** - **□**

**Wiring specifications**

Symbol	Specifications
<b>PD</b>	Double wiring
<b>PS</b>	Single wiring
<b>P0</b>	None

**Option**

Symbol	Specifications
<b>Nil</b>	None
<b>B</b>	With back pressure check valve

**Stations**

Symbol	Stations
<b>02</b>	2 stations
<b>:</b>	:
<b>24</b>	24 stations

**Port size**

Symbol	Port size
<b>C2</b>	With ø2 One-touch fitting
<b>C3</b>	With ø3.2 One-touch fitting
<b>C4</b>	With ø4 One-touch fitting
<b>N1</b>	With ø1/8" One-touch fitting
<b>N3</b>	With ø5/32" One-touch fitting
<b>C0</b>	Without One-touch fitting

### ⑱ U-side end plate assembly part no.

**SS0700-2A-2**

### ⑲ Fitting assembly part no.

**VVQ0000-50A-C4**

**Port size**

Symbol	Applicable tube
<b>C2</b>	Applicable tube ø2
<b>C3</b>	Applicable tube ø3
<b>C4</b>	Applicable tube ø4
<b>N1</b>	Applicable tube ø1/8"
<b>N3</b>	Applicable tube ø5/32"

\*: Purchasing order is available in units of 10 pieces.

\*: For One-touch fittings replacement, refer to Specific Product Precautions.

### <Replacement Parts for Manifold Block>

No.	Description	Part no.	Qty.
20	Gasket	SS0700-80A-2	10 <sup>-1</sup>
21	Clip	SS0700-80A-4	10 <sup>-1</sup>
22	Tie-rod assembly	SS0700-TR-□	2 <sup>-2</sup>

\*1: 1 set includes 10 pieces.

\*2: 1 set includes 2 pieces. Please order when eliminating manifold stations. When adding stations, tie-rods are attached to the manifold block assembly. Therefore, it is not necessary to order.  
□: Stations 02 to 24

### <Replacement Parts for Valve>

No.	Description	Part no.	Qty.
23	Gasket, Screw	S0700-GS-5	10

\*: Above part number consists of 10 units. Each unit has one gasket and two screws.



## How to Add Manifold Stations (Plug-in Type / Lead Wire Connection Type)

### What to order


- Manifold block assembly (Refer to page 489-16.)

### Steps for adding stations

- ① Loosen hexagon bolts from the end plate at the U-side and remove the end plate.
- ② Connect the tie-rod for increasing the station number, open the junction cover, mount the manifold block assembly and U-side end plate and tighten them by hexagon bolts.  
(Tightening torque: 0.85 to 0.95 N·m)
- ③ Connect the round type terminal of red lead wire to the common terminal inside the junction cover.

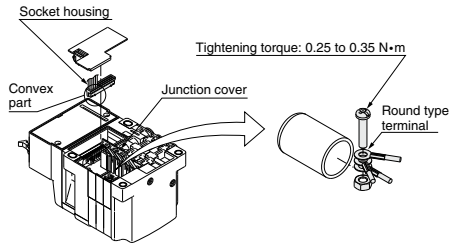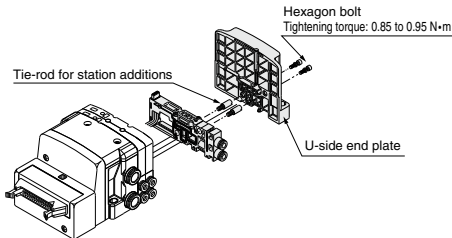

- ④ Take out the socket housing and connect the black and white lead wires. The connection layout is common to all kits.



		Terminal no.	
COM.	Red ... 1A	1B ... Red	COM.
SOLA Station 2	Black ... 2A	2B ... Black	Station 1 SOLA
SOLB Station 3	White ... 3A	3B ... Black	Station 3 SOLA
SOLB Station 4	White ... 4A	4B ... Black	Station 4 SOLA
SOLB Station 5	White ... 5A	5B ... Black	Station 5 SOLA
	6A	6B ... Black	Station 6 SOLA
	7A	7B	
	8A	8B	
	9A	9B	
	10A	10B	
	11A	11B	
	12A	12B	
	13A	13B	




## Plug Lead Manifold Bar Base

# Connector


# C kit

**Plug-in Manifold  
Bar Base**

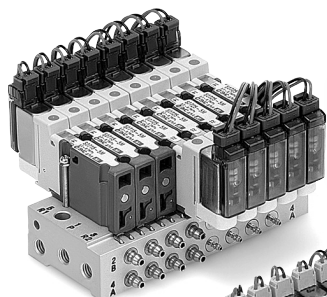

**With barb fittings**

**Individual  
Connector**

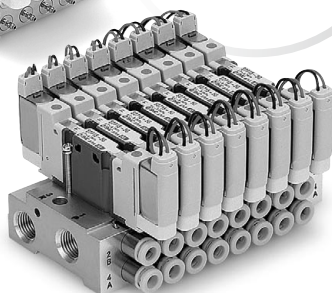

**With One-touch fittings**



➤ **Page 491**

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment


Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



# C

## Series 10-S0700 Plug Lead Manifold Bar Base kit (Connector)

### How to Order Manifold

10-SS0755-08C4 C-

Clean series

Plug lead

Stations

Symbol	Stations
02	2 stations
...	...
20	20 stations

Cylinder port size

Symbol	Port size	Manifold pitch
M5	M5 thread	Metric
C2	With ø2 One-touch fitting	
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
CM	Mixed sizes and with port plug <sup>Note</sup>	8.5
N1	With ø1/8" One-touch fitting	
N3	With ø5/32" One-touch fitting	
NM	Mixed sizes and with port plug <sup>Note</sup>	
		Inch

Note) Specify "Mixed sizes and with port plug" on the manifold specification sheet.  
\* The manifold pitch 7.5 mm type is available as special order.

Option

Symbol	Specifications
Nil	None
R <sup>Note</sup>	External pilot

Note) For details, refer to page 497.  
\* For manifold optional parts, refer to pages 497 to 498.

Connector kit

P, R port thread type

Symbol	Manifold pitch	
	8.5	7.5
Nil	Rc (PT)	M5
F	G (PF)	
N	NPT	
T	NPTF	

### How to Order Valve

10-S0715-5G

Clean series

Electrical entry

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [pressure center]
C	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

Symbol	Specifications
G	Grommet
M	Plug connector, with lead wire (Light/surge voltage suppressor)
MO	Plug connector, without lead wire (Light/surge voltage suppressor)

Voltage

Symbol	Specifications
5	24 VDC
6	12 VDC

Function

Symbol	Specifications
Nil	Standard
R	External pilot <sup>Note</sup>

Note) Not compatible with dual 3-port valves.  
The 3(R) port is released to the atmosphere.  
(Pressurization and vacuum are not allowed.)

Base mounted plug lead

### How to Order Manifold Assembly


Specify the part numbers for valves and options together beneath the manifold base part number.

<Example>



Connector kit

10-SS0755-07C4C... 1 set - Manifold base part no.  
+ 10-S0715-5G..... 3 sets - Valve part no. (Stations 1 to 3)  
+ 10-S0725-5G..... 2 sets - Valve part no. (Stations 4 to 5)  
+ 10-S07A5-5G..... 2 sets - Valve part no. (Stations 6 to 7)



Prefix the asterisk to the part no. of the solenoid valve, etc.  
Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.



10-SS0755-□ ☐ M5  
☐ C ☐ N

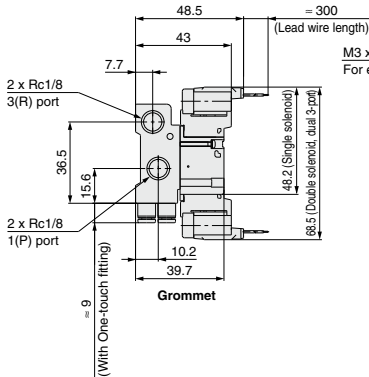

M3 x 0.5 external pilot port  
 For external pilot specifications

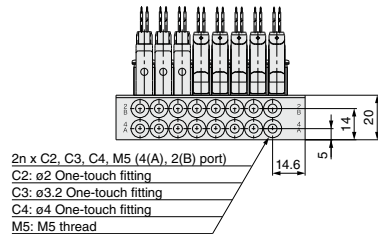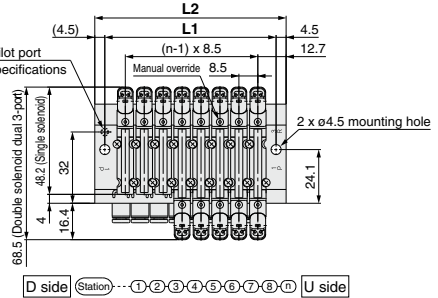

## Dimensions

Formula L1 = 8.5n + 8.9, L2 = 8.5n + 17.9 n: Station (Maximum 20 stations)

L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
L1		25.9	34.4	42.9	51.4	59.9	68.4	76.9	85.4	93.9	102.4	110.9	119.4	127.9	136.4	144.9	153.4	161.9	170.4	178.9
L2		34.9	43.4	51.9	60.4	68.9	77.4	85.9	94.4	102.9	111.4	119.9	128.4	136.9	145.4	153.9	162.4	170.9	179.4	187.9




Plug Lead Manifold Bar Base

Serial Transmission

S kit

Plug Lead Manifold  
Bar Base

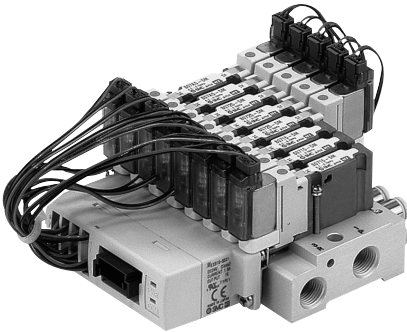

Gateway-type  
Serial Transmission  
System

**EX510**

Connect all wiring  
using connectors.

Page 495



Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.


Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors





## How to Order Manifold

10-SS0755-SA [ ] 08 C4 [ ] - [ ]

Clean series

S kit  
EX510 serial wiring

SI unit COM.

Nil	+COM.
N	-COM.

Stations

Symbol	Stations
02	2 stations
:	:
16	16 stations

Note) The maximum number of stations is determined by the total number of solenoids.  
For mixed single and double wirings, enter "K" to the order code options.

Standard station	Max. number of stations for special wiring specifications	Max. number of solenoids
1 to 8 stations	16 stations	16

Actuation type	Single	Double, Dual 3-port
Number of solenoids	1	2

Refer to the **WEB catalog** for details on the EX510 Gateway-type Serial Transmission System.

Option

Symbol	Specifications
Nil	None
K <sup>Note 2)</sup>	Special wiring specifications (Except double wiring)
R <sup>Note 3)</sup>	External pilot

Note 1) When two or more options are specified, indicate them alphabetically. Example) -KR  
Note 2) Indicate the wiring specifications for mixed single and double wirings.  
Note 3) For details, refer to page 497.  
\* For manifold optional parts, refer to pages 497 to 498.

P, R port thread type

Symbol	Manifold pitch
Nil	8.5
F	Rc (PT)
N	G (PF)
T	NPT

Cylinder port size

Symbol	Port size	
M5	M5 thread	Metric
C2	With ø2 One-touch fitting	
C3	With ø3.2 One-touch fitting	
C4	With ø4 One-touch fitting	
CM	Mixed sizes and with port plug <sup>Note)</sup>	Inch
N1	With ø1/8" One-touch fitting	
N3	With ø5/32" One-touch fitting	
NM	Mixed sizes and with port plug <sup>Note)</sup>	

Note) Specify "Mixed sizes and with port plug" on the manifold specification sheet.

## How to Order Valve

10-S07 1 5 [ ] - 5 MO

Clean series

Actuation type

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423

Electrical entry

M-type plug connector, without lead wire  
(Light/surge voltage suppressor)

Voltage: 24 VDC

Function

Symbol	Specifications
Nil	Standard
R	External pilot <sup>Note)</sup>

Note) Not compatible with dual 3-port valves.  
The 3(R) port is released to the atmosphere.  
(Pressurization and vacuum are not allowed.)

Base mounted plug lead

## How to Order Manifold Assembly

Specify the part numbers for valves and options together beneath the manifold base part number.

<Example>

Serial transmission kit


10-SS0755-SA08C4... 1 set - Manifold base part no.

≒ 10-S0715-5MO ..... 3 sets - Valve part no. (Stations 1 to 3)

≒ 10-S0725-5MO ..... 3 sets - Valve part no. (Stations 4 to 6)

≒ 10-S07A5-5MO ..... 2 sets - Valve part no. (Stations 7 to 8)




Prefix the asterisk to the part no. of the solenoid valve, etc.  
Write sequentially from the 1st station on the D side. When part no. written collectively are complicated, specify on the manifold specification sheet.  
The connector assembly lead wire length used for EX510 manifold varies depending on the number of stations.



Therefore, solenoid valves (including a blanking plate) and connector assembly are shipped as a standard specification. Please specify the mounting solenoid valve when ordering.

## 10-SS0755

### S kit (Serial transmission: EX510)

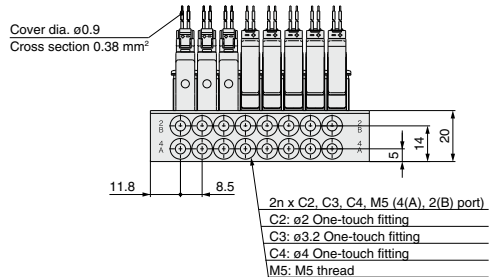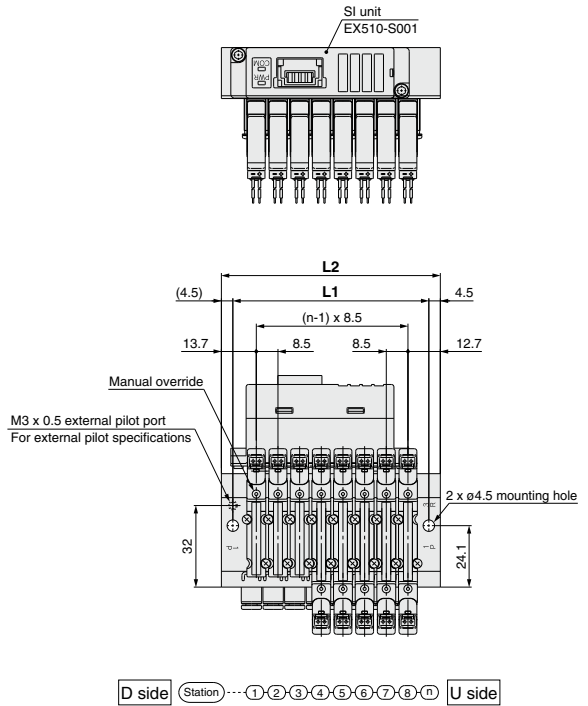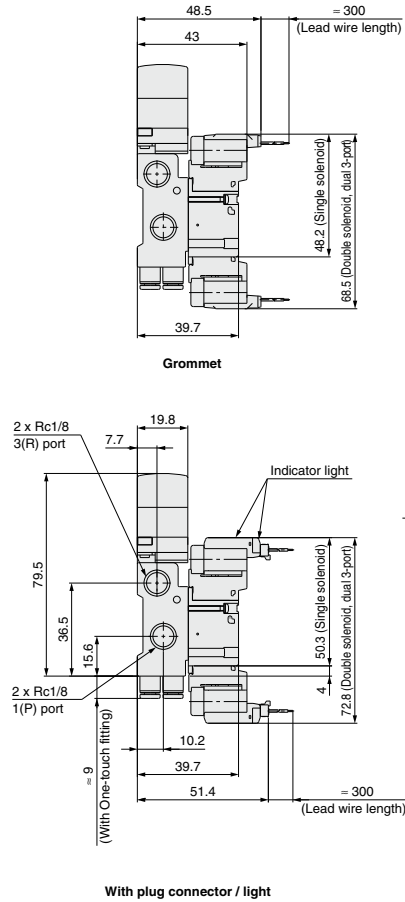

#### Dimensions

L	n	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
L1		68.4	68.4	68.4	68.4	68.4	68.4	76.9	85.4	93.9	102.4	110.9	119.4	127.9	136.4	144.9
L2		77.4	77.4	77.4	77.4	77.4	77.4	85.9	94.4	102.9	111.4	119.9	128.4	136.9	145.4	153.9

# Series 10-S0700 Plug Lead Manifold Bar Base


## Manifold Optional Parts

### Blanking plate assembly

#### SS0700-10A-5

It is used by attaching on the manifold block for being prepared for removing a valve for maintenance reasons or planning to mount a spare valve, etc.

Weight: 21 g

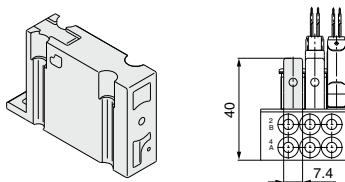

### Individual SUP spacer

#### SS0700-P-5-M5


Port size

M5 M5 thread

Mounted on the manifold block to make an independent supply port when each solenoid valve uses different operating pressure.

Weight: 7 g

\* Compatible with 8.5 mm pitch manifold only.

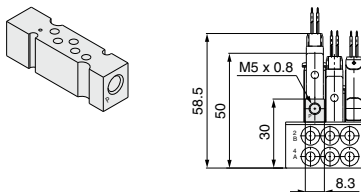

### Individual EXH spacer

#### SS0700-R-5-M5


Port size

M5 M5 thread

Mounted on the manifold block to make an independent exhaust port when the exhaust from one valve affects valves on other stations in the air circuit.

Weight: 7 g

\* Compatible with 8.5 mm pitch manifold only.

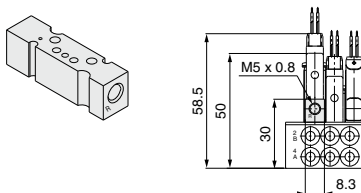


### Port plug

#### VVQ0000-CP

The plug is used to block the cylinder port when using a 5-port valve as a 3-port valve.

\* When ordering a plug incorporated with a manifold, indicate "CM" for the port size in the manifold no., as well as, the mounting position and number of stations and cylinder port mounting positions, A and B, on the manifold specification sheet.

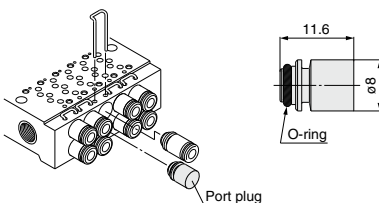

### External pilot [-R]

This can be used when the air pressure is 0.1 to 0.2 MPa lower than the minimum operating pressure of the solenoid valves or used for vacuum specifications.

Add R to the part numbers of manifolds and valves to indicate the external pilot specifications.

An M5 port will be installed on the top side of the manifold's SUP/EXH block.

● How to Order Valve (Example)

10-S0715 B -5G

External pilot


● How to Order Manifold (Example)

\* Indicate -R for an option.

10-SS0755-08C4C-B

External pilot

External pilot port  
(M3 x 0.5)



Note 1) The dual 3-port valve is not available.

Note 2) When the internal pilot type and external pilot type of valves are mixed up on the manifold, order the manifold suitable for the specifications of the external pilot valve.

Note 3) Since the pilot EXH of valves with the external pilot specification also has a common exhaust specification, the 3(R) port should be released to the atmosphere.



Blanking plug (For One-touch fittings)

KJP-02

23

KQ2P-04

06



Dimensions

(mm)

Applicable fitting size $\phi d$	Model	A	L	D	Weight (g)
2	KJP-02	8.2	17	3	0.1
3.2	KQ2P-23	16	31.5	3.2	1
4	KQ2P-04	16	32	6	1
6	KQ2P-06	18	35	8	1

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment


Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

# Series 10-S0700

5 Port Solenoid Valve:  
Base Mounted  
Plug Lead, Single Unit

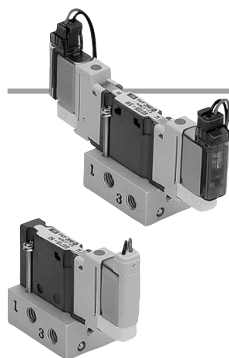

## How to Order Valve

10-S07 1 5   - 5 G - M5

• Clean series

### Actuation type

Symbol	Specifications
1	2-position single
2	2-position double
A	4-position dual 3-port (N.C. + N.C.) [Exhaust center]
B	4-position dual 3-port (N.O. + N.O.) [Pressure center]
C	4-position dual 3-port (N.C. + N.O.)

Note) For symbol, refer to page 423.

• Plug lead

### Function

Symbol	Specifications
Nil	Standard
R	External pilot <small>Note)</small>

Note) Not compatible with dual 3-port valves.

### Sub-plate

Symbol	Specifications
Nil	Without sub-plate
M5	With sub-plate

### Electrical entry

Symbol	Specifications	Configuration
G	Grommet	
M	M-type plug connector, with lead wire (With light/surge voltage suppressor)	
MO	M-type plug connector, without lead wire (With light/surge voltage suppressor)	


### Voltage

Symbol	Specifications
5	24 VDC
6	12 VDC

## Dimensions


### 2-Position Single

Grommet (G): 10-S0715(R)-□G-M5

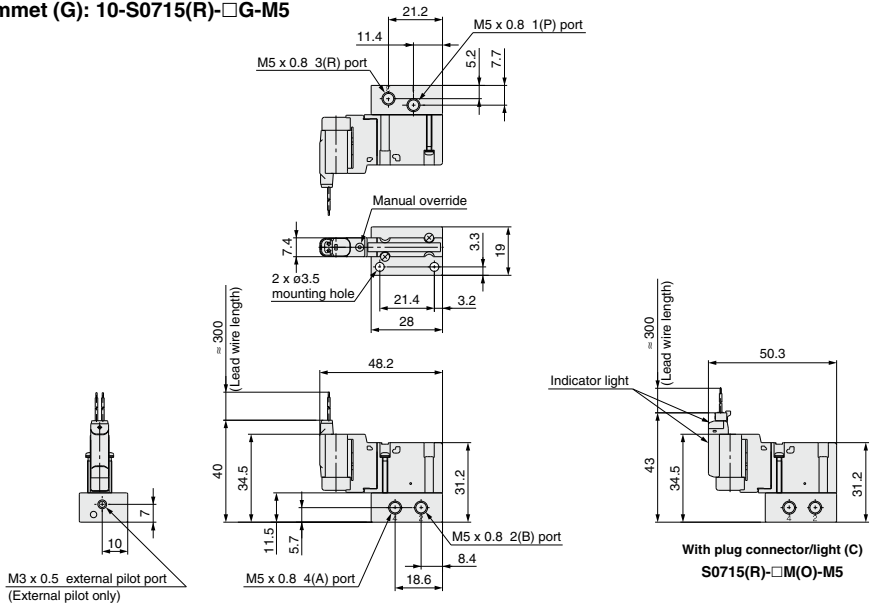


### 2-Position Double/4-Position Dual 3-Port

Grommet (G): 10-S07<sup>2</sup><sub>5</sub>(R)-□G-M5

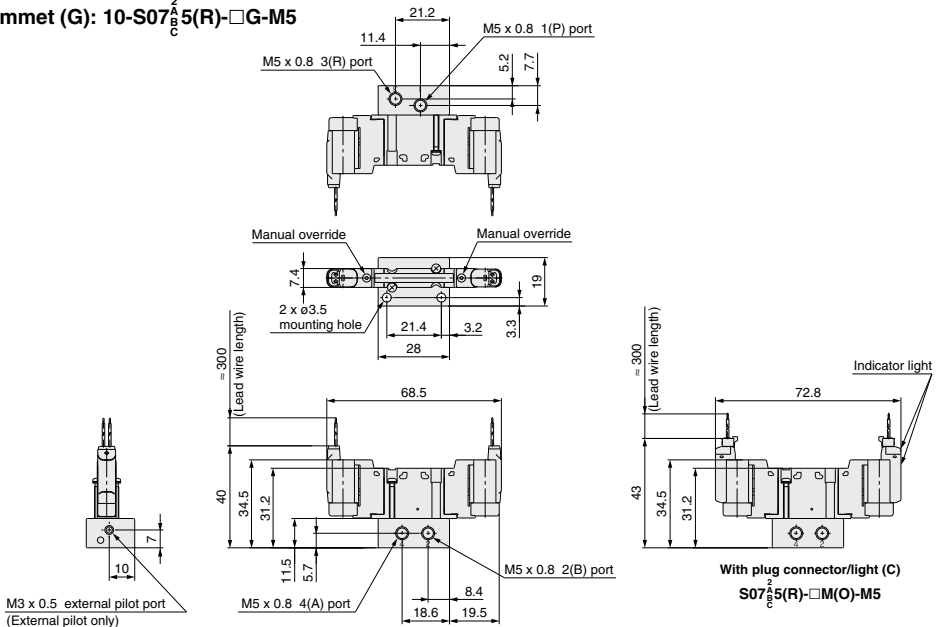


# **Series 10-S0700** Plug Lead Single Unit **Construction: Main Parts/Replacement Parts**


## 2-Position Single

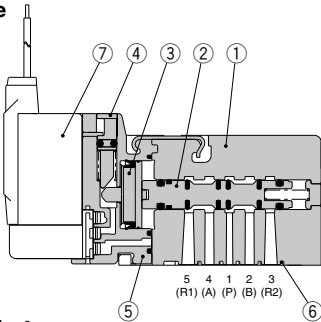

## 2-Position Double

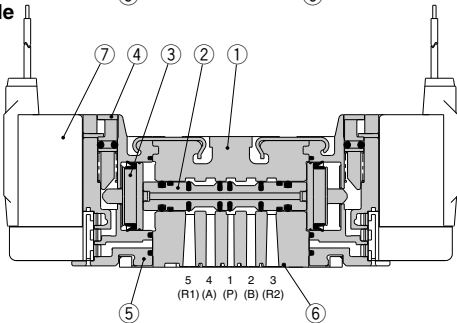

## 4-Position Dual 3-Port Valve

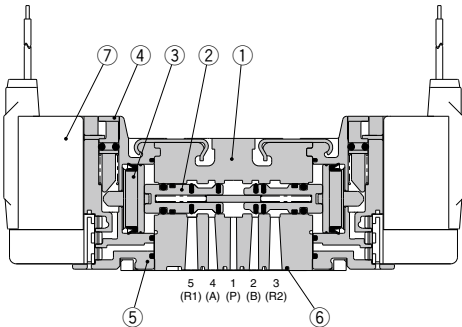

### <Pilot Valve Assembly Part No.>

S070P—5 B G -1


Voltage	
Symbol	Specifications
5	24 VDC
6	12 VDC

Accessory	
Symbol	Specifications
Nil	None
-1	Stopper plate is included.


Electrical entry	
Symbol	Specifications
G	Grommet
C	Plug connector, with lead wire (With light/surge voltage suppressor)
CO	Plug connector, without lead wire (With light/surge voltage suppressor)

Note) For pilot valve assembly replacement, refer to the Specific Product Precautions 3.


S0715




S0725




S07A5



S07B5



S07C5



### Component Parts

No.	Description	Material
1	Body	Zinc die-casted
2	Spool	Aluminum
3	Piston	Resin
4	Manual override	Resin
5	Adapter plate	Resin
6	Interface gasket	HNBR

### Replacement Parts

No.	Description	Material
7	Pilot valve assembly	—

Note) For pilot valve assembly replacement, refer to the Specific Product Precautions 3.

# Series 10-S0700

## Plug Lead

# Replacement Parts

### <One-touch Fitting Assembly (For Cylinder Port)>

Manifold pitch	Port size	Part no.
8.5	ø2 One-touch fitting	VVQ0000-50A-C2
	ø3.2 One-touch fitting	VVQ0000-50A-C3
	ø4 One-touch fitting	VVQ0000-50A-C4
	ø1/8" One-touch fitting	VVQ0000-50A-N1
	ø5/32" One-touch fitting	VVQ0000-50A-N3
7.5	ø2 barb fitting	SS070-50A-20
	ø3.2 barb fitting	SS070-50A-32
	ø4 barb fitting	SS070-50A-40

Note) Purchase orders are available in units of 10 pieces.

### <Plug Connector Assembly>

S070-14A-□

#### Lead wire length

Symbol	Length
Nil	150 mm
3	300 mm
6	600 mm
10	1000 mm

Note) Standard wire length of valve with plug connector is 300 mm. When ordering a lead wire length of 600 mm or longer, list the part numbers for the valve without connector and the connector assembly.

### <Pilot Valve Assembly>

10-S070P-□5□B□G□-1

#### Voltage

Symbol	Specifications
5	24 VDC
6	12 VDC

#### Accessory

Symbol	Specifications
Nil	None
-1	Stopper plate is included.

#### Electrical entry

Symbol	Specifications
G	Grommet
C	Plug connector, with lead wire (With light/surge voltage suppressor)
CO	Plug connector, without lead wire (With light/surge voltage suppressor)

Note) For pilot valve assembly replacement, refer to the Specific Product Precautions 3.

### <Gasket, Screw Assembly>

Part no.
S0700-GS-5

Note) Above part number consists of 10 units.  
Each unit has one gasket and two screws.

### <Sub-plate>

Part no.
S0700-S-M5

### <SI Unit (Series EX510)>

EX510-S□0□1

#### Output specifications

0	NPN output (+COM.)
1	PNP output (-COM.)

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors





## Series 10-S0700

# Specific Product Precautions 1

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

### Manual Override


#### Warning

The manual override is used for switching the main valve.


#### Push type (Tool required)

Push down on the manual override button with a small screwdriver until it stops.

#### Plug-in



#### Plug lead




### How to Attach/Detach Plug Connector

#### <Plug lead type only>

To attach a connector, hold the lever and connector unit between your fingers and insert straight onto the pins of the solenoid valve so that the lever's pawl is pushed into the groove and locks.

To detach a connector, remove the pawl from the groove by pushing the lever downward with your thumb, and pull the connector straight out.

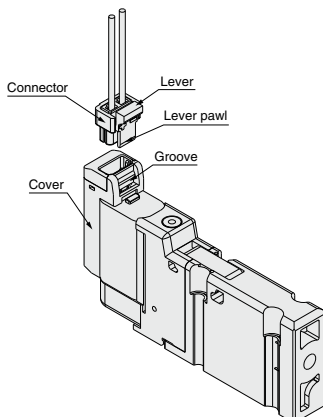

Note) In order not to damage the connector and cover, do not pull the lead wire excessively (with a force of 10 N or more).

### How to Mount Valve


#### Caution

Tighten the bolts firmly to stop the gasket from coming away from the valve using the appropriate torque as shown on the following table.


Proper tightening torque N·m

0.17 to 0.23

#### Plug-in

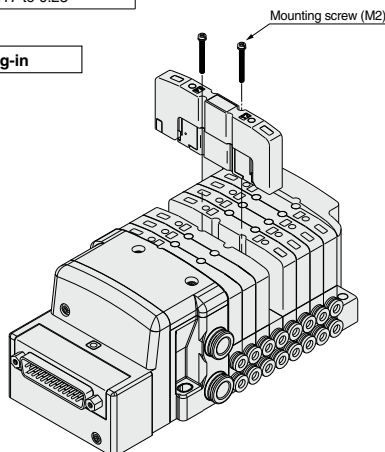

#### Plug lead

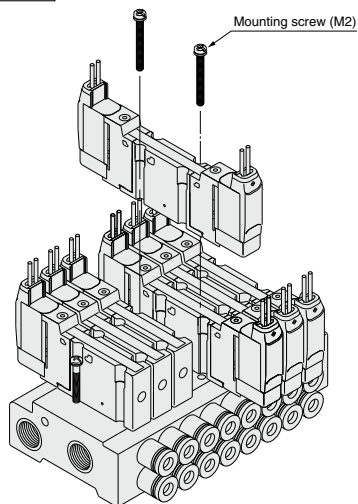



# Series 10-S0700

## Specific Product Precautions 2

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.


### How to Mount/Remove DIN Rail

#### ⚠ Caution

##### Plug-in


##### Removal

- 1) Loosen the clamping screw of the end plate on both sides.
- 2) Lift side (a) of the manifold base and slide the end plate in the direction of ② shown in the figure to remove.

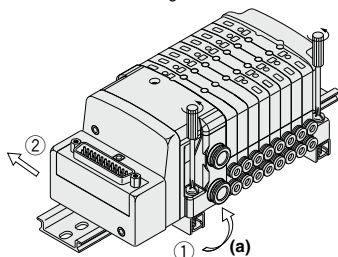

##### Mounting

- 1) Hook side (b) of the manifold base on the DIN rail.
- 2) Press down side (a) and mount the end plate on the DIN rail. Tighten the clamping screw on side (a) of the end plate. The proper tightening torque for screws is 0.4 to 0.6 N·m.

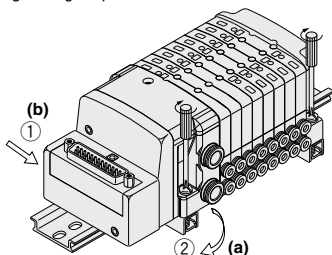


### How to Change Connector Entry Direction

#### ⚠ Caution

##### <Plug-in manifold stacking base>

The connector entry direction can be changed from the top to the side by simply pressing the manual release button.

It is not necessary to use the manual release button when switching from the side to the top.

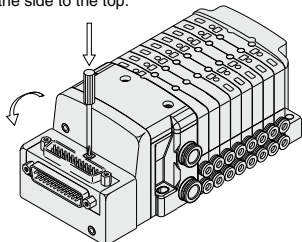


### How to Replace Cylinder Port Fittings

#### ⚠ Warning

The cylinder port fittings are a cassette for easy replacement. The fittings are blocked by a clip inserted from the top of the valve.

Remove the clip with a flat blade screwdriver to remove fittings. For replacement, insert the fitting assembly until it strikes against the inside wall and then re-insert the clip to the specified position.

##### Plug-in




Applicable tubing O.D.	One-touch fitting part no.
Applicable tubing ø2	VVQ0000-50A-C2
Applicable tubing ø3.2	VVQ0000-50A-C3
Applicable tubing ø4	VVQ0000-50A-C4
Applicable tubing ø1/8"	VVQ0000-50A-N1
Applicable tubing ø5/32"	VVQ0000-50A-N3

\* Part number is for one fitting assembly.

\* Please order it in units of 10 pieces.

##### Plug lead

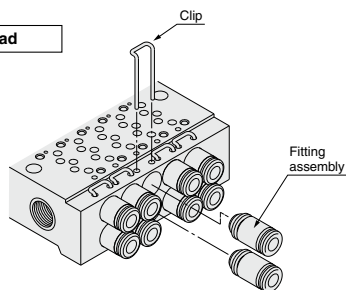

	Applicable tubing O.D.	Fitting part no.
8.5 mm pitch (One-touch fitting)	Applicable tubing ø2	VVQ0000-50A-C2
	Applicable tubing ø3.2	VVQ0000-50A-C3
	Applicable tubing ø4	VVQ0000-50A-C4
	Applicable tubing ø1/8"	VVQ0000-50A-N1
7.5 mm pitch (Barb fitting)	Applicable tubing ø5/32"	VVQ0000-50A-N3
	Barb fitting ø2	SS070-50A-20
	Barb fitting ø3.2	SS070-50A-32
	Barb fitting ø4	SS070-50A-40

\* Part number is for one fitting assembly.

Please order it in units of 10 pieces.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors



## Series 10-S0700

# Specific Product Precautions 3

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.


### Internal Wiring Specifications

#### ⚠ Caution


Light/surge voltage suppressor

No polarity by adopting non-polar light.

#### Plug-in Single/All plug lead types



#### Plug-in Double, Dual 3-port




Note) Coil surge voltage generated when OFF is about -60 V. Please contact SMC separately for further suppression of the coil surge voltage.


#### Plug-in

##### Slim type plug-in manifold


A: Red  
B: Green



##### Plug-in manifold



#### Plug lead manifold

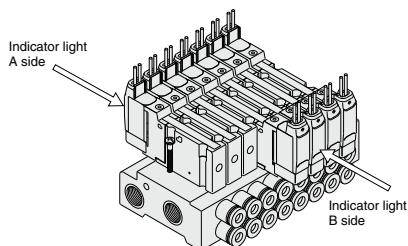

### Surge Voltage Intrusion

#### ⚠ Caution

The surge voltage created when the power supply is cut off could apply to the de-energized load equipment through the output circuit. In cases where the energized load equipment has a larger capacity (power consumption) and is connected to the same power supply as the product, the surge voltage could malfunction and/or damage the internal circuit element of the product and the internal device of the output equipment. To avoid this situation, place a diode which can suppress the surge voltage between the COM lines of the load equipment and output equipment.

### How to Replace Pilot Valve

#### ⚠ Caution


##### <Plug lead>

##### Removal

- 1) Remove the stopper plate from the adapter plate assembly by using a flat blade screwdriver on the concave of the stopper plate.
- 2) Take off the pilot valve in horizontal direction.

##### Mounting

- 1) Mount the pilot valve on the adapter plate assembly.
- 2) Insert the stopper plate into the adapter plate so that the stopper plate will not protrude from the end of the adapter plate.

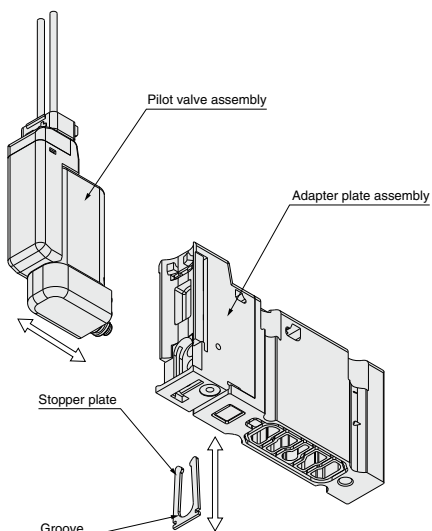



## Series 10-S0700

# Specific Product Precautions 4

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX500/EX250/EX260

## Warning

1. These products are intended for use in general factory automation equipment.

Avoid using these products in machinery/equipment which affects human safety, and in cases where malfunction or failure can result in extensive damage.

2. Do not use in an explosive atmosphere, environment with inflammable gases, or corrosive atmosphere. This can cause injury or fire, etc.
3. Work such as transporting, installing, piping, wiring, operation, control and maintenance should be performed by personnel with specialized knowledge. There is a danger of electrocution, injury or fire, etc.
4. Install an external emergency stop circuit that can promptly stop operation and shut off the power supply.
5. Do not remodel these products, as there is a danger of injury and damage.

## Caution

1. Read the operation manual carefully, strictly observe the precautions and operate within the range of the specifications.
2. Do not drop these products or submit them to strong impacts. This can cause damage, failure or malfunction, etc.
3. In locations with poor electrical conditions, take steps to ensure a steady flow of the rated power supply. Use of a voltage outside of the specifications can cause malfunction, damage to the unit, electrocution or fire, etc.
4. Do not touch connector terminals or internal substrates when current is being supplied. There is a danger of malfunction, damage to the unit or electrocution if connector terminals or internal substrates are touched when current is being supplied.

Be sure that the power supply is OFF when adding or removing manifold valves or input blocks, etc., or when connecting or disconnecting connectors.

5. Operate at an ambient temperature that is within the specifications. Even when the ambient temperature range is within the specifications, do not use in locations where there are rapid temperature changes.
6. Keep wire scraps and other extraneous material from getting inside these products. This can cause fire, failure or malfunction, etc.
7. This product is not constructed to withstand water or oil penetration. Therefore it should be fitted with a protective cover when used in environments where it could be exposed to water or oil splash.
8. Observe the proper tightening torque.

There is a possibility of damaging threads if tightening exceeds the tightening torque range.

### 9. Adjustment/Operation

DIP switches and rotary switches should be set with a small watchmakers' screwdriver.

## Caution

10. Provide adequate protection when operating in locations such as the following:
  - Where noise is generated by static electricity, etc.
  - Where there is a strong electric field
  - Where there is a danger of exposure to radiation
  - When in close proximity to power supply lines
11. When these products are installed in equipment, provide adequate protection against noise by using noise filters, etc.
12. Since these products are components that are used after installation in other equipment, the customer should confirm conformity to EMC directives for the finished product.
13. Do not remove the name plate.
14. Perform periodic inspections and confirm normal operation. It may otherwise be impossible to guarantee safety due to unexpected malfunction or erroneous operation.

### Safety Instructions on Power Supply

## Caution

1. Operation is possible with a single power supply or a separate power supply. However, be sure to provide two wiring systems (one for solenoid valves, and one for input and control units).

2. Use the following UL approved products for DC power supply combinations.

- 1) Controlled voltage current circuit conforming to UL508  
Circuit uses the secondary coil of an isolated transformer as the power supply, satisfying the following conditions.
  - Max. voltage (with no load): 30 Vrms (42.4 V peak) or less
  - Max. current: (1) 8 A or less (including shorts), and
- (2) When controlled by a circuit protector (fuse, etc.) with the following rating

No-load voltage (V peak)	Max. current rating
0 to 20 [V]	5.0
Over 20 [V] to 30 [V]	100
Peak voltage value	

- 2) A circuit (class 2 circuit) with maximum 30 Vrms (42.4 V peak) or less, and a power supply consisting of a class 2 power supply unit conforming to UL1310, or a class 2 transformer conforming to UL1585

Directional  
Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation  
Equipment

Modular F. R.

Pressure Control  
Equipment

Fittings & Tubing

Flow Control  
Equipment

Pressure Switches/  
Pressure Sensors



## Series 10-S0700

# Specific Product Precautions 5

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX500/EX250

### Safety Instructions on Cable

## ⚠ Caution

1. Be careful of miswiring. This can cause malfunction, damage and fire in the unit.
2. Do not connect cables during energizing.  
This could damage or cause malfunction to the SI unit.
3. To prevent noise and surge in signal lines, keep all wiring separate from power lines and high voltage lines. Otherwise, this can cause malfunction.
4. Check wiring insulation, as defective insulation can cause damage to the unit due to excessive voltage or current.
5. Do not bend or pull cables repeatedly, and do not place heavy objects on them or allow them to be pinched. This can cause broken lines.

EX510

### Design/Selection


## ⚠ Warning

1. Use within the allowable voltage range.  
Using beyond the allowable voltage range is likely to cause the units and connecting devices to be damaged or to malfunction.
2. Do not use beyond the specification range.  
Using beyond the specification range is likely to cause a fire, malfunction, or breakdown in the units and connecting devices. Check the specifications before handling.
3. Establish a backup system beforehand, which employs fail-safe concepts such as multiple equipment and devices to prevent breakage or malfunction of this product.
4. Provide an external emergency stop circuit that will immediately stop an operation and cut off the power supply.
5. When using for an interlock circuit:
  - Provide a double interlock which is operated by another system (such mechanical protection function).
  - Perform an inspection to check that it is working properly because it can cause possible injuries.

## ⚠ Caution

1. Keep the surrounding space free for maintenance.  
When designing a system, take into consideration the amount of free space needed for performing maintenance.
  2. Use the following UL approved products for DC power supply combinations.
    - 1) Controlled voltage current circuit conforming to UL508  
Circuit uses the secondary coil of an isolated transformer as the power supply, satisfying the following conditions.
      - Max. voltage (with no load): 30 Vrms (42.4 V peak) or less
      - Max. current: (1) 8 A or less (including shorts), and
    - (2) When controlled by a circuit protector (fuse, etc.) with the following rating
  - 2) A circuit (class 2 circuit) with maximum 30 Vrms (42.4 V peak) or less, and a power supply consisting of a class 2 power supply unit conforming to UL1310, or a class 2 transformer conforming to UL1585
3. This product is one of the components to be equipped into a final equipment. Confirm the adaptability to the EMC directive as the whole equipment by customers themselves.
  4. The power supply for the Gateway unit should be 0 V as the standard for both power supply for outputs as well as inputs and for the control unit of the Gateway.

No-load voltage (V peak)	Max. current rating
0 to 20 [V]	5.0
Over 20 [V] to 30 [V]	100
	Peak voltage value

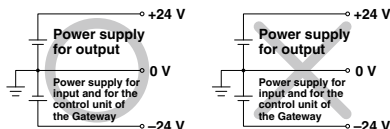



## Series 10-S0700

# Specific Product Precautions 6

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX510

### Mounting

#### ⚠ Caution

- 1. Do not drop, bump, or apply excessive impact.**  
Otherwise, the unit can become damaged, malfunction, or fail to function.
- 2. Hold the body while handling this product.**  
Otherwise, the unit can become damaged, malfunction, or fail to function.
- 3. Observe the tightening torque range.**  
Tightening outside of the allowable torque range will likely damage the product.
- 4. Do not install a unit in a place where it can be used as a scaffold.**  
Applying any excessive load such as stepping on the unit by mistake or placing a foot on it, will cause it to break.

### Wiring

#### ⚠ Warning

- 1. Avoid miswiring.**  
If miswired, there is a probability of damaging units or connecting devices.
- 2. Do not wire while energizing the product.**  
It is likely to damage the units or connecting devices.
- 3. Avoid wiring the power line and high pressure line in parallel.**  
Noise or surge produced by signal line resulting from the power line or high pressure line could cause a malfunction. Wiring of the reduced wiring system and the power line or high pressure line should be separated from each other.
- 4. Check the wiring insulation.**  
Inferior insulation (contact with other circuit, insulation between terminals, etc.) will likely cause damage to the units or connecting devices due to excessive voltage or the influx of current.

#### ⚠ Caution

- 1. Take measures to avoid applying repeated bending force or pulling force to the cable.**  
Also, pay attention not to place any heavy matter on the cable or clipping. It is likely to cause a broken wire.
- 2. Check the grounding to maintain the safety of the reduced wiring system and for anti-noise performance.**  
Grounding should be close to units and keep the grounding distance short.

### Operating Environment

#### ⚠ Warning

- 1. Do not use this product in the presence of dust, particles, water, chemicals, and oil.**  
Use with such materials is likely to cause a malfunction or breakage.
- 2. Do not use this product in the presence of a magnetic field.**  
Use in such an environment is likely to cause a malfunction.
- 3. Do not use this product in an atmosphere containing an inflammable gas, explosive gas, or corrosive gas.**  
Use in such an atmosphere is likely to cause a fire, explosion, or corrosion. This wire-reduced system is not explosion-proof.
- 4. Do not use this product in places where there are cyclic temperature changes.**  
In case that the cyclic temperature is beyond normal temperature changes, the internal unit is likely to be adversely affected.
- 5. Do not use this product in places where there is radiated heat around it.**  
Such a place is likely to cause a malfunction or breakage.
- 6. Do not use this product near sources that generate a surge which exceeds the benchmark test, even though this product is CE-marked certified.**  
The internal circuit components are likely to deteriorate or become damaged when there are equipment (solenoid type lifter, high frequency guided furnace, motor, etc.) which generate a large surge around the reduced wiring system. Take measures to prevent an electrical surge and avoid having the wires touch each other.
- 7. Use the product type that has an integrated surge absorption element when directly driving a load which generates surge voltage by relay or solenoid valves.**
- 8. The reduced wiring system should be installed in places with no vibration or shock.**  
Such a place is likely to cause a malfunction or breakage.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment

Pressure Switches/ Pressure Sensors



## Series 10-S0700

# Specific Product Precautions 7

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX510

### Adjustment/Operation

#### Warning

**1. Do not short-circuit a load.**

If a load is short-circuited, excessive current can cause damage to the connected devices. The fuse of the input unit will melt. The output and SI unit will activate its overcurrent protection function. However, they cannot cover all modes, so damage is likely to occur.

**2. Do not manipulate or perform settings with wet hands.**

Performing such activity will likely cause an electrical shock.

#### Caution

**1. DIP switches and rotary switches should be set with a small watchmakers' screwdriver.**

### Maintenance

#### Warning

**1. Do not disassemble, modify (including circuit board replacement) or repair this product.**

Such actions are likely to cause injuries or breakage.

**2. Perform periodic inspection.**

Confirm that wiring or screws are not loose.

Otherwise, unpredicted malfunction in the system composition devices is likely to occur.

**3. When an inspection is performed.**

- Turn off the power supply.
- Stop the supplied fluid and discharge the fluid in the piping and confirm the release to the atmosphere before performing an inspection. It is likely to cause injuries.

#### Caution

**1. Do not wipe this product with chemicals such as benzene or thinner.**

Using such chemicals is likely to cause damage.



## Series 10-S0700

# Specific Product Precautions 8

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX600

## Design/Selection

### Warning


- Use this product within the specification range.**  
Using beyond the specified specifications range can cause fire, malfunction, or damage to the system.  
Check the specifications when operating.
- When using for an interlock circuit:**
  - Provide a multiple interlock system which is operated by another system (such as mechanical protection function).
  - Perform an inspection to confirm that it is working properly. This may cause possible injury due to malfunction.

### Caution

- Use the following UL approved products for DC power supply combinations.**
  - Controlled voltage current circuit conforming to UL508  
Circuit uses the secondary coil of an isolated transformer as the power supply, satisfying the following conditions.
    - Max. voltage (with no load): 30 Vrms (42.4 V peak) or less
    - Max. current: (1) 8 A or less (including shorts), and (2) When controlled by a circuit protector (fuse, etc.) with the following rating

No-load voltage (V peak)	Max. current rating
0 to 20 [V]	5.0
Over 20 [V] to 30 [V]	100
	Peak voltage value

- 2) A circuit (class 2 circuit) with maximum 30 Vrms (42.4 V peak) or less, and a power supply consisting of a class 2 power supply unit conforming to UL1310, or a class 2 transformer conforming to UL1585
- Use this product within the specified voltage range.**  
Using beyond the specified voltage range is likely to cause the units and connecting devices to be damaged or to malfunction.
- The power supply for the unit should be 0 V as the standard for both power supply for output as well as power supply for control/input.**



- Do not install a unit in a place where it can be used as a foothold.**  
Applying any excessive load such as stepping on the unit by mistake or placing a foot on it, will cause it to break.
- Keep the surrounding space free for maintenance.**  
When designing a system, take into consideration the amount of free space needed for performing maintenance.
- Do not remove the name plate.**  
Improper maintenance or incorrect use of operation manual can cause failure and malfunction. Also, there is a risk of losing conformity with safety standards.
- Beware of inrush current when the power supply is turned on.**  
Some connected loads can apply an initial charge current which will trigger the over current protection function, causing the unit to malfunction.

## Mounting

### Caution

- When handling and assembling units:**
  - Do not touch the sharp metal parts of the connector or plug.**
  - Do not apply excessive force to the unit when disassembling.**  
The connecting portions of the unit are firmly joined with seals.
  - When joining units, take care not to get fingers caught between units.**  
Injury can result.
- Do not drop, bump, or apply excessive impact.**  
Otherwise, the unit can become damaged, malfunction, or fail to function.
- Observe the tightening torque range.**  
Tightening outside of the allowable torque range will likely damage the product.  
IP67 protection class cannot be guaranteed if the screws are not tightened to the specified torque.
- When lifting a large size manifold solenoid valve unit, take care to avoid causing stress to the valve connection joint.**  
The connection parts of the unit may be damaged. Because the unit may be heavy, carrying and installation should be performed by more than one operator to avoid strain or injury.
- When placing a manifold, mount it on a flat surface.**  
Torsion in the whole manifold can lead to trouble such as air leakage or defective insulation.

## Wiring

### Caution

- Check the grounding to maintain the safety of the reduced wiring system and for anti-noise performance.**  
Provide a specific grounding as close to the unit as possible to minimize the distance to grounding.
- Avoid repeatedly bending or stretching the cable and applying a heavy object or force to it.**  
Wiring applying repeated bending and tensile stress to the cable can break the circuit.
- Avoid miswiring.**  
If miswired, there is a danger of malfunction or damage to the reduced wiring system.
- Do not wire while energizing the product.**  
There is a danger of malfunction or damage to the reduced wiring system or input/output equipment.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors





## Series 10-S0700

# Specific Product Precautions 9

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX600

### Wiring

#### Caution

**5. Avoid wiring the power line and high pressure line in parallel.**

Noise or surge produced by signal line resulting from the power line or high pressure line could cause malfunction.

Wiring of the reduced wiring system or input/output device and the power line or high pressure line should be separated from each other.

**6. Check the wiring insulation.**

Defective insulation (contact with other circuits, improper insulation between terminals, etc.) may cause damage to the reduced wiring system or input/output device due to excessive voltage or current.

**7. When a reduced wiring system is installed in machinery/equipment, provide adequate protection against noise by using noise filters, etc.**

Noise in signal lines may cause a malfunction.

**8. When connecting wires of input/output device or handheld terminal, prevent water, solvent or oil from entering inside from the connector section.**

This can cause damage, equipment failure or malfunction.

**9. Avoid wiring patterns in which excessive stress is applied to the connector.**

This may cause malfunction or damage to the unit due to contact failure.

### Operating Environment

#### Warning

**1. Do not use in an atmosphere containing an inflammable gas or explosive gas.**

Use in such an atmosphere is likely to cause a fire or explosion. This system is not explosion-proof.

#### Caution

**1. Select the proper type of enclosure according to the environment of operation.**

IP65/67 is achieved when the following conditions are met.

1) Provide appropriate wiring between all units using electrical wiring cables, communication connectors and cables with M12 connectors.

2) Suitable mounting of each unit and manifold valve.

3) Be sure to mount a seal cap on any unused connectors.

If using in an environment that is exposed to water splashes, please take measures such as using a cover.

Also, the Handheld Terminal conforms to IP20, so prevent foreign matter from entering inside, and water, solvent or oil from coming in direct contact with it.

### Operating Environment

#### Caution

**2. Provide adequate protection when operating in locations such as the following.**

Failure to do so may cause damage or malfunction.

The effect of countermeasures should be checked in individual equipment and machine.

1) Where noise is generated by static electricity, etc.

2) Where there is a strong electric field

3) Where there is a danger of exposure to radiation

4) When in close proximity to power supply lines

**3. Do not use in an environment where oil and chemicals are used.**

Operating in environments with coolants, cleaning solvents, various oils or chemicals may cause adverse effects (damage, malfunction) to the unit even in a short period of time.

**4. Do not use in an environment where the product could be exposed to corrosive gas or liquid.**

This may damage the unit and cause it to malfunction.

**5. Do not use in locations with sources of surge generation.**

Installation of the unit in an area around the equipment (electromagnetic lifters, high frequency induction furnaces, welding machine, motors etc.), which generates the large surge voltage could cause to deteriorate an internal circuitry element of the unit or result in damage. Implement countermeasures against the surge from the generating source, and avoid touching the lines with each other.

**6. Use the product type that has an integrated surge absorption element when directly driving a load which generates surge voltage by relay, solenoid valves or lamp.**

When a surge generating load is directly driven, the unit may be damaged.

**7. The product is CE marked, but not immune to lightning strikes. Take measures against lightning strikes in your system.**

**8. Keep dust, wire scraps and other extraneous material from getting inside the product.**

This may cause a malfunction or damage.

**9. Mount the unit in such locations, where no vibration or shock is affected.**

This may cause a malfunction or damage.

**10. Do not use in places where there are cyclic temperature changes.**

In case that the cyclic temperature is beyond normal temperature changes, the internal unit is likely to be adversely effected.

**11. Do not use in direct sunlight.**

Do not use in direct sunlight. It may cause a malfunction or damage.

**12. Use this product within the specified ambient temperature range.**

This may cause a malfunction.

**13. Do not use in places where there is radiated heat around it.**

Such a place is likely to cause a malfunction.



# Series 10-S0700

## Specific Product Precautions 10

Be sure to read this before handling.

Refer to page 1382 for Safety Instructions and pages 677 to 683 for 3/4/5 Port Solenoid Valve Precautions.

EX600

### Adjustment/Operation

#### ⚠ Warning

1. **Do not perform operation or setting with wet hands.**  
There is a risk of electrical shock.

##### <Handheld Terminal>

2. **Do not apply pressure to the LCD.**  
There is a possibility of the crack of LCD and injuring.
3. **The forced input/output function is used to change the signal status forcibly. When operating this function, be sure to check the safety of the surroundings and installation.**  
Otherwise, injury or equipment damage could result.
4. **Incorrect setting of parameters can cause malfunction. Be sure to check the settings before use.**  
This may cause injury or equipment damage.


#### ⚠ Caution

1. **Use a watchmakers' screwdriver with thin blade for the setting of each switch of the SI unit.**  
**When setting the switch, do not touch other unrelated parts.**  
This may cause parts damage or malfunction due to a short-circuit.
2. **Provide adequate setting for the operating conditions.**  
Failure to do so could result in malfunction.  
Refer to the operation manual for setting of the switches.
3. **For details on programming and address setting, refer to the manual from the PLC manufacturer.**  
The content of programming related to protocol is designed by the manufacturer of the PLC used.

##### <Handheld Terminal>

4. **Do not press the setting buttons with a sharp pointed object.**  
This may cause damage or malfunction.
5. **Do not apply excessive load and impact to the setting buttons.**  
This may cause damage, equipment failure or malfunction.

When the order does not include the SI unit, the valve plate to connect the manifold and SI unit is not mounted. Use attached valve fixing screws and mount the valve plate.  
(Tightening torque: 0.6 to 0.7 N·m)

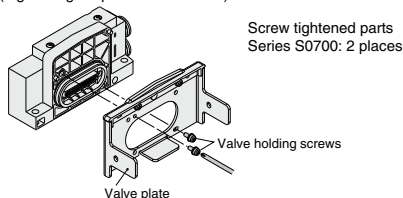

### Maintenance

#### ⚠ Warning

1. **Do not disassemble, modify (including circuit board replacement) or repair this product.**  
Such actions are likely to cause injuries or breakage.
2. **When an inspection is performed,**
  - Turn off the power supply.
  - Stop the air supply, exhaust the residual pressure in piping and verify that the air is released before performing maintenance work.  
Unexpected malfunction of system components and injury can result.

#### ⚠ Caution

1. **When handling and replacing the unit:**
  - Do not touch the sharp metal parts of the connector or plug.
  - Do not apply excessive force to the unit when disassembling.  
The connecting portions of the unit are firmly joined with seals.
  - When joining units, take care not to get fingers caught between units.  
Injury can result.
2. **Perform periodic inspection.**  
Unexpected malfunction in the system composition devices is likely to occur due to malfunction of machinery or equipment.
3. **After maintenance, make sure to perform an appropriate functionality inspection.**  
In cases of abnormality such as faulty operation, stop operation. Unexpected malfunction in the system composition devices is likely to occur.
4. **Do not use benzene and thinner for cleaning units.**  
Damage to the surface or erasure of the display can result. Wipe off any stains with a soft cloth.  
If the stain is persistent, wipe off with a cloth soaked in a dilute solution of neutral detergent and wrung out tightly, and then finish with a dry cloth.

Directional Control Valves

Air Cylinders

Rotary Actuators

Air Grippers

Air Preparation Equipment

Modular F. R.

Pressure Control Equipment

Fittings & Tubing

Flow Control Equipment

Pressure Switches/Pressure Sensors

#### ■ Trademark

DeviceNet® is a registered trademark of ODVA, Inc. EtherNet/IP® is a registered trademark of ODVA, Inc.  
EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.  
The product names stated in this catalog may be trademarks of their respective owners.

